

## **GENERATOR INTERCONNECTION APPLICATION**

### Category 3 (Combined) For All Projects with Aggregate Generator Output of More Than 150 kW but Less Than or Equal to 550 kW Also Serves as Application for Category 3 Net Metering (Note: Net Metering Program only available to Methane Digester Projects)


ELECTRIC UTILITY CONTACT I	NFORMATION		FOR OFFICE USE	ONLY	
Consumers Energy Interconnection Coordinator		Application Number			
			Date and Time Application Received		
1945 West Parnall Road (Room P14-205)					
Jackson, MI 49201 (517)788-1432					
Net Metering E-mail: net_metering@cmsenergy.con		m			
CUSTOMER / ACCOUNT INFORMATION Electric Utility Customer Information (As shown on utility bill)					
Customer Name (Last, First, Middle)		Customer Mail			
Customer Phone Number		Customer E-mail Address (Optional)			
( )					
Electric Service Account #		Electric Service Meter Number			
Are you applying for the Net Metering Program?		Are you interested in selling Renewable Energy Credits (REC's)?			
Yes No		Yes	No		
Do you have an Alternative Electric Supplier?					
Yes No If Yes, Name					
<b>Notes:</b> Enter name ONLY if your energy is supplied by a 3 <sup>rd</sup> party, not the utility. You must apply to both the Distribution Utility and your Alternate Energy Provider (if applicable) for Net Metering					
GENER	ATION SYSTEM	<b>M SITE INFC</b>	RMATION		
Physical Site Service Address (If Not Billing Address)					
Annual Site Requirements Without Generation in kWh	Peak Annual Site I	Demand in kW (	only for customers billed on Demand Rates)	Attached Site Plan	
kWh/year	kW			Page #	
Attached Electrical One-Line Drawing				_1	
Page #					
(Per MPSC Order in Case No. U-15787 – The One-Line I	Drowing must be sig	mod and applace	hy a licensed professional angineer	licenced in the State of	
Michigan or by an electrical contractor licensed by the Sta					
See Page 5 for sample Site Plan					
See Page 6 for sample of Inverter Generator		-			
See Page 7 for sample of Synchronous Generator Electrical One-Line Drawing					
See Page 8 for sample of Induction Generate		<u> </u>			
GENERATION SYSTEM MAN		-			
System Type (Solar, Wind, Biomass Methane Digester, etc)		Generator Typ	e (Inverter, Induction, Synchronous)		
Generator Nameplate Rating		Expected Annual Output in Kilowatt Hours			
kW		kWh/year			
A.C. Operating Voltage		Wiring Configuration (Single Phase, Three Phase)			
Certified Test Record No. (Testing to Standard UL1741 se	cope 1.1a)	<u> </u>			


INVERTER GENERATOR - BASED SYSTEMS				
Manufacturer	Model (Name/Number)	Inverter Power Rating (kW) kW		
SYNCHRONOUS AND INDUCTION GENERATOR - BASED SYSTEMS				
(Must complete either Page 3 or Page 4 and attach Electrical One-Line Drawing)				
<ul> <li>The following information on these system components shall appear on the Electrical One-Line Drawing:</li> <li>Breakers – Rating, location and normal operating status (open or closed)</li> <li>Buses – Operating voltage</li> <li>Capacitors – Size of bank in Kvar</li> <li>Circuit Switchers – Rating, location and normal operating status (open or closed)</li> <li>Current Transformers – Overall ratio, connected ratio</li> <li>Fuses – Normal operating status, rating (Amps), type</li> <li>Generators – Capacity rating (kVA), location, type, method of grounding</li> <li>Grounding Resistors – Size (ohms), current (Amps)</li> <li>Isolating Transformers – Capacity rating (kVA), location, impedance, voltage ratings, primary and secondary connections and method of grounding</li> <li>Potential Transformers – Ratio, connection</li> <li>Reactors – Ohms/phase</li> <li>Relays – Types, quantity, IEEE device number, operator lines indicating the device initiated by the relays</li> <li>Switches – Location and normal operating status (open or closed), type, rating</li> <li>Tagging Point – Location, identification</li> </ul>				
Manufacturer	Model Name	Model Number		
	INSTALLATION INFORM			
Project Single Po Name	Company (If Applicable)	Customer, Developer or Other) Phone Number		
Name				
E-Mail Address		Requested in Service Date		
Licensed Contractor(Name of Firm or Self)				
Contractor's Name (Last, First, MI)	Contractor's Phone #	Contractor's E-mail		
		ACTOR SIGNATURES AND FEES		
<ul> <li>Attached \$150 Interconnection A</li> <li>Attached \$100 combined Interconnection Application fee ald</li> <li>Check # Money</li> <li>Sign and Return Completed Application</li> </ul>	Application Fee OR onnection and Net Metering Proof ong with \$25 Application Fee for Order # ation with Application Fee to E e information provided in this	ogram Application Fees (Includes \$75 Net Metering) Electric Utility Contact application form is complete and correct.		
Project Developer/Contractor Signature (if appli	cable):	Date		
	Electric Utility Generator Interconnect nelines, and Technical Requirements	tion Requirements" for a detailed explanation of the s.		

SYNCHRONOUS GENERATORS				
GENERATOR INFORMATION				
Generator Nameplate Voltage	Generator Nameplate Watts or Volt-Amperes			
Generator Nameplate Power Factor (pf)	RPM			
TECHNICAL INFORMATION				
Minimum and Maximum Acceptable Terminal Voltage	Direct Axis Reactance (saturated)			
Direct Axis Reactance (unsaturated)	Quadrature Axis Reactance (unsaturated)			
Direct Axis Transient Reactance (saturated)	Direct Axis Transient Reactance (unsaturated)			
Quadrature Axis Transient Reactance (unsaturated)	Direct Axis Sub-Transient Reactance (saturated)			
Direct Axis Sub-Transient Reactance (unsaturated)	Leakage Reactance			
Direct Axis Transient Open Circuit Time Constant	Quadrature Axis Transient Open Circuit Time Constant			
Direct Axis Sub-Transient Open Circuit Time Constant	Quadrature Axis Sub-Transient Open Circuit Time Constant			
Open Circuit Saturation Curve				
Reactive Capability Curve Showing Overexcited and Underexcited Limits (Reactive Information if Non-Synchronous)				
Excitation System Block Diagram with Values for Gains and Time Constants	(Laplace Transforms)			
Short Circuit Current Contribution From Generator at the Point of Common Coupling				
Rotating Inertia of Overall Combination Generator, Prime Mover, Couplers and Gear Drives				
Station Power Load When Generator is Off-Line, Watts, pf	Station Power Load During Start-Up, Watts, pf			
Station Power Load During Operation, Watts, pf	1			

INDUCTION GENERATORS					
GENERATOR INFORMATION					
Generator Nameplate Voltage	Generator Nameplate Watts or Volt-Amperes				
Generator Nameplate Power Factor (pf)	RPM				
TECHNICAL INFORMATION					
Synchronous Rotational Speed	Rotation Speed at Rated Power				
Slip at Rated Power	Minimum and Maximum Acceptable Terminal Voltage				
Motoring Power (kW)	Neutral Grounding Resistor (If Applicable)				
12 2t or K (Heating Time Constant)	Rotor Resistance				
Stator Resistance	Stator Reactance				
Rotor Reactance	Magnetizing Reactance				
Short Circuit Reactance	Exciting Current				
Temperature Rise	Frame Size				
Design Letter	Reactive Power Required in Vars (No Load)				
Reactive Power Required in Vars (Full Load)					
Short Circuit Current Contribution from Generator at the Point of Common C	Coupling				
Rotating Inertia, H in Per Unit on kVA Base, of Overall Combination Genera	tor, Prime Mover, Couplers and Gear Drives				
Station Power Load When Generator is Off-Line, Watts, pf	Station Power Load During Start-Up, Watts, pf				
Station Power Load During Operation, Watts, pf	_1				

## SAMPLE SITE PLAN – PROVIDED FOR REFERENCE ONLY

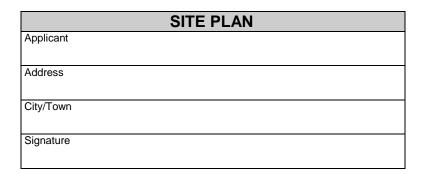

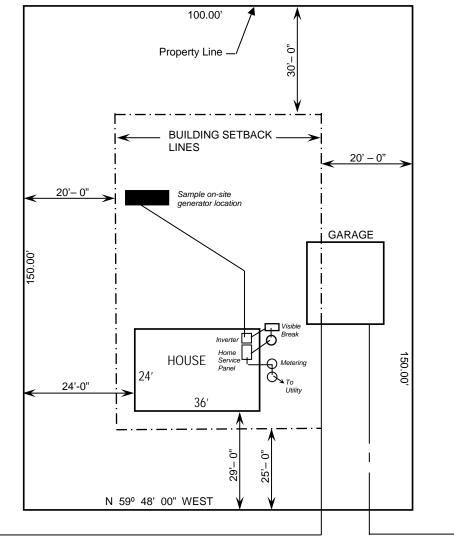

STREET


Weblink to State of Michigan / Plats:

http://www.cis.state.mi.us/platmaps/sr\_subs.asp

### Note: Legible hand drawn site plans are acceptable

## SAMPLE ONE-LINE DRAWING – PROVIDED FOR REFERENCE ONLY


## INVERTER GENERATOR UL 1741 SCOPE 1.1A COMPLIANT

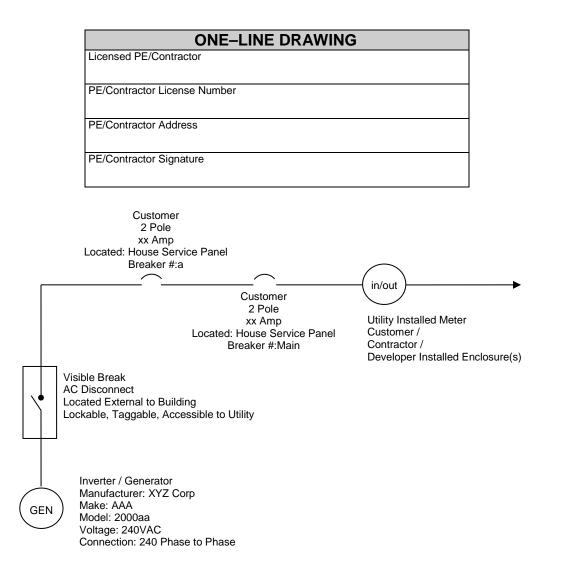

Note: Legible Hand Drawn One-Line is Acceptable

# SAMPLE ELECTRICAL ONE-LINE DRAWING – PROVIDED FOR REFERENCE ONLY TYPICAL ISOLATION AND FAULT PROTECTION FOR SYNCHRONOUS GENERATOR

ONE-LINE DRAWING		
Licensed PE/Contractor	PE/Contractor License Number	
PE/Contractor Address	PE/Contractor Signature	

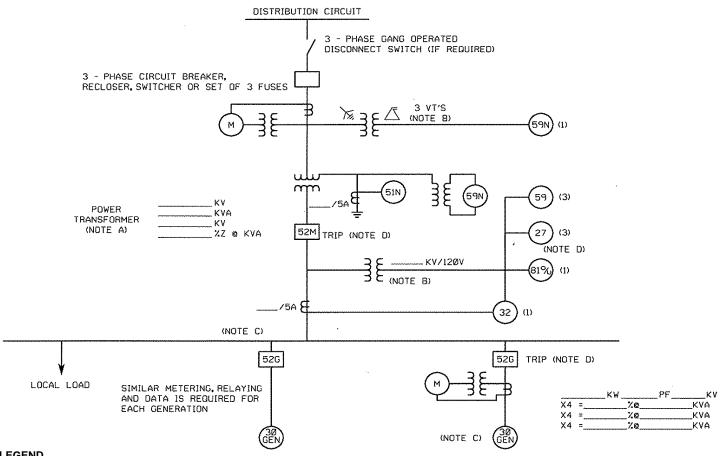

### LEGEND

27 Undervoltage


- 32 Reverse Power (Not Required for Flow-Back)
- 51N Neutral overcurrent (required for grounded secondary)
- 59 Overvoltage
- 59N Zero sequence overvoltage (assuming ungrounded secondary on power transformer)

81o/u Over/Underfrequency

### **NOTES**

- A) See technical requirements for permissible connection configurations and protection. Transformer connections proposed shall be shown on the one-line drawing by the Project Developer. Transformer connection and secondary grounding to be approved by Utility.
- B) Protection alternatives for the various acceptable transformer connections are shown. Only one protection alternative will ultimately be used, depending on the actual transformer winding connections. VT's for 59, 27, 81o/u and 32 are shown connected on the primary (Project side) of the power transformer, but may instead be connected on the secondary (Utility side). VT's are required on the secondary of the power transformer if a 59N is required for an ungrounded secondary connection. IEEE std 1547 requirements for voltage and frequency must be met at the PCC. IEEE Std. 1547 permits the VT's to be connected at the point of generator connection in certain cases.
- C) Main breaker protection, generator protection and synchronizing equipment are not shown.
- D) Trip of all 52G breakers or the 52M breaker is acceptable, depending upon whether the Project Developer wants to serve its own isolated load after loss of Utility service.

# SAMPLE ELECTRICAL ONE-LINE DRAWING – PROVIDED FOR REFERENCE ONLY TYPICAL ISOLATION AND FAULT PROTECTION FOR INDUCTION GENERATOR

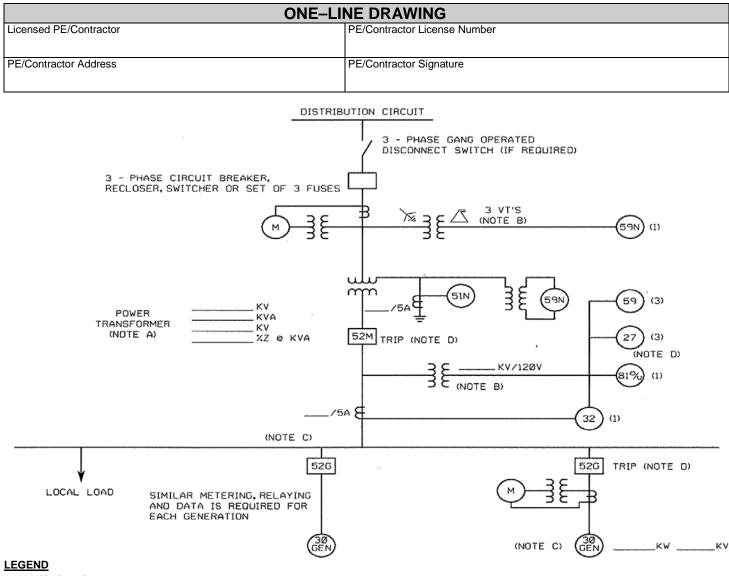

- 27 Undervoltage
- 32 Reverse Power (Not Required for Flow-Back)
- 51N Neutral overcurrent (required for grounded secondary)
- 59 Overvoltage
- 59N Zero sequence overvoltage (assuming ungrounded secondary on power transformer)
- 81o/u Over/Underfrequency

#### NOTES

- A) See technical requirements for permissible connection configurations and protection. Transformer connections proposed shall be shown on the one-line drawing by the Project Developer. Transformer connection and secondary grounding to be approved by Utility.
- B) Protection alternatives for the various acceptable transformer connections are shown. Only one protection alternative will ultimately be used, depending on the actual transformer winding connections. VT's for 59, 27, 81o/u and 32 are shown connected on the primary (Project side) of the power transformer, but may instead be connected on the secondary (Utility side). VT's are required on the secondary of the power transformer if a 59N is required for an ungrounded secondary connection. IEEE std 1547 requirements for voltage and frequency must be met at the PCC. IEEE Std. 1547 permits the VT's to be connected at the point of generator connection in certain cases.
- C) Main breaker protection, generator protection and synchronizing equipment are not shown.
- D) Trip of all 52G breakers or the 52M breaker is acceptable, depending upon whether the Project Developer wants to serve its own isolated load after loss of Utility service.