



Inflow Design Flood Control System Plan

J.H. CAMPBELL GENERATING FACILITY

POND A INFLOW DESIGN FLOOD CONTROL SYSTEM PLAN

West Olive, Michigan

Pursuant to 40 CFR 257.82

Submitted To: Consumers Energy Company
1945 W. Parnall Road
Jackson, Michigan 49201

Submitted By: Golder Associates Inc.
15851 South US 27, Suite 50
Lansing, Michigan 48906

October 2016

1654923





CERTIFICATION

Professional Engineer Certification Statement [40 CFR 257.82(c)]

I hereby certify that, having reviewed the attached documentation and being familiar with the provisions of Title 40 of the Code of Federal Regulations Section 257.82 (40 CFR Part 257.82), I attest that this Inflow Design Flood Control System Plan is accurate and has been prepared in accordance with good engineering practices, including the consideration of applicable industry standards, and with the requirements of 40 CFR Part 257.82.

Golder Associates Inc.



Signature

October 14, 2016

Date of Report Certification

John D. Puls, PE

Name

6201055787

Professional Engineer Certification Number

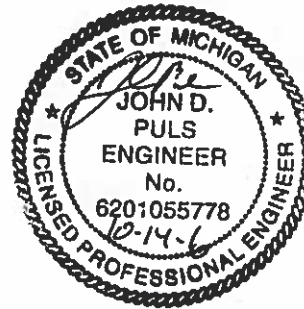




Table of Contents

CERTIFICATION..... C-1
Professional Engineer Certification Statement [40 CFR 257.82(c)]..... C-1
1.0 INTRODUCTION..... 1
1.1 Background 1
1.2 Purpose 1
2.0 FLOOD CONTROL SYSTEM 2
2.1 External Floodwater Protection 2
2.2 Internal Flood Control..... 2
3.0 PLAN REVISION AND RECORDKEEPING 4
4.0 REFERENCES..... 5

List of Tables

Table 2.2.1 Discharge Structure Summary
Table 2.2.2 Storm Flow Data

List of Figures

Figure 1 Site Location Map
Figure 2 Site Plan

List of Appendices

Appendix A FEMA Flood Elevation and Lake Michigan Normal Elevation
Appendix B Rainfall Data
Appendix C Hydrologic and Hydraulic Model Output



1.0 INTRODUCTION

1.1 Background

J.H. Campbell Generating Facility (JH Campbell) is a coal-fired power generation facility located near West Olive, Michigan as presented on Figure 1 – Site Location Map. JH Campbell Pond A is a hydraulically active coal combustion residuals (CCR) surface impoundment which receives commingled CCRs and low-volume miscellaneous wastewaters and serves as a detention basin to settle suspended solids and CCRs until they are mechanically removed to maintain adequate storage capacity. The pond has a primary 24-inch diameter corrugated metal pipe (CMP) outlet with a concrete energy dissipater, a 24-inch diameter primary CMP inlet, a 30-inch diameter CMP overflow inlet, and a 24-inch diameter high-density polyethylene (HDPE) inlet. The discharge from Pond A flows through an internal ditch (South Ditch) and pond system and ultimately through the site's National Pollutant Discharge Elimination System (NPDES) Outfall 002, regulated under the site's current NPDES permit.

1.2 Purpose

The purpose of the Inflow Design Flood Control System Plan (Plan) is to provide a basis for the certification required by 40 CFR 257.82 (Hydrologic and Hydraulic Capacity Requirements for CCR Surface Impoundments). Pond A has been rated a significant hazard potential as determined under 40 CFR 257.73(a)(2). 40 CFR 257.82(a) requires the owner or operator of the significant hazard potential CCR surface impoundment to design, construct, operate, and maintain an inflow flood control system as follows:

- Adequately manage the flow into the CCR unit during and following the peak discharge of the inflow of the 1000-year flood event
- Adequately manage the flow from the CCR unit to collect and control the peak discharge resulting from the 1000-year flood event
- Handle discharge from the CCR unit in accordance with the surface water requirements under 40 CFR 257.3-3



2.0 FLOOD CONTROL SYSTEM

To meet the requirements of 40 CFR 257.82(a), the flood control system must provide flood protection to the CCR unit during the inflow design flood (1000-year event) for two cases: 1) floodwater from outside the unit from the South Ditch and from the Pigeon River, and 2) controlling internal water levels within the unit.

2.1 External Floodwater Protection

Pond A is surrounded by a perimeter berm that provides external flood water protection. Based on borings completed in 2015, the berm is generally constructed of sand. Berms were constructed in 12-inch loose lifts and were compacted to a minimum 90 percent maximum compaction as documented in Sheet 2 of Drawing number 690-G-3930 (Commonwealth 1978). An access road travels the length of the perimeter berm.

Two potential inflow sources to Pond A were identified and evaluated: the South Ditch and the Pigeon River. The South Ditch parallels Pond A to the south. Given that the outer bank elevation of the South Ditch is approximately 605.00 (NGVD29) and the lowest perimeter berm elevation is 624.37 (NGVD29), overbank flow from the South Ditch during a 1000-year event should inundate areas to the south, away from Pond A. Therefore, the South Ditch should not be an inflow source to Pond A.

A publicly available 1000-year flood elevation for the Pigeon River has not been determined by Federal Emergency Management Agency (FEMA). As a result, Golder Associates Inc. (Golder) has estimated the 1000-year flood elevation by extrapolation of the FEMA data. The FEMA Flood Insurance Study (FIS) (FEMA 2013) reported the mouth of Pigeon River (Pigeon Lake) levels for the 10-, 50-, 100-, and 500-year recurrence intervals. The 100- and 500-year levels are 584.8 and 585.7 feet (NGVD29), respectively. Based on a logarithmic best fit curve extrapolation, the 1000-year Pigeon Lake level is approximately 586.2 feet (NGVD29). Based on FEMA Firm Map Numbers 26139C0195E and 26139C0190E, both Pigeon Lake and Pigeon River have 100-year flood elevations of 584.8 feet (NGVD29). FEMA elevations were converted from NAVD88 to NGVD29. Therefore, Golder has applied the extrapolated 1000-year level of Pigeon Lake to upstream areas of the Pigeon River that border Pond A to the south. The lowest elevation along the perimeter berm is 624.37 feet (NGVD29), which allows for 38.17 feet of freeboard during the 1000-year flood event. Therefore, the Pigeon River should not be an inflow source to Pond A.

2.2 Internal Flood Control

The only inflow other than ash process and low-volume miscellaneous wastewater will be precipitation directly falling on the pond and surrounding drainage areas from a 1000-year 24-hour storm event of 11.2 inches, as provided in Appendix B - Rainfall Data. There is one discharge structure in the perimeter berm:



one 24-inch CMP with two segments. Table 2.2.1 below provides a summary of the outflow structures as surveyed in May 2016.

Table 2.2.1 - Discharge Structure Summary

Discharge Structure	Type	Size (Inches)	Length (Feet)	Upstream Invert (NGVD29)	Downstream Invert (NGVD29)	Average Slope (%)
Pond A - Segment 1	CMP	24	345	613.50	608.50	1.45
Pond A - Segment 2	CMP	24	65	608.50	596.80	18.00

Pond A was modeled as one pond with a water level equal to that of the outfall pipe upstream invert elevation. Table 2.2.2 below provides a storm flow summary that indicates that Pond A is contained with 6.47 feet (NGVD29) of freeboard, a peak discharge rate of 14.5 cubic feet per second (cfs) during the design storm event (1000-year 24-hour). The modeled results indicate that:

- The inflow design flood control system adequately manages flow from the CCR unit to collect and control the peak discharge resulting from the inflow design flood (1000-year 24-hour storm event)

The hydrologic and hydraulic model output is provided in Appendix C - Hydrologic and Hydraulic Model Output. It should be noted that the pond elevations presented in Table 2.2.2 were used to assess the maximum storage pool loading condition pursuant to 40 CFR 257.73(e)(1)(i).

Table 2.2.2 – Storm Flow Data

Area	Perimeter Berm Elevation (NGVD29)	Pond Elevation 1000-year,24-hour (NGVD29)	Peak Outflow (cfs)
Pond A	624.37	617.90	14.5



3.0 PLAN REVISION AND RECORDKEEPING

Per 40 CFR 257.82(c)(2): “The owner or operator of the CCR unit may amend the written inflow design flood control system plan at any time provided the revised plan is placed in the facility's operating record as required by §257.105(g)(4). The owner or operator must amend the written inflow design flood control system plan whenever there is a change in conditions that would substantially affect the written plan in effect.”

Per 40 CFR 257.82(c)(4); “The owner or operator must prepare periodic inflow design flood control system plans required by paragraph (c)(1) of this section every five years. The date of completing the initial plan is the basis for establishing the deadline to complete the first periodic plan. The owner or operator may complete any required plan prior to the required deadline provided the owner or operator places the completed plan into the facility's operating record within a reasonable amount of time. In all cases, the deadline for completing a subsequent plan is based on the date of completing the previous plan. For purposes of this paragraph (c)(4), the owner or operator has completed an inflow design flood control system plan when the plan has been placed in the facility's operating record as required by §257.105(g)(4).”




4.0 REFERENCES

Commonwealth Associates Inc., Ash Pond Plan. Drawing number 690-G-3930. Sheet 2. September 6, 1978.

FEMA (Federal Emergency Management Agency). 2013. Flood Insurance Study, Ottawa County, Michigan. Effective May 16, 2013. Flood Insurance Study Number 26139CV001B.

USEPA (US Environmental Protection Agency). 2015. Disposal of Coal Combustion Residuals from Electric Utilities; Final Rule. 40 CFR Part 257. Effective Date October 19, 2015.

FIGURES

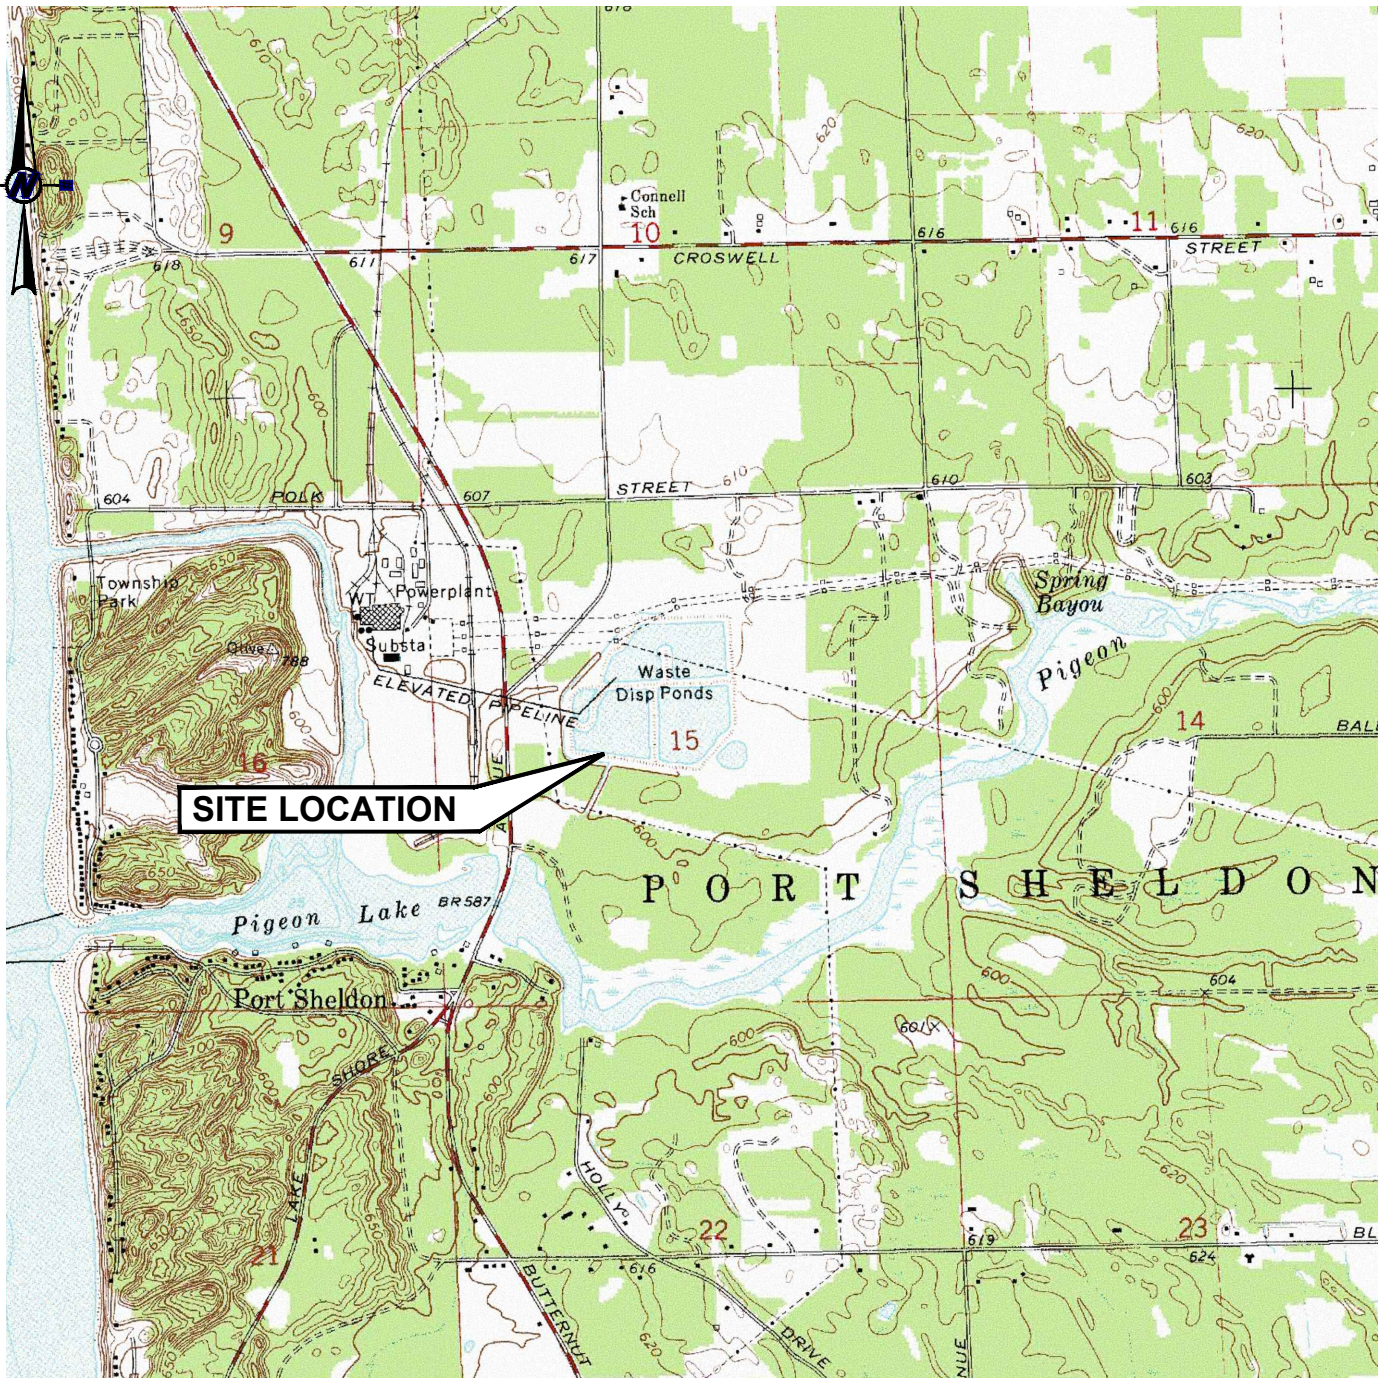


SITE LOCATION



REFERENCE(S)

1. BASE MAP TAKEN FROM 7.5 MINUTE U.S.G.S. QUADRANGLES OF PORT SHELDON MICHIGAN, DOWNLOADED FROM MICHIGAN DNR WEBSITE JUNE 2016.



CLIENT
CONSUMERS ENERGY COMPANY
 17000 CROSWELL ST.
 WEST OLIVE, MI 49460

PROJECT
J.H. CAMPBELL GENERATING FACILITY
 POND A FLOOD CONTROL PLAN

CONSULTANT

YYYY-MM-DD	2016-06-06
DESIGNED	BAL
PREPARED	ARM
REVIEWED	DJS
APPROVED	MAB



TITLE


SITE LOCATION MAP

PROJECT NO.
1654923

REV.
#

FIGURE
1

1b IF THIS MEASUREMENT DOES NOT MATCH WHAT IS SHOWN, THE SHEET SIZE HAS BEEN MODIFIED FROM ANSI A

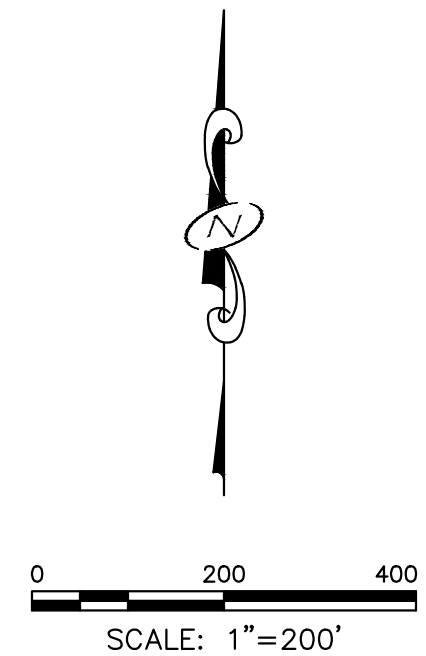

S:\Projects\094 - Collier Associates\2016 Projects\094-16-004 - JH Campbell RCRA Ash Pond Closure\CAD\094-16-004-EXIST-HYDRO.dwg 10/7/2016 9:17 AM

REV	DATE	DESCRIPTION	BY	CHK	APP	REV	DATE	DESCRIPTION	BY	CHK	APP	
						10/6/2016		FILED IN OWNER'S OPERATING RECORD		AM	DS	JP
REFERENCE DRAWINGS												



J.H. CAMPBELL ASH STORAGE FACILITY

EXISTING CONDITIONS
SITE PLAN

SCALE	1" = 200'	DRAWING NO.		FIGURE	2	UNIT#	
JOB	1654923			REV.	A		

APPENDIX A
FEMA FLOOD ELEVATION AND LAKE MICHIGAN NORMAL ELEVATION

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **Floodways** have been determined, users are encouraged to consult the **Flood Profiles and Floodway Data and/or Summary of Stillwater Elevations** tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0.0' North American Vertical Datum of 1988 (NAVD 88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **Roadways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to Section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The projection used in the preparation of this map was Michigan State Plane South zone 8401 (FIPSZONE 2113). The horizontal datum was NAD83. Differences in datum, national projection or state plane zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the North American Vertical Datum of 1988. These flood elevations must be compared to structure and ground elevations referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
 NOAA, NGS012
 National Geodetic Survey
 5350 3rd Avenue
 Silver Spring, Maryland 20910-3282
 (301) 713-3242

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242 or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this FIRM was derived from the Ottawa County, Michigan GIS Office from photography dated 2004. This map reflects more detailed and up-to-date **stream channel configurations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.



Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels, community map repository addresses, and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

For information on available products associated with this FIRM visit the **Map Service Center (MSC)** website at <http://www.fema.gov/business/mfc>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. Many of these products can be ordered or obtained directly from the MSC website.

If you have **questions about this map**, how to order products, or the National Flood Insurance Program in general, please call the **FEMA Map Information Exchange (MIEX)** at 1-877-FEMA-MAP or visit the FEMA website at <http://www.fema.gov/business/mfc>.


The **profile base lines** depicted on this map represent the hydraulic modeling baselines that match the flood profiles in the FIS report. As a result of improved topographic data, the **profile base line** in some cases, may deviate significantly from the channel centerline or appear outside the SFHA.

PANEL INDEX

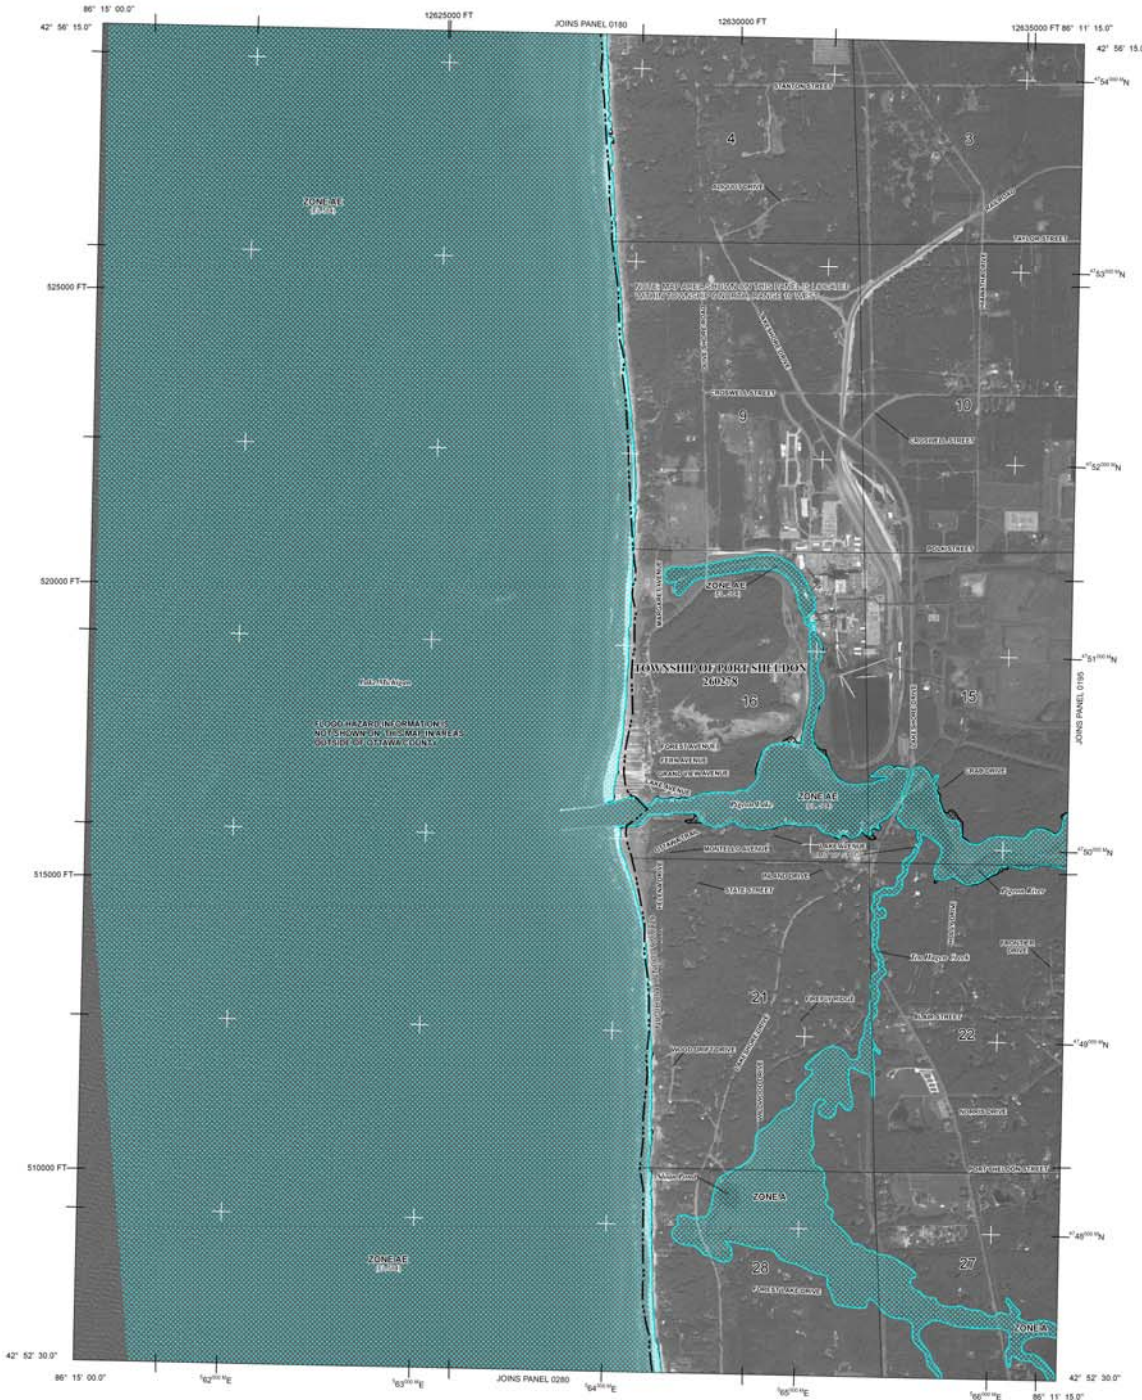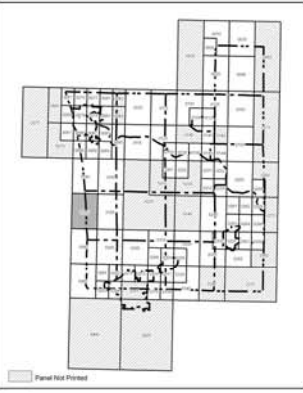

LEGEND

- SPECIAL FLOOD HAZARD AREAS SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD
- ZONE AE**
No Base Flood Elevations determined.
- ZONE AH**
Base Flood Elevations determined.
- ZONE AH**
Road depths of 1 to 3 feet (usually areas of parking); Base Flood Elevations determined.
- ZONE AD**
Road depths of 1 to 3 feet (usually built flow on sloping terrain); average depths determined. For areas of shallow fan flooding, velocities also determined.
- ZONE AR**
Area of special flood hazard formerly protected from the 1% annual chance flood event by a flood control system that was subsequently abandoned. Zone AR indicates that the former flood control system is being replaced to provide protection from the 1% annual chance of greater flood.
- ZONE A99**
Area to be protected from 1% annual chance flood event by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V**
Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE**
Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.
- FLOODWAY AREAS IN ZONE AE
- OTHER FLOOD AREAS**
- ZONE B**
Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or of average width less than 1 square mile; and areas protected by levees from 1% annual chance of greater flood.
- OTHER AREAS**
- ZONE X**
Areas determined to be outside of the 0.2% annual chance floodplain.
- ZONE D**
Areas in which flood hazards are undetermined, but possible.
- COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS
- OTHERWISE PROTECTED AREAS (OPAs)
- CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.
- 1% annual chance floodplain boundary
- 0.2% annual chance floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary Abutting Special Flood Hazard Areas of adjacent Base Flood Elevations, Flood depths or flood velocities.
- Base Flood Elevation line and value elevation in feet
- Base Flood Elevation value where within zone elevation in feet



NFIP
NATIONAL FLOOD INSURANCE PROGRAM

PANEL 0190E

FIRM
FLOOD INSURANCE RATE MAP
OTTAWA COUNTY,
MICHIGAN
(ALL JURISDICTIONS)

PANEL 190 OF 425
 (SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS
 COMMUNITY NUMBER PANEL SUFFIX
 FORT SHELDON TOWNSHIP OF 26077 0190 E

Note to User: The Map Number shown below should be used when placing map orders; the Community Number shown above should be used in insurance applications for the insured community.

MAP NUMBER
26139C0190E

EFFECTIVE DATE
DECEMBER 16, 2011

Federal Emergency Management Agency

NOTES TO USERS

This map is for use in administering the National Flood Insurance Program. It does not necessarily identify all areas subject to flooding, particularly from local drainage sources of small size. The community map repository should be consulted for possible updated or additional flood hazard information.

To obtain more detailed information in areas where the **Base Flood Elevations (BFEs)** and/or **Footprints** have been determined, users are encouraged to consult the **Flood Profiles and Floodway Data** and/or **Summary of Stillwater Elevations** tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRMs. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only to landward of 0.0' North American Vertical Datum of 1988 (NAVD 88). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations table in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations table should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **Roadways** were computed at cross sections and interpolated between cross sections. The roadways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to Section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures for this jurisdiction.

The projection used in the preparation of this map was Michigan State Plane South zone 6401 (FIPSZONE 2113). The horizontal datum was NAD83. Differences in datum, national projection or state plane zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of the FIRM.

Flood elevations on this map are referenced to the North American Vertical Datum of 1988. These flood elevations must be compared to structure and ground elevations referenced to the same vertical datum. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at <http://www.ngs.noaa.gov/> or contact the National Geodetic Survey at the following address:

NGS Information Services
 NOAA, NGS012
 National Geodetic Survey
 5350-3, #6202
 Silver Spring, Maryland 20910-3282
 (301) 713-3242

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242, or visit its website at <http://www.ngs.noaa.gov/>.

Base Map information shown on this FIRM was derived from the Ottawa County, Michigan GIS Office from photography dated 2004. This map reflects more detailed and up-to-date stream channel configurations than those shown on the previous FIRM for this jurisdiction. The floodplains and roadways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.



Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels, community map repository addresses, and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

For information on available products associated with this FIRM visit the **Map Service Center (MSC)** website at <http://www.fema.gov/>. Available products may include previously issued Letters of Map Change, a Flood Insurance Study Report, and/or digital versions of this map. Many of these products can be ordered or obtained directly from the MSC website.

If you have **questions about this map**, how to order products, or the National Flood Insurance Program in general, please call the **FEMA Map Information Exchange (FMIX)** at 1-877-FEMA-MAP or visit the FEMA website at <http://www.fema.gov/business/fmif>.

The **profile base lines** depicted on this map represent the hydraulic modeling baselines that match the flood profiles in the FIS report. As a result of improved topographic data, the profile base line in some cases, may deviate significantly from the channel centerline or appear outside the SFHA.

PANEL INDEX

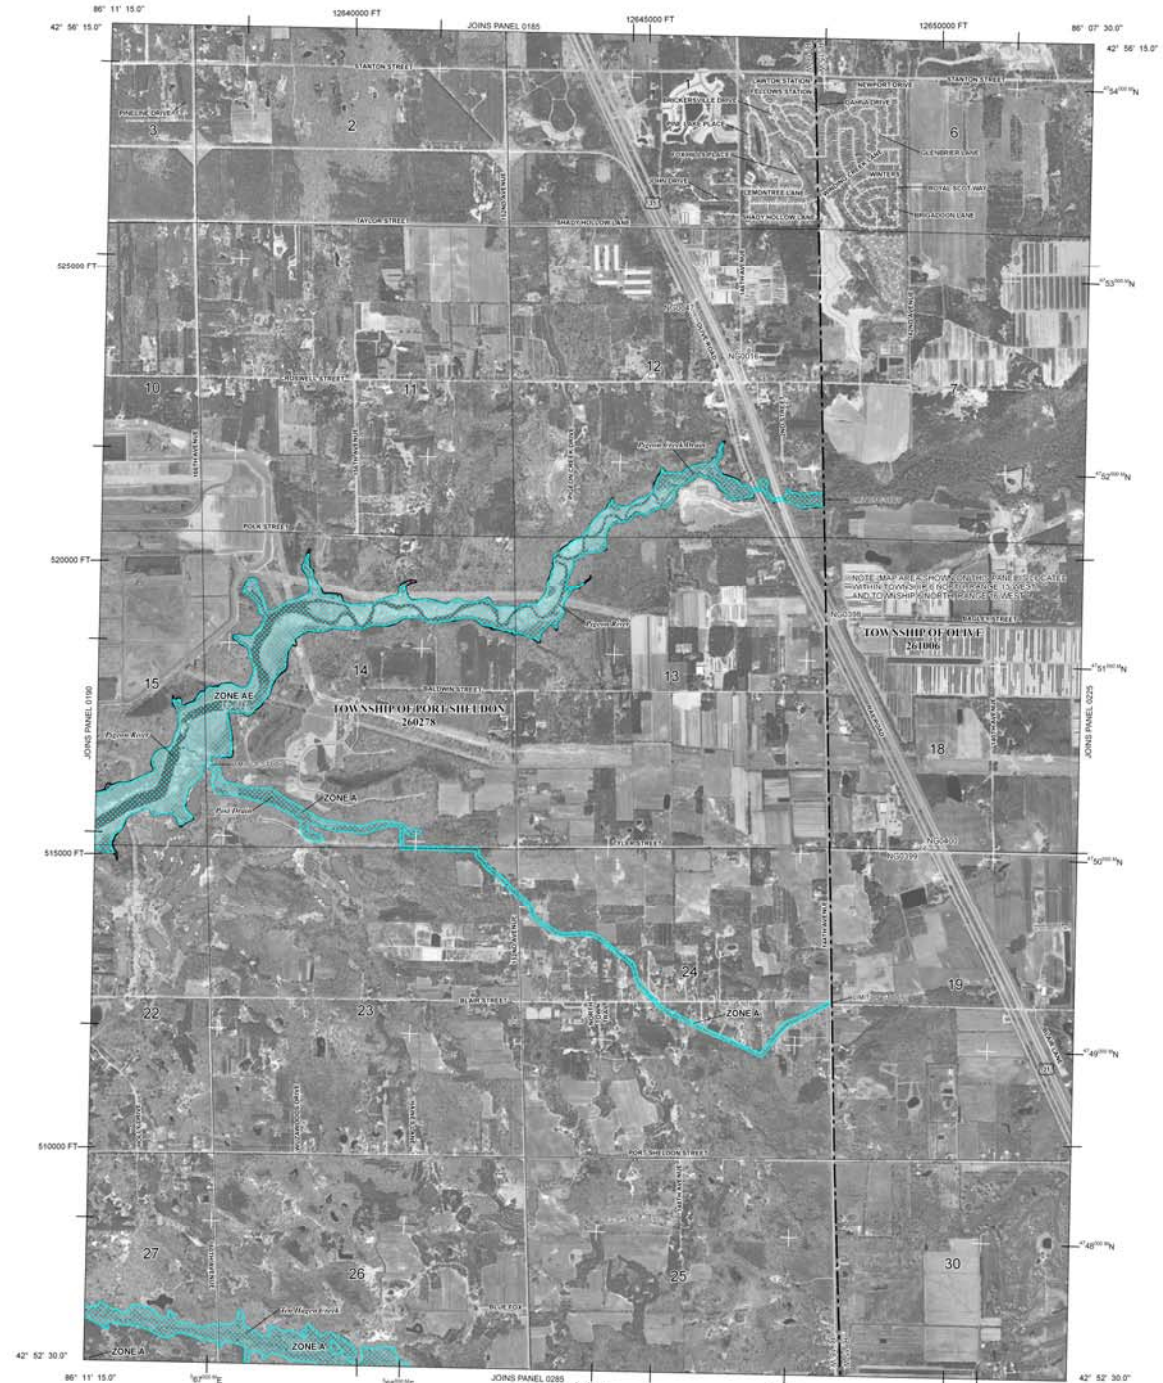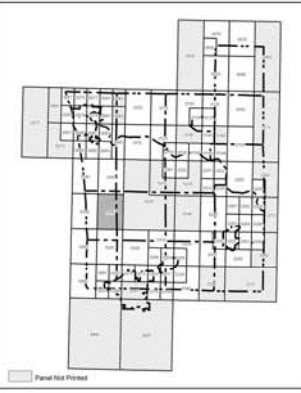

LEGEND

SPECIAL FLOOD HAZARD AREAS SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

The 1% annual chance flood (100-year flood), also known as the base flood, is the flood that has a 1% chance of being equaled or exceeded in any given year. The Special Flood Hazard Area is the area subject to flooding by the 1% annual chance flood. Areas of Special Flood Hazard include Zone AE, Zone A, Zone X, Zone D, and Zone V. The Base Flood Elevation is the water-surface elevation of the 1% annual chance flood.

Zone A No Base Flood Elevations determined.

Zone AE Base Flood Elevations determined.

Zone AH Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined; For areas of shallow fan flooding, velocities also determined.

Zone AD Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined; For areas of shallow fan flooding, velocities also determined.

Zone AR Area of special flood hazard formerly protected from the 1% annual chance flood event by a flood control system that was subsequently abandoned. Zone AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.

Zone ARS Area to be protected from 1% annual chance flood event by a Federal flood protection system under construction; no Base Flood Elevations determined.

Zone AV Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.

Zone VE Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

FLOODWAY AREAS IN ZONE AE

The floodway is the channel of a stream plus any adjacent floodplain areas that must be kept free of encroachment so that the 1% annual chance flood can be carried without substantial increases in flood heights.

OTHER FLOOD AREAS

Zone X Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot and stream widths less than 100 feet; and areas protected by levees from the 1% annual chance or greater flood.

Zone D Areas determined to be outside of the 0.2% annual chance floodplain.

Zone V Areas in which flood hazards are undetermined, but possible.

COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS

OTHERWISE PROTECTED AREAS (OPAs)

CBRS areas and OPAs are normally located within or adjacent to Special Flood Hazard Areas.

- 1% annual chance floodplain boundary
- 0.2% annual chance floodplain boundary
- Floodway boundary
- Zone D boundary
- Zone V boundary
- CBRS area boundary
- Boundary Abandoning Special Flood Hazard Area of different Base Flood Elevation, Flood depths or flood velocities.
- Base Flood Elevation line and water elevation in feet* (E1, E2)
- Base Flood Elevation value where within zone elevation in feet* (E1, E2)

Referenced to the North American Vertical Datum of 1988.

Other Symbols:

- Cross section line
- Transit line
- Ridge
- Culvert
- Geoid
- Geoid coordinate referenced to the North American Datum of 1983 (NAD 83), UTM Hemisphere
- 100-year (average) recurrence interval gage station, zone AE
- 500-year (average) recurrence interval gage station, zone AE
- 500-year (average) recurrence interval gage station, zone AE (FIPSZONE 2113), Lambert Conformal Conic projection
- Bench mark (see explanation in Notes to Users section of this FIRM panel)
- M1.5 River Mile

MAP REPOSITORY

Refer to listing of Map Repositories on Map Index.

EFFECTIVE DATE OF COUNTY-WIDE FLOOD INSURANCE RATE MAP
 December 16, 2011

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL

For community map revision history, prior to coordinate mapping, refer to the Community Map History located in the Flood Insurance Study report for this jurisdiction. To determine if flood insurance is available in a community, contact your insurance agent or call the National Flood Insurance Program at 1-800-658-6623.

NFIP

PANEL 0195E

FIRM
FLOOD INSURANCE RATE MAP
OTTAWA COUNTY,
MICHIGAN
(ALL JURISDICTIONS)

PANEL 195 OF 425
 (SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS	SUBMER PANEL	SUFFIX
COMMUNITY	261006	0195 E
COUNTY	261006	0195 E
FIRM REVISION	261006	0195 E


Note to User: The Map Number shown below should be used when placing map orders. The Community Number shown above should be used in insurance applications for the insured community.

MAP NUMBER
26139C0195E

EFFECTIVE DATE
DECEMBER 16, 2011

Federal Emergency Management Agency

Lake Michigan–Huron

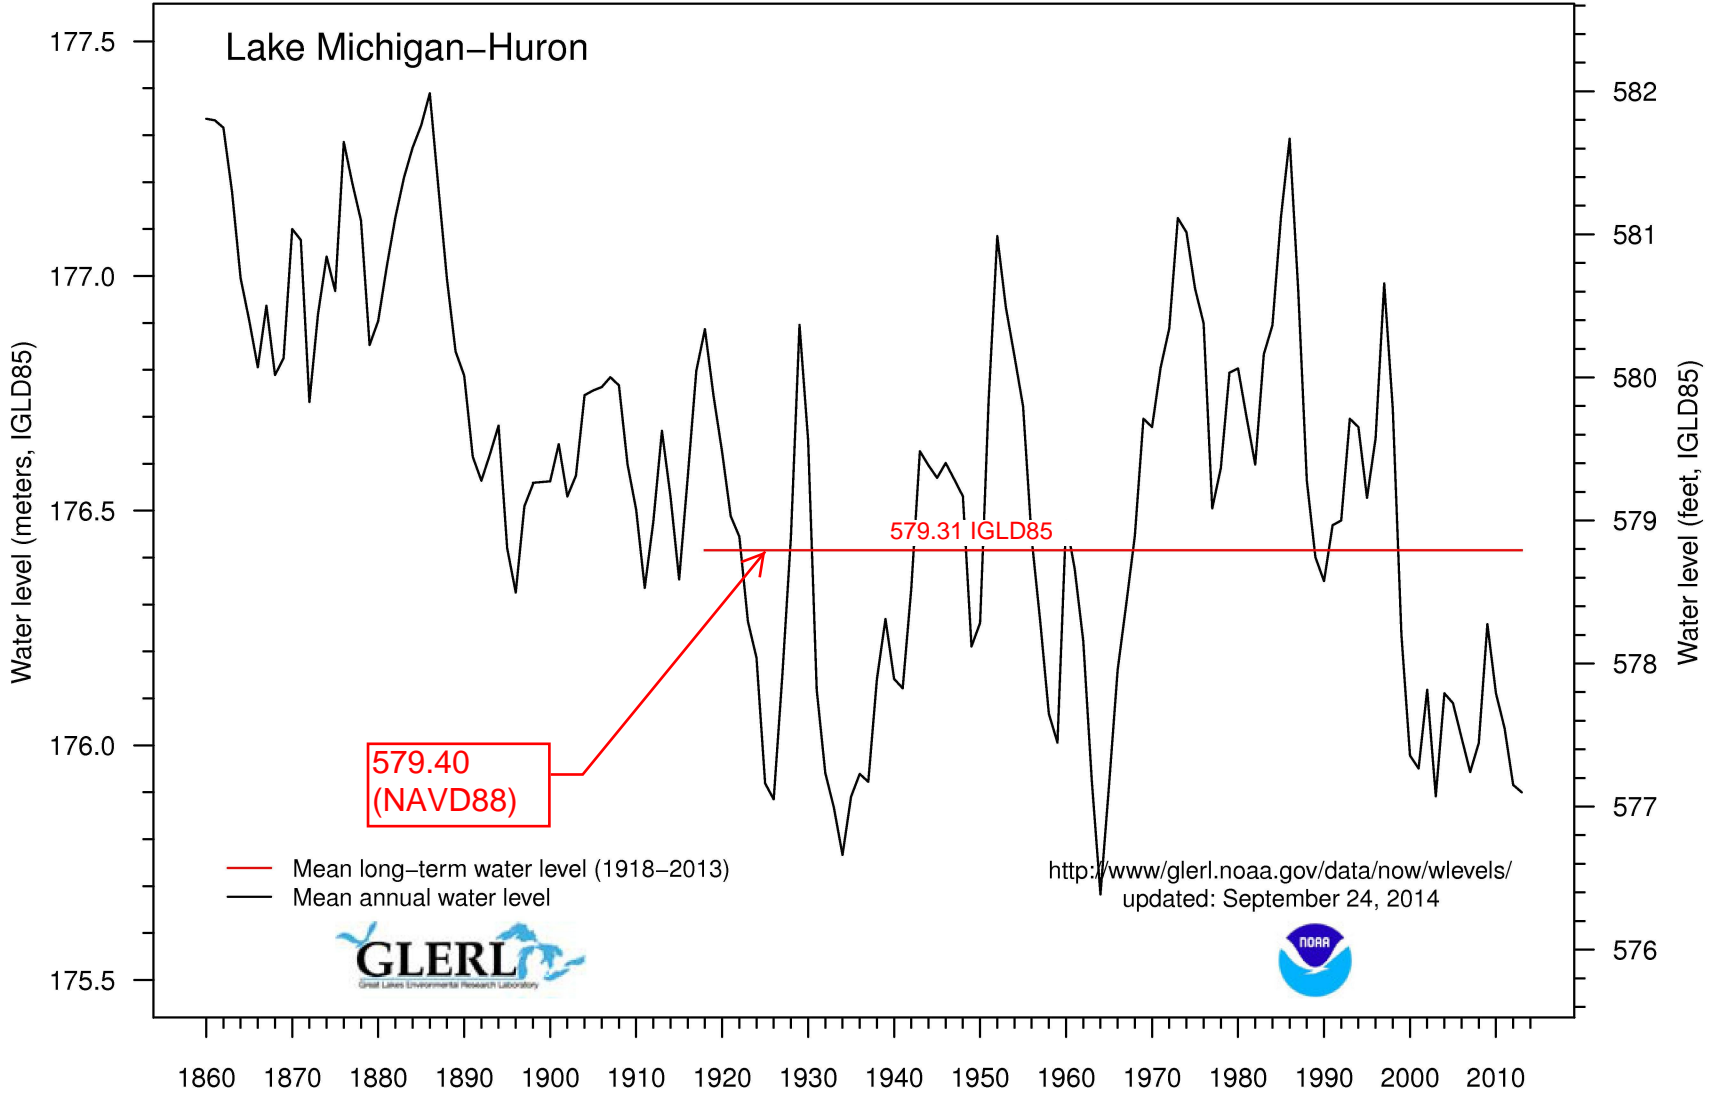

FLOOD INSURANCE STUDY

VOLUME 1 OF 2



OTTAWA COUNTY, MICHIGAN (ALL JURISDICTIONS)

Community Name	Community Number
Allendale, Charter Township of	260490
* Blendon, Township of	261005
Chester, Township of	260829
Coopersville, City of	260491
Crockery, Township of	260981
Ferrysburg, City of	260184
Georgetown, Charter Township of	260589
Grand Haven, City of	260269
Grand Haven, Charter Township of	260270
Holland, City of (Allegan and Ottawa Counties)	260006
Holland, Charter Township of	260492
Hudsonville, City of	260493
Jamestown, Charter Township of	261001
* Olive, Township of	261006
Park, Township of	260185
Polkton, Charter Township of	260923
Port Sheldon, Township of	260278
Robinson, Township of	260913
Spring Lake, Township of	260281
Spring Lake, Village of	260282
Tallmadge, Charter Township of	260494
Wright, Township of	260495
Zeeland, Charter Township of	260932
Zeeland, City of	260983

* No Special Flood Hazard Areas identified



REVISED:
May 16, 2013



Federal Emergency Management Agency

FLOOD INSURANCE STUDY NUMBER
26139CV001B

TABLE 8 – Summary of Stillwater Elevations (*continued*)

<u>Flooding Source and Location</u>	<u>Peak Elevation (feet NAVD88)</u>			
	<u>10%</u>	<u>2%</u>	<u>1%</u>	<u>0.2%</u>
	<u>Annual</u>	<u>Annual</u>	<u>Annual</u>	<u>Annual</u>
	<u>Chance</u>	<u>Chance</u>	<u>Chance</u>	<u>Chance</u>
Lake Macatawa				
Charter Township and City of Holland and Township of Park	582.8 ¹	583.9 ¹	584.3 ¹	585.2 ¹
Lake Michigan				
Entire shoreline	582.8	583.9	584.3	585.2
Lloyd's Bayou				
Township and Village of Spring Lake	582.8 ¹	583.9 ¹	584.7 ²	586.6 ²
Morning Dew Lake				
Charter Township of Holland	*	*	610.3	*
Mill House Bayou				
Charter Township of Grand Haven	584.9 ²	586.7 ²	587.5 ²	589.5 ²
Pigeon Lake				
Township of Port Sheldon	582.8 ¹	583.9 ¹	584.3 ¹	585.2 ¹
Pottawattomie Bayou				
Charter Township and City of Grand Haven	584.4 ²	586.3 ²	587.1 ²	589.1 ²
Rushmore Lake				
Charter Township of Georgetown	*	*	606.8	*
Spring Lake				
City of Ferrysburg and Township and Village of Spring Lake	582.8 ¹	583.9 ¹	584.3 ¹	585.2 ¹
Waterfront Lake				
Charter Township of Georgetown	*	*	606.7	*
West Georgetown Shores Lake				
Charter Township of Georgetown	*	*	608.9	*

* Data not available

¹ Elevation controlled by peak flood elevation of Lake Michigan

² Elevation controlled by peak flood elevation of the Grand River

Hydrologic calculations were performed using approximate methods for each of the approximate-study streams listed in Section 1.2 to estimate the peak 1-percent-annual-chance flood discharges.

Discharges for the approximate-study streams studied as a part of Phase I were provided by MDEQ. No information regarding the hydrologic analyses performed to estimate the discharges for these streams was available for this study.

Discharges for the approximate-study stream studied as a part of Phase II were calculated by Stantec. Subbasins were delineated at various locations along each reach. The method of analysis used for each subbasin was selected based upon the contributing drainage area.

**APPENDIX B
RAINFALL DATA**



NOAA Atlas 14, Volume 8, Version 2
Location name: West Olive, Michigan, US*
Latitude: 42.9081°, Longitude: -86.1972°
Elevation: 606 ft*
 * source: Google Maps



POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Deborah Martin, Sandra Pavlovic, Ishani Roy, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Michael Yekta, Geoffrey Bonnin

NOAA, National Weather Service, Silver Spring, Maryland

[PF tabular](#) | [PF graphical](#) | [Maps & aerials](#)



PF tabular

PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)¹										
Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	0.307 (0.251-0.382)	0.362 (0.296-0.451)	0.459 (0.373-0.572)	0.544 (0.440-0.682)	0.671 (0.526-0.877)	0.776 (0.591-1.03)	0.886 (0.650-1.20)	1.01 (0.704-1.39)	1.17 (0.786-1.66)	1.30 (0.848-1.87)
10-min	0.450 (0.368-0.560)	0.531 (0.433-0.661)	0.671 (0.546-0.838)	0.797 (0.644-0.999)	0.982 (0.771-1.28)	1.14 (0.866-1.50)	1.30 (0.952-1.75)	1.47 (1.03-2.04)	1.71 (1.15-2.44)	1.91 (1.24-2.74)
15-min	0.549 (0.449-0.683)	0.647 (0.528-0.806)	0.819 (0.666-1.02)	0.972 (0.786-1.22)	1.20 (0.940-1.57)	1.39 (1.06-1.83)	1.58 (1.16-2.14)	1.79 (1.26-2.49)	2.09 (1.40-2.97)	2.33 (1.51-3.34)
30-min	0.768 (0.628-0.955)	0.907 (0.741-1.13)	1.15 (0.937-1.44)	1.37 (1.11-1.72)	1.69 (1.33-2.21)	1.96 (1.49-2.59)	2.24 (1.64-3.03)	2.54 (1.78-3.52)	2.96 (1.99-4.22)	3.30 (2.15-4.74)
60-min	0.999 (0.817-1.24)	1.18 (0.962-1.47)	1.50 (1.22-1.87)	1.79 (1.44-2.24)	2.22 (1.75-2.92)	2.59 (1.98-3.43)	2.98 (2.19-4.03)	3.40 (2.39-4.72)	4.00 (2.69-5.69)	4.48 (2.91-6.43)
2-hr	1.23 (1.01-1.52)	1.45 (1.19-1.79)	1.84 (1.51-2.28)	2.20 (1.80-2.74)	2.75 (2.18-3.58)	3.21 (2.48-4.23)	3.71 (2.75-4.99)	4.26 (3.01-5.87)	5.03 (3.41-7.11)	5.66 (3.71-8.05)
3-hr	1.38 (1.14-1.69)	1.62 (1.34-1.99)	2.06 (1.70-2.53)	2.47 (2.02-3.05)	3.10 (2.48-4.03)	3.64 (2.82-4.77)	4.23 (3.15-5.67)	4.87 (3.46-6.69)	5.79 (3.94-8.16)	6.54 (4.31-9.27)
6-hr	1.66 (1.38-2.01)	1.93 (1.61-2.34)	2.45 (2.03-2.98)	2.94 (2.43-3.60)	3.72 (3.01-4.81)	4.40 (3.44-5.73)	5.14 (3.87-6.86)	5.97 (4.29-8.16)	7.17 (4.93-10.0)	8.15 (5.41-11.5)
12-hr	1.95 (1.64-2.34)	2.26 (1.90-2.71)	2.85 (2.39-3.44)	3.44 (2.86-4.16)	4.36 (3.56-5.61)	5.18 (4.09-6.70)	6.08 (4.62-8.05)	7.09 (5.14-9.63)	8.56 (5.94-11.9)	9.78 (6.54-13.6)
24-hr	2.26 (1.91-2.68)	2.60 (2.20-3.09)	3.26 (2.75-3.89)	3.92 (3.28-4.70)	4.97 (4.09-6.34)	5.91 (4.71-7.58)	6.95 (5.32-9.12)	8.11 (5.93-10.9)	9.82 (6.87-13.6)	11.2 (7.58-15.5)
2-day	2.60 (2.23-3.07)	2.96 (2.53-3.49)	3.67 (3.13-4.34)	4.38 (3.70-5.20)	5.51 (4.58-6.96)	6.53 (5.24-8.29)	7.65 (5.91-9.96)	8.91 (6.57-11.9)	10.8 (7.60-14.7)	12.3 (8.37-16.9)
3-day	2.86 (2.45-3.34)	3.23 (2.77-3.78)	3.96 (3.38-4.65)	4.68 (3.97-5.52)	5.83 (4.86-7.31)	6.86 (5.54-8.66)	8.01 (6.21-10.4)	9.29 (6.88-12.3)	11.2 (7.91-15.2)	12.7 (8.69-17.4)
4-day	3.06 (2.64-3.57)	3.45 (2.97-4.02)	4.20 (3.60-4.91)	4.93 (4.20-5.79)	6.09 (5.09-7.59)	7.13 (5.77-8.95)	8.27 (6.43-10.6)	9.54 (7.09-12.6)	11.4 (8.11-15.5)	13.0 (8.88-17.6)
7-day	3.58 (3.10-4.13)	4.01 (3.48-4.64)	4.82 (4.16-5.59)	5.59 (4.79-6.51)	6.78 (5.68-8.31)	7.80 (6.34-9.68)	8.93 (6.98-11.3)	10.2 (7.58-13.3)	11.9 (8.54-16.0)	13.4 (9.25-18.1)
10-day	4.05 (3.53-4.65)	4.53 (3.94-5.21)	5.40 (4.68-6.23)	6.20 (5.34-7.18)	7.41 (6.21-9.00)	8.44 (6.87-10.4)	9.54 (7.48-12.0)	10.7 (8.04-13.9)	12.4 (8.92-16.6)	13.8 (9.59-18.6)
20-day	5.50 (4.83-6.25)	6.11 (5.36-6.95)	7.15 (6.25-8.16)	8.05 (6.99-9.23)	9.34 (7.85-11.1)	10.4 (8.50-12.5)	11.5 (9.04-14.2)	12.6 (9.49-16.1)	14.2 (10.2-18.6)	15.4 (10.8-20.6)
30-day	6.76 (5.97-7.64)	7.49 (6.61-8.47)	8.69 (7.64-9.86)	9.69 (8.47-11.1)	11.1 (9.34-13.0)	12.2 (10.0-14.6)	13.3 (10.5-16.3)	14.4 (10.9-18.2)	15.9 (11.5-20.7)	17.0 (12.0-22.6)
45-day	8.39 (7.45-9.43)	9.29 (8.23-10.4)	10.7 (9.47-12.1)	11.9 (10.4-13.5)	13.4 (11.3-15.6)	14.6 (12.0-17.3)	15.7 (12.5-19.1)	16.8 (12.7-21.1)	18.3 (13.2-23.6)	19.3 (13.6-25.5)
60-day	9.80 (8.73-11.0)	10.9 (9.66-12.2)	12.5 (11.1-14.0)	13.8 (12.2-15.6)	15.5 (13.1-17.9)	16.8 (13.8-19.7)	17.9 (14.3-21.7)	19.1 (14.5-23.8)	20.4 (14.9-26.3)	21.4 (15.2-28.2)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS). Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values. Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical

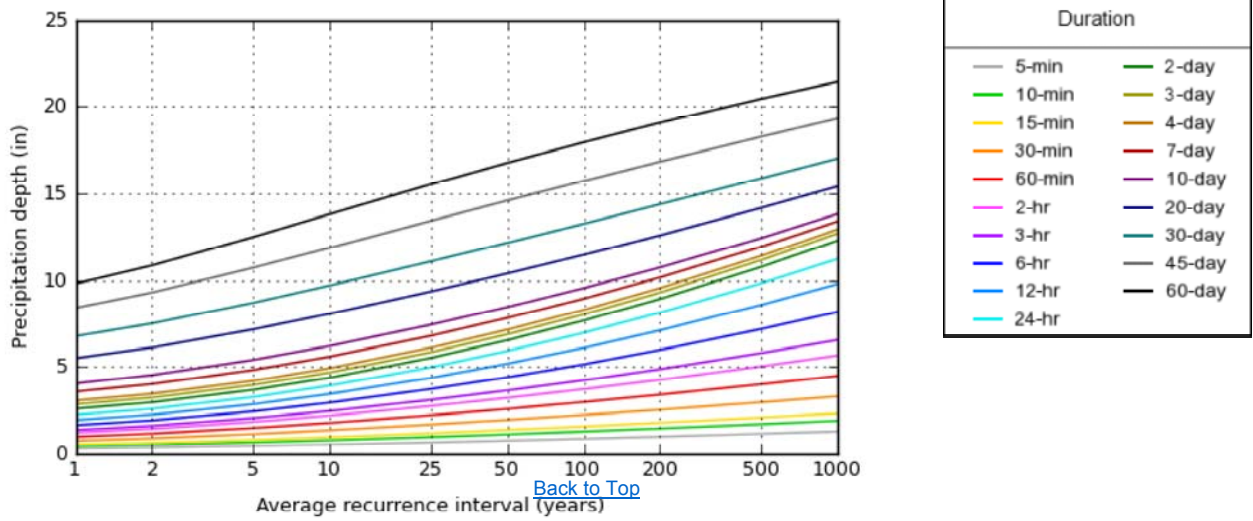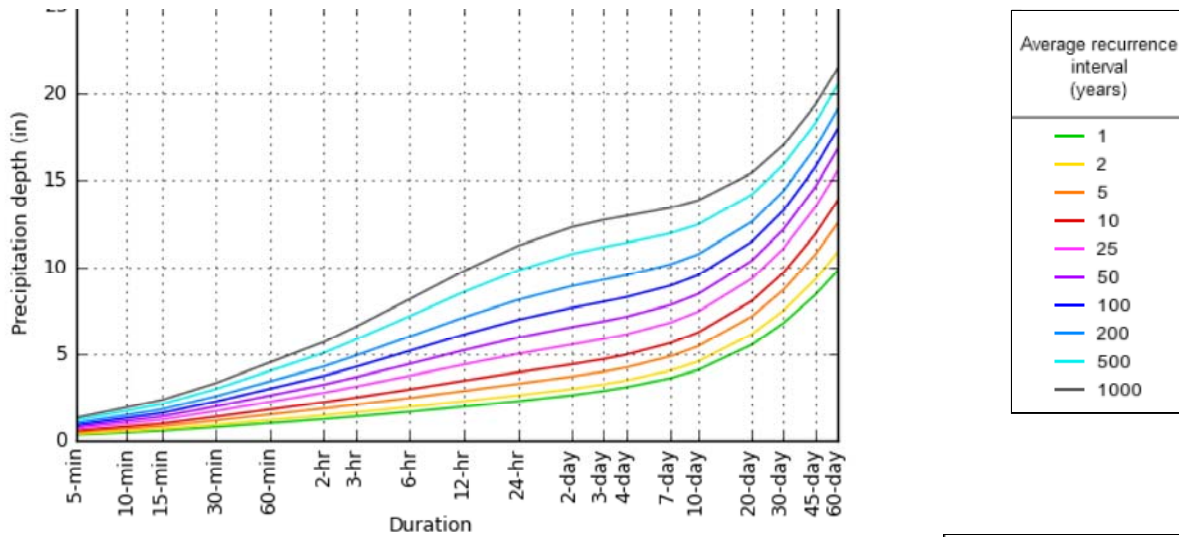


[Back to Top](#)

NOAA Atlas 14, Volume 8, Version 2

Maps & aeri

Created (GMT): Mon Jul 18 19:24:26 2016


Small scale terrain

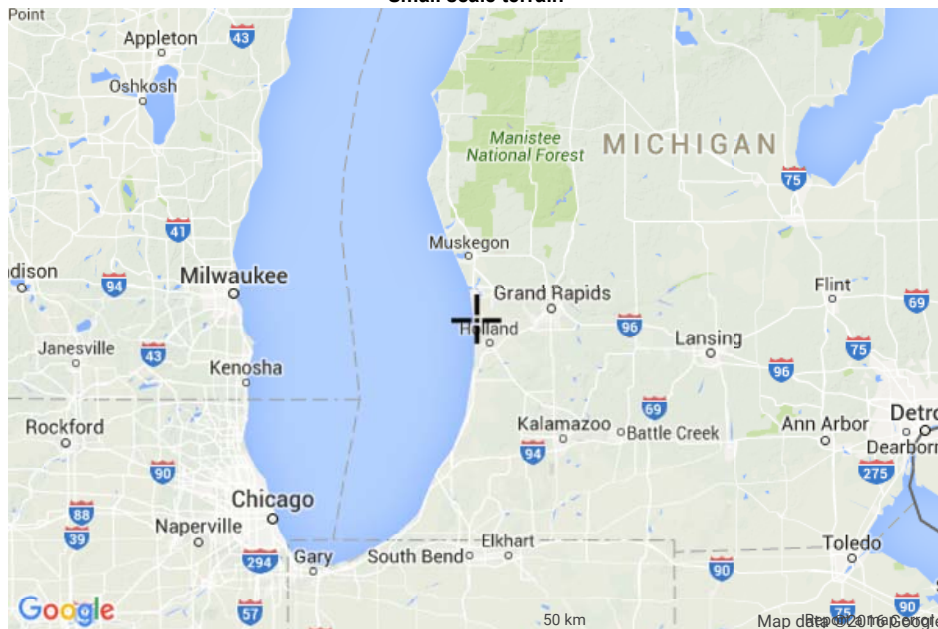


Large scale terrain



Large scale map

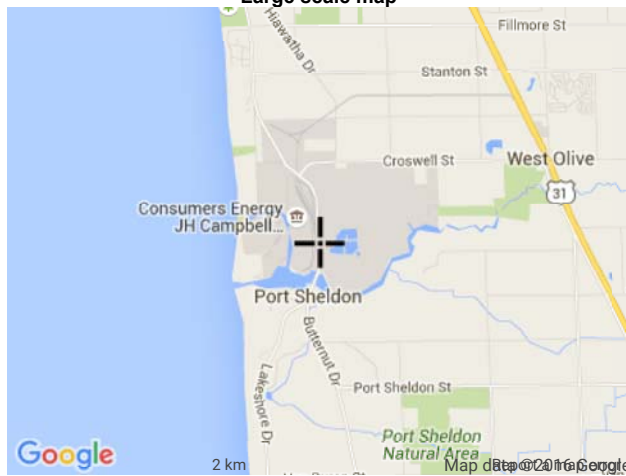

Large scale aerial

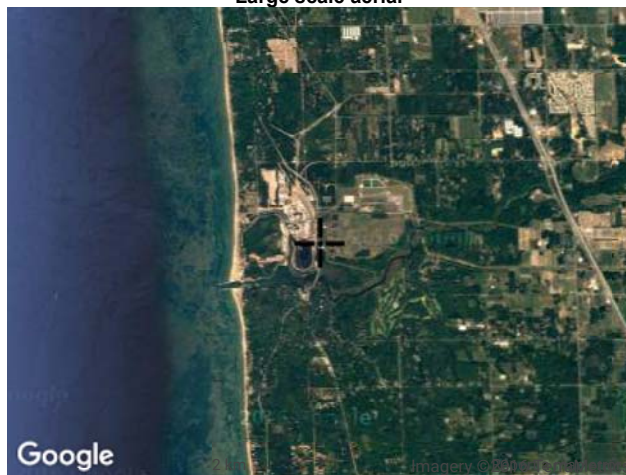

[Back to Top](#)

[US Department of Commerce](#)
[National Oceanic and Atmospheric Administration](#)
[National Weather Service](#)
[National Water Center](#)
1325 East West Highway
Silver Spring, MD 20910

Questions?: HDSC.Questions@noaa.gov

[Disclaimer](#)

APPENDIX C
HYDROLOGIC AND HYDRAULIC MODEL OUTPUT

Project Description

File Name Campbell Units 1-3.SPF

Project Options

Flow Units CFS
 Elevation Type Depth
 Hydrology Method EPA SWMM
 EPA SWMM Infiltration Method Horton
 Link Routing Method Hydrodynamic
 Enable Overflow Ponding at Nodes YES
 Skip Steady State Analysis Time Periods NO

Analysis Options

Start Analysis On Jun 01, 2016 00:00:00
 End Analysis On Jun 04, 2016 00:00:00
 Start Reporting On Jun 01, 2016 00:00:00
 Antecedent Dry Days 0 days
 Runoff (Dry Weather) Time Step 0 01:00:00 days hh:mm:ss
 Runoff (Wet Weather) Time Step 0 00:05:00 days hh:mm:ss
 Reporting Time Step 0 00:05:00 days hh:mm:ss
 Routing Time Step 30 seconds

Number of Elements

	Qty
Rain Gages	1
Subbasins.....	9
Nodes.....	21
<i>Junctions</i>	12
<i>Outfalls</i>	3
<i>Flow Diversions</i>	0
<i>Inlets</i>	0
<i>Storage Nodes</i>	6
Links.....	20
<i>Channels</i>	4
<i>Pipes</i>	14
<i>Pumps</i>	0
<i>Orifices</i>	1
<i>Weirs</i>	1
<i>Outlets</i>	0
Pollutants	0
Land Uses	0

Rainfall Details

SN	Rain Gage ID	Data Source	Data Source ID	Rainfall Type	Rain Units	State	County	Return Period (years)	Rainfall Depth (inches)	Rainfall Distribution
1	Rain Gage-01	Time Series	TS-1000	Cumulative	inches				11.20	

Subbasin Summary

SN	Subbasin ID	Area	Impervious Area	Average Slope	Equivalent Width	Impervious Area Manning's Roughness	Pervious Area Manning's Roughness	Total Rainfall	Total Infiltration	Total Runoff	Total Runoff Volume	Peak Runoff	Time of Concentration
		(ac)	(%)	(%)	(ft)			(in)	(in)	(in)	(ac-in)	(cfs)	(days hh:mm:ss)
1	Sub-100	8.85	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.8600	6.34	56.12	73.21	0 01:11:18
2	Sub-101	3.60	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.7510	6.45	23.23	40.29	0 00:41:34
3	Sub-102	1.70	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.7090	6.50	11.05	22.47	0 00:26:30
4	Sub-103	14.00	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.9570	6.24	87.37	98.82	0 01:33:54
5	Sub-Pond1-2N	2.78	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.7330	6.47	17.98	33.27	0 00:35:35
6	Sub-Pond1-2S	2.09	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.7180	6.49	13.54	26.59	0 00:29:58
7	Sub-Pond3N	5.02	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.7810	6.42	32.24	50.77	0 00:50:45
8	Sub-Pond3S	4.52	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.7710	6.43	29.06	47.26	0 00:47:38
9	Sub-PondA	11.13	25.00	0.5000	500.00	0.0150	0.1000	11.20	4.9040	6.30	70.09	85.30	0 01:21:50

Node Summary

SN	Element ID	Element Type	Invert Elevation	Ground/Rim (Max) Elevation	Initial Water Elevation	Surcharge Elevation	Ponded Area	Peak Inflow	Max HGL Elevation Attained	Max Surcharge Depth Attained	Min Freeboard Attained	Time of Peak Flooding Occurrence	Total Flooded Volume	Total Time Flooded
			(ft)	(ft)	(ft)	(ft)	(ft ²)	(cfs)	(ft)	(ft)	(ft)	(days hh:mm)	(ac-in)	(min)
1	Jun-10	Junction	619.90	631.46	0.00	0.00	0.00	7.93	623.61	0.00	7.85	0 00:00	0.00	0.00
2	Jun-101	Junction	616.82	625.00	0.00	0.00	0.00	59.83	618.78	0.00	6.22	0 00:00	0.00	0.00
3	Jun-103	Junction	618.16	632.32	0.00	0.00	0.00	84.35	632.32	0.00	0.00	0 12:01	0.03	0.00
4	Jun-104	Junction	623.00	631.60	0.00	0.00	0.00	105.20	631.60	0.00	0.00	0 12:11	0.02	0.00
5	Jun-105	Junction	628.00	633.20	0.00	0.00	0.00	98.76	630.98	0.00	2.22	0 00:00	0.00	0.00
6	Jun-11	Junction	619.06	632.11	0.00	0.00	0.00	7.93	621.67	0.00	10.44	0 00:00	0.00	0.00
7	Jun-12	Junction	608.50	610.50	0.00	0.00	0.00	14.53	609.30	0.00	1.20	0 00:00	0.00	0.00
8	Jun-12N-Out	Junction	618.36	631.07	0.00	6.00	0.00	47.66	620.40	0.00	10.67	0 00:00	0.00	0.00
9	Jun-12S-Out	Junction	617.72	624.87	0.00	0.00	0.00	23.17	619.10	0.00	5.77	0 00:00	0.00	0.00
10	Jun-13	Junction	613.50	619.50	0.00	0.00	0.00	14.53	617.02	0.00	2.48	0 00:00	0.00	0.00
11	Jun-3N-Out	Junction	623.46	631.99	0.00	6.00	0.00	3.05	626.37	0.00	5.62	0 00:00	0.00	0.00
12	Jun-3S-Out	Junction	622.10	633.70	0.00	6.00	0.00	7.93	626.02	0.00	7.68	0 00:00	0.00	0.00
13	Out-01	Outfall	589.75					44.78	591.04					
14	Out-02	Outfall	602.00					0.00	602.00					
15	Out-04	Outfall	596.80					14.53	597.54					
16	Stor-100	Storage Node	625.00	632.00	625.93		0.00	73.17	626.88				0.00	0.00
17	Stor-Pond1-2N	Storage Node	604.00	626.00	619.08		0.00	44.90	620.14				0.00	0.00
18	Stor-Pond1-2S	Storage Node	600.00	626.00	618.78		0.00	26.57	619.32				0.00	0.00
19	Stor-Pond3N	Storage Node	604.00	632.00	625.34		0.00	56.66	626.44				0.00	0.00
20	Stor-Pond3S	Storage Node	604.00	632.00	624.66		0.00	53.26	626.62				0.00	0.00
21	Stor-PondA	Storage Node	600.00	626.00	615.50		0.00	164.96	617.90				0.00	0.00

Link Summary

SN Element ID	Element Type	From (Inlet) Node	To (Outlet) Node	Length	Inlet Invert Elevation	Outlet Invert Elevation	Average Slope (%)	Diameter or Height (ft)	Manning's Roughness	Peak Flow (cfs)	Design Flow Capacity (cfs)	Peak Flow/Design Flow Ratio	Peak Flow Velocity (ft/sec)	Peak Flow Depth (ft)	Peak Flow Depth/Total Depth Ratio
1 Link-17	Pipe	Jun-10	Jun-11	285.40	619.90	619.16	0.2600	1.500	0.0130	7.93	5.35	1.48	4.49	1.50	1.00
2 Link-18	Pipe	Jun-11	Jun-12N-Out	192.01	619.06	619.03	0.0200	1.500	0.0130	7.93	1.31	6.04	4.89	1.43	0.96
3 Pipe-001	Pipe	Jun-3N-Out	Jun-3S-Out	658.20	623.46	622.08	0.2100	1.500	0.0130	3.05	4.77	0.64	1.78	1.50	1.00
4 Pipe-002	Pipe	Jun-3S-Out	Jun-10	341.45	622.10	620.00	0.6200	1.500	0.0130	7.93	8.24	0.96	4.49	1.50	1.00
5 Pipe-Outfall01	Pipe	Jun-101	Out-01	173.41	617.37	589.75	15.9300	2.500	0.0250	44.78	85.12	0.53	16.54	1.32	0.54
6 Pipe-Pond12N-Outlet	Pipe	Stor-Pond1-2N	Jun-12N-Out	78.49	619.08	618.36	0.9200	2.000	0.0250	5.28	11.27	0.47	2.80	1.45	0.74
7 Pipe-Pond12S-Outlet	Pipe	Stor-Pond1-2S	Jun-12S-Out	59.89	618.78	617.72	1.7700	2.000	0.0250	2.46	15.65	0.16	3.57	0.89	0.45
8 Pipe-Pond3N-Outlet	Pipe	Stor-Pond3N	Jun-3N-Out	109.20	625.34	623.56	1.6300	1.500	0.0130	3.05	13.41	0.23	3.83	1.30	0.87
9 Pipe-Pond3S-Outlet	Pipe	Stor-Pond3S	Jun-3S-Out	119.51	624.66	622.08	2.1600	1.500	0.0130	6.03	15.37	0.39	4.77	1.50	1.00
10 Pipe-PondA-In1	Pipe	Stor-100	Stor-PondA	99.23	625.93	614.05	11.9700	2.500	0.0250	22.57	73.80	0.31	6.25	1.72	0.69
11 Pipe-PondA-In2	Pipe	Jun-103	Stor-PondA	100.72	618.16	615.82	2.3200	2.000	0.0130	55.57	34.48	1.61	17.69	2.00	1.00
12 Pipe-PondA-In3	Pipe	Jun-101	Stor-PondA	640.00	616.82	615.14	0.2600	2.000	0.0130	11.84	11.59	1.02	4.16	1.72	0.86
13 Pipe-PondA-Outlet1	Pipe	Jun-13	Jun-12	345.00	613.50	608.50	1.4500	2.000	0.0250	14.53	14.16	1.03	6.35	1.40	0.70
14 Pipe-PondA-Outlet2	Pipe	Jun-12	Out-04	65.00	608.50	596.80	18.0000	2.000	0.0250	14.53	49.91	0.29	13.05	0.77	0.38
15 Ditch-001	Channel	Jun-12N-Out	Jun-101	1154.00	618.36	616.82	0.1300	7.000	0.0350	39.54	462.65	0.09	2.02	1.98	0.28
16 Ditch-002	Channel	Jun-12S-Out	Jun-101	558.30	617.72	616.82	0.1600	7.000	0.0350	21.24	508.49	0.04	1.46	1.65	0.24
17 Ditch-003	Channel	Jun-105	Jun-104	753.20	628.00	623.00	0.6600	5.000	0.0350	105.20	378.54	0.28	4.77	3.88	0.78
18 Ditch-004	Channel	Jun-104	Jun-103	504.30	623.00	618.16	0.9600	5.000	0.0350	84.35	455.15	0.19	3.48	5.00	1.00
19 Orifice-01	Orifice	Stor-PondA	Jun-13		600.00	613.50		2.000		14.53					
20 Weir-Pond1-2S	Weir	Out-02	Stor-Pond1-2N		602.00	604.00				0.00					

Subbasin Hydrology

Subbasin : Sub-100

Input Data


Area (ac)	8.85
Impervious Area (%)	25.00
Max Infiltration Rate (in/hr)	3.0000
Min Infiltration Rate (in/hr)	0.5000
Drying Time (days)	7.00
Decay Constant (1/hrs)	4.0000
Max Volume (in)	0.00
Average Slope (%)	0.5000
Equivalent Width (ft)	500.00
Impervious Area	
<i>Manning's Roughness</i>	0.0150
Pervious Area	
<i>Manning's Roughness</i>	0.1000
Curb & Gutter Length (ft)	0.00
Rain Gage ID	Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in)	11.20
Total Runon (in)	0.00
Total Evaporation (in)	0.0000
Total Infiltration (in)	4.8600
Total Runoff (in)	6.34
Peak Runoff (cfs)	73.21
Time of Concentration (days hh:mm:ss)	0 01:11:18

Subbasin : Sub-100

Rainfall Intensity Graph

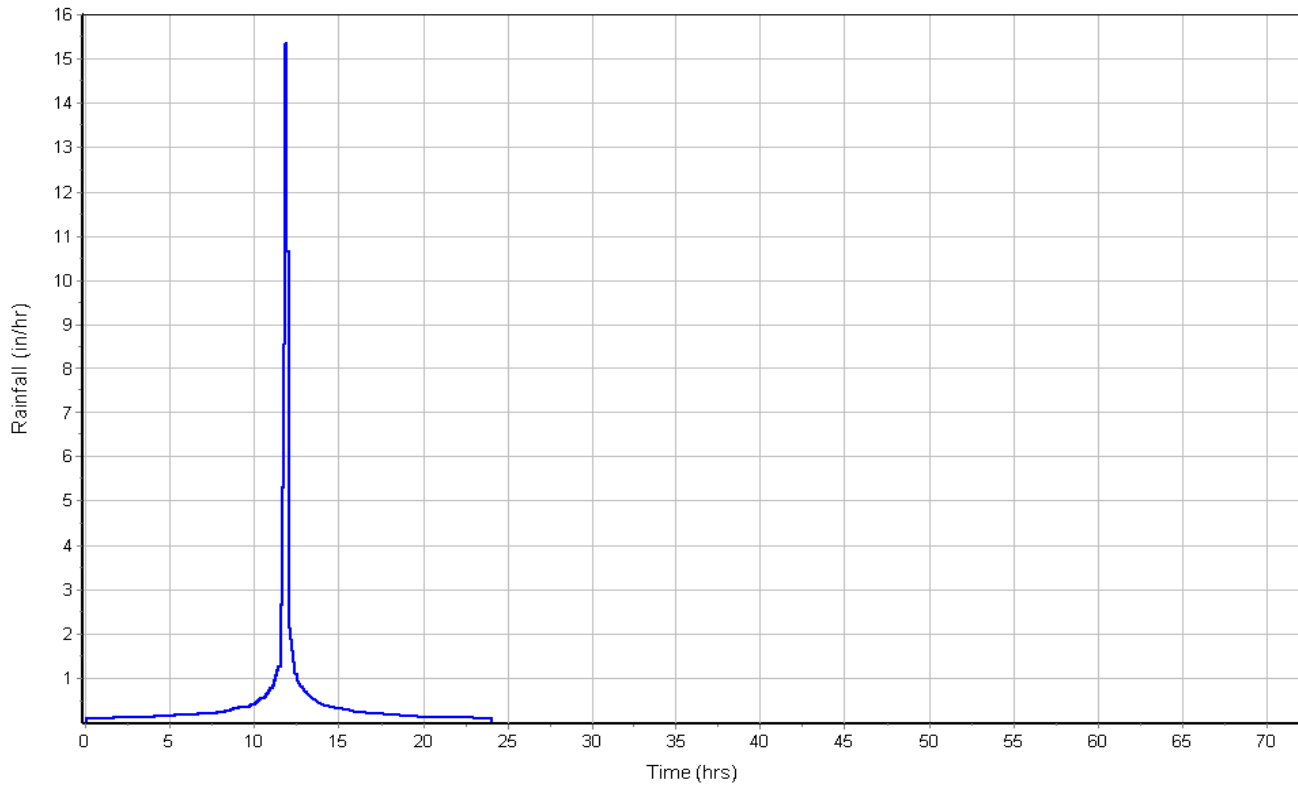

Runoff Hydrograph

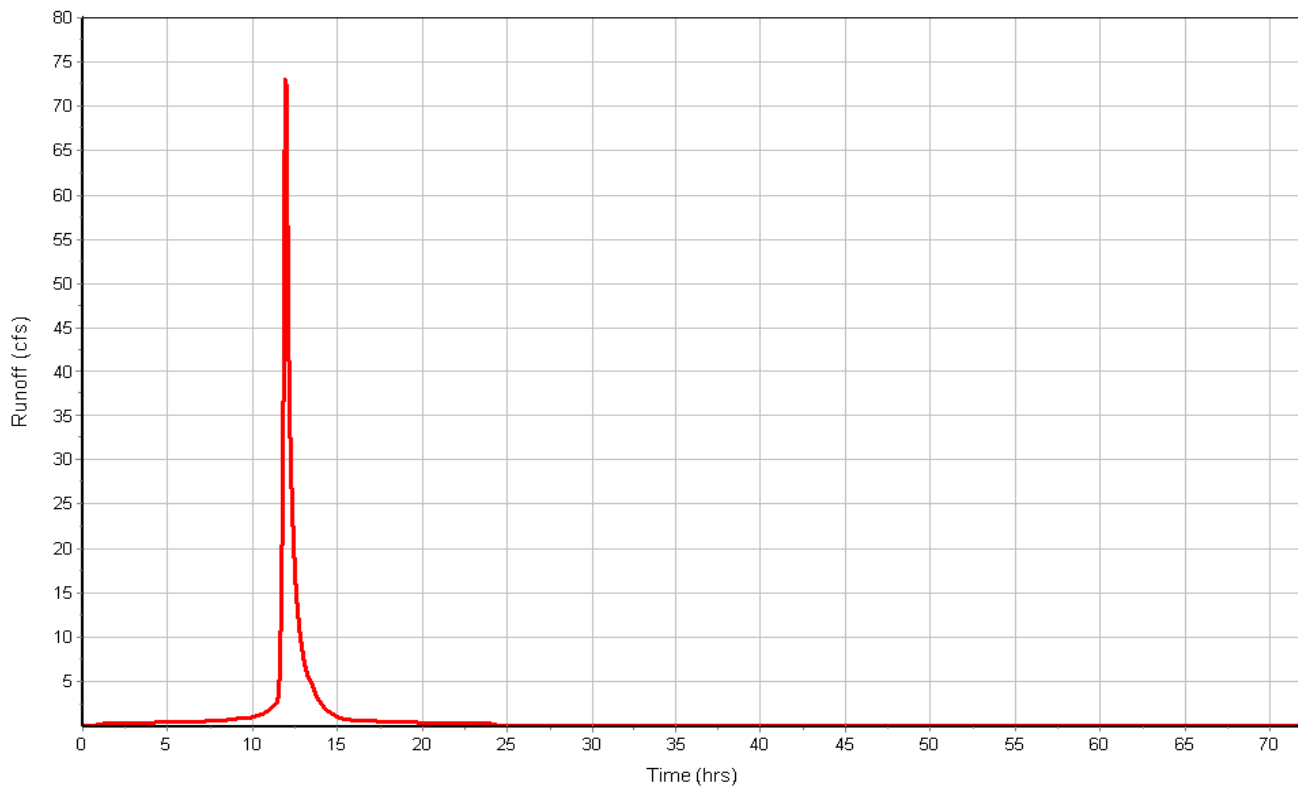

Subbasin : Sub-101

Input Data


Area (ac) 3.60
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.7510
Total Runoff (in) 6.45
Peak Runoff (cfs) 40.29
Time of Concentration (days hh:mm:ss) 0 00:41:34

Subbasin : Sub-101

Rainfall Intensity Graph

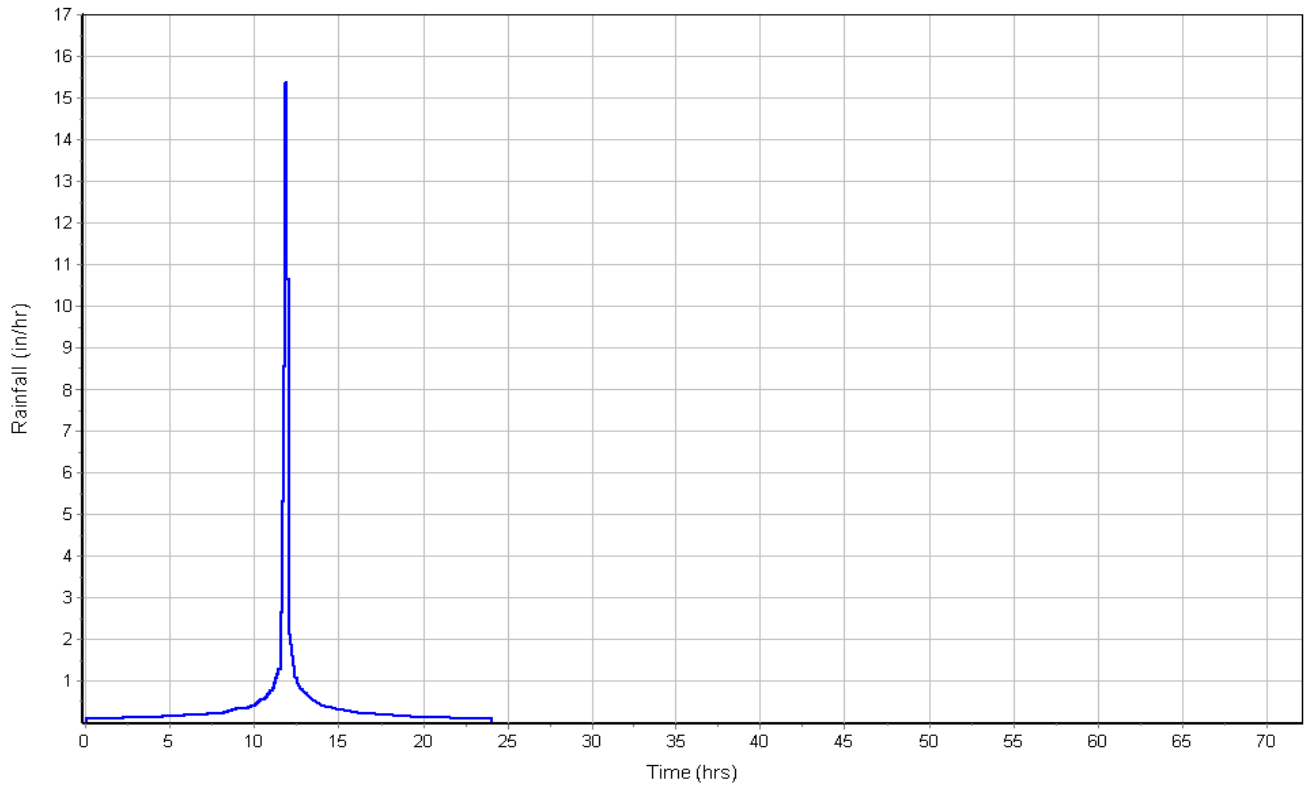

Runoff Hydrograph

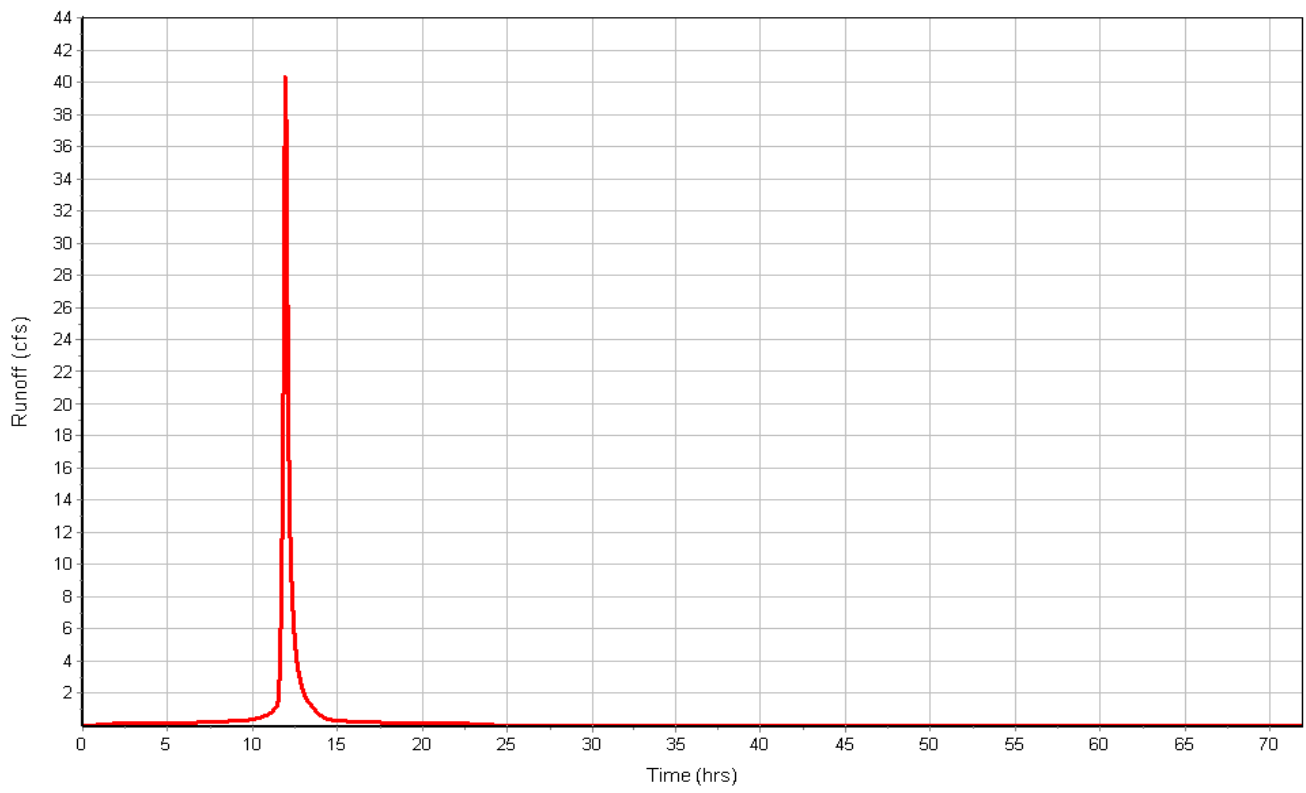

Subbasin : Sub-102

Input Data


Area (ac) 1.70
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.7090
Total Runoff (in) 6.50
Peak Runoff (cfs) 22.47
Time of Concentration (days hh:mm:ss) 0 00:26:30

Subbasin : Sub-102

Rainfall Intensity Graph

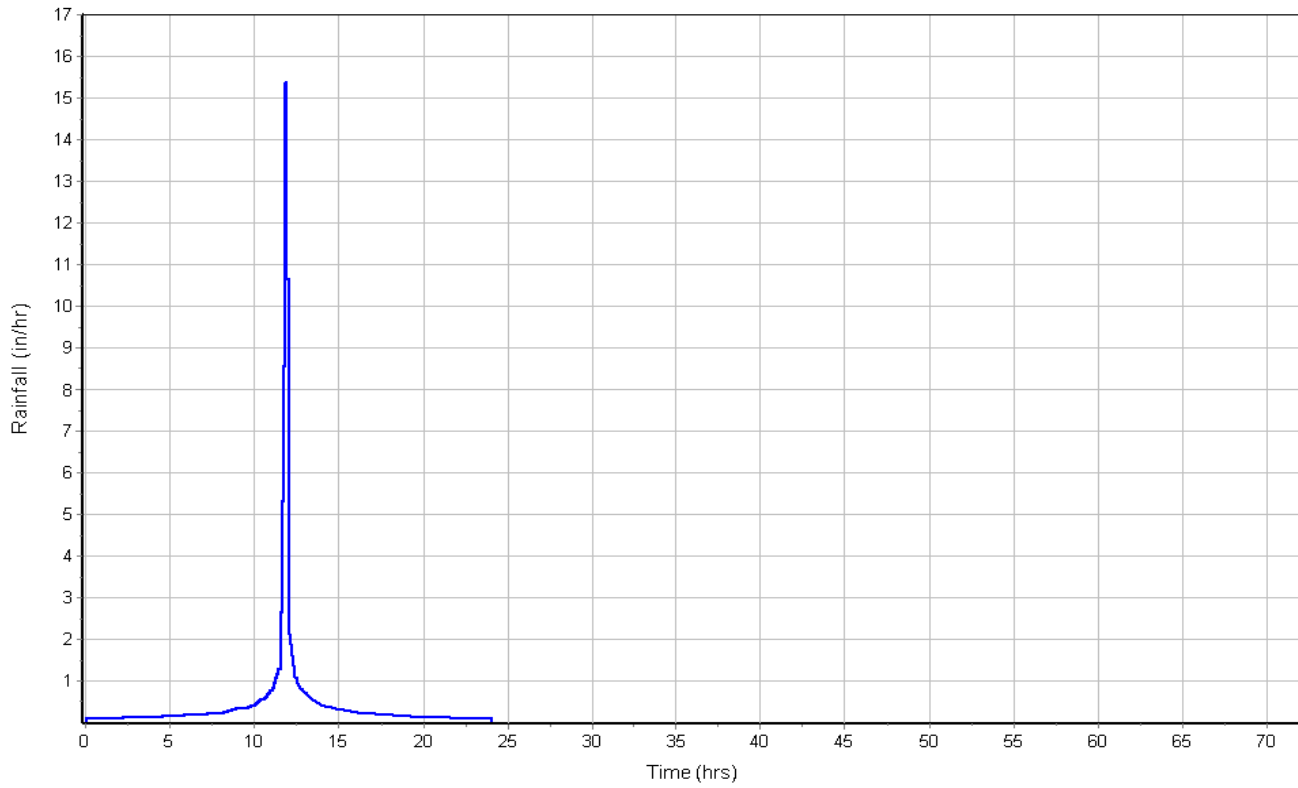

Runoff Hydrograph

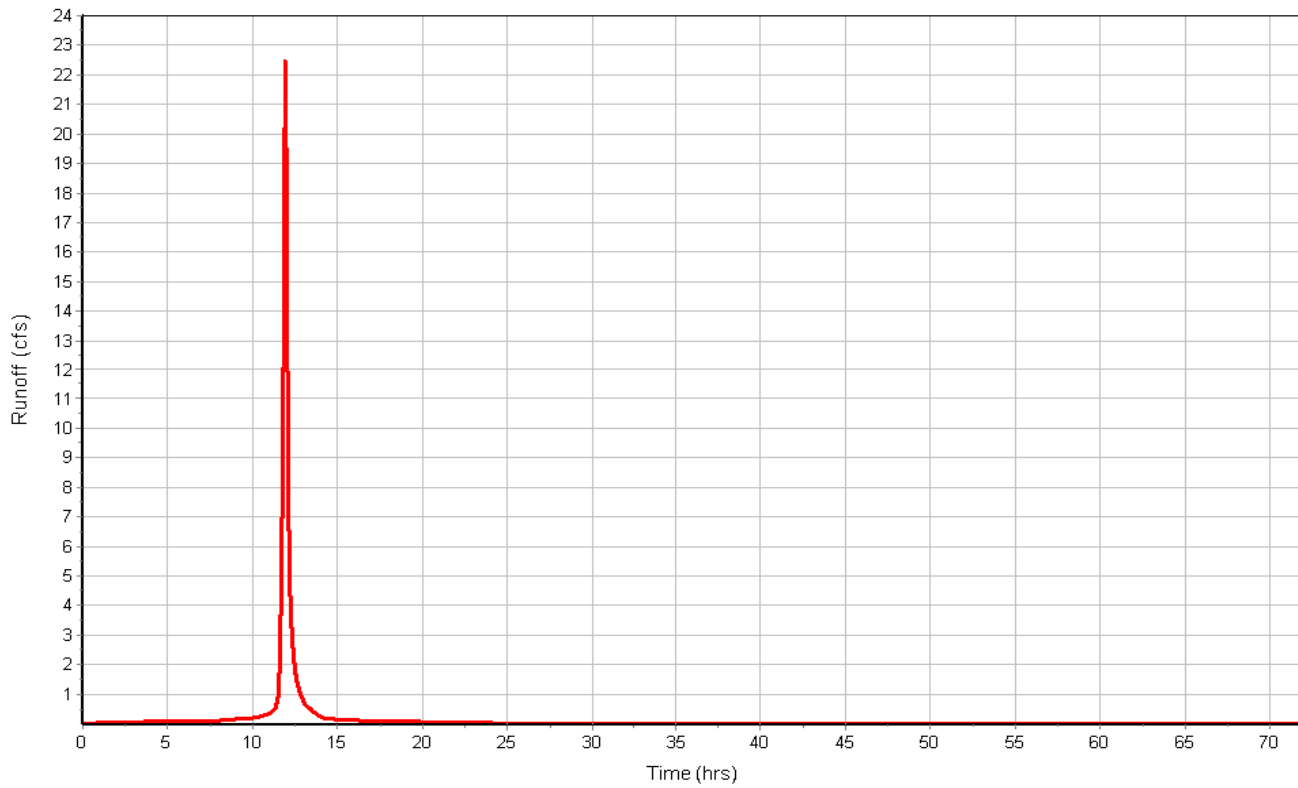

Subbasin : Sub-103

Input Data


Area (ac) 14.00
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.9570
Total Runoff (in) 6.24
Peak Runoff (cfs) 98.82
Time of Concentration (days hh:mm:ss) 0 01:33:54

Subbasin : Sub-103

Rainfall Intensity Graph

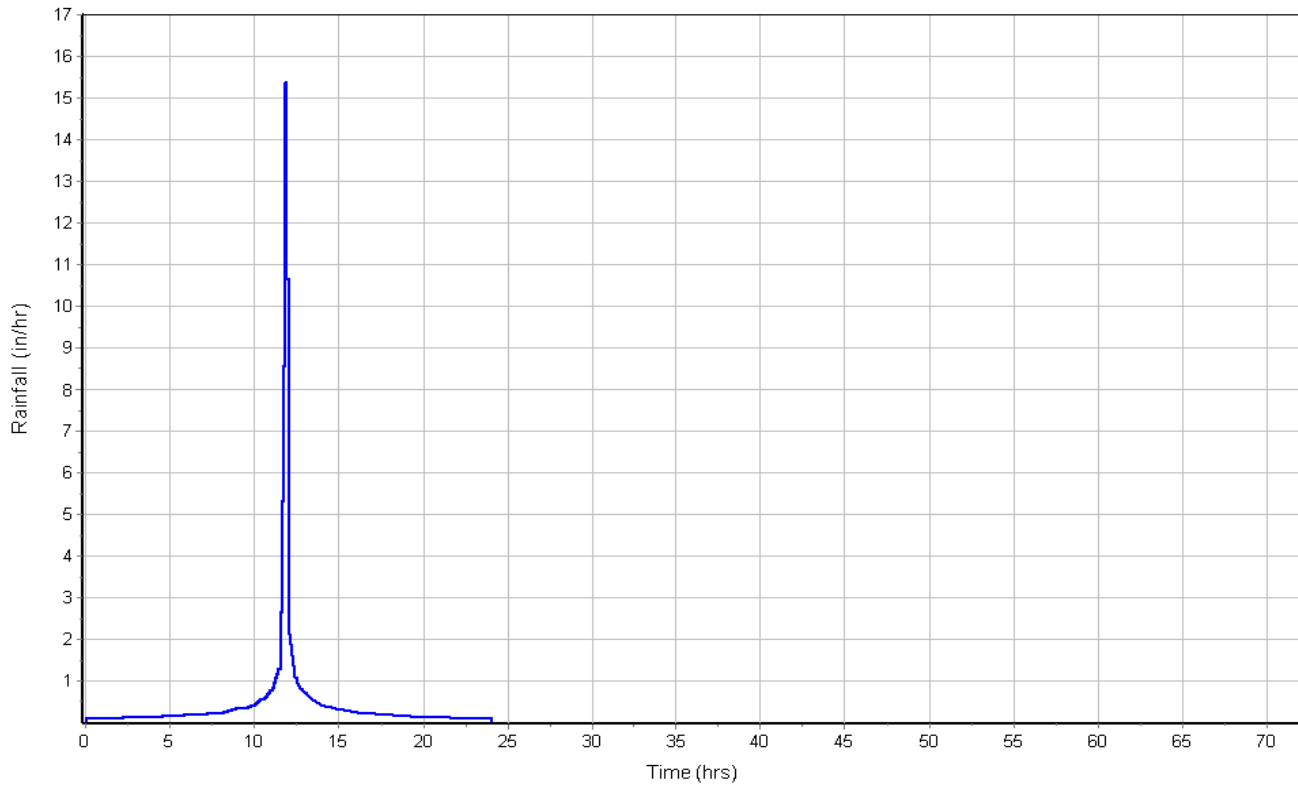

Runoff Hydrograph

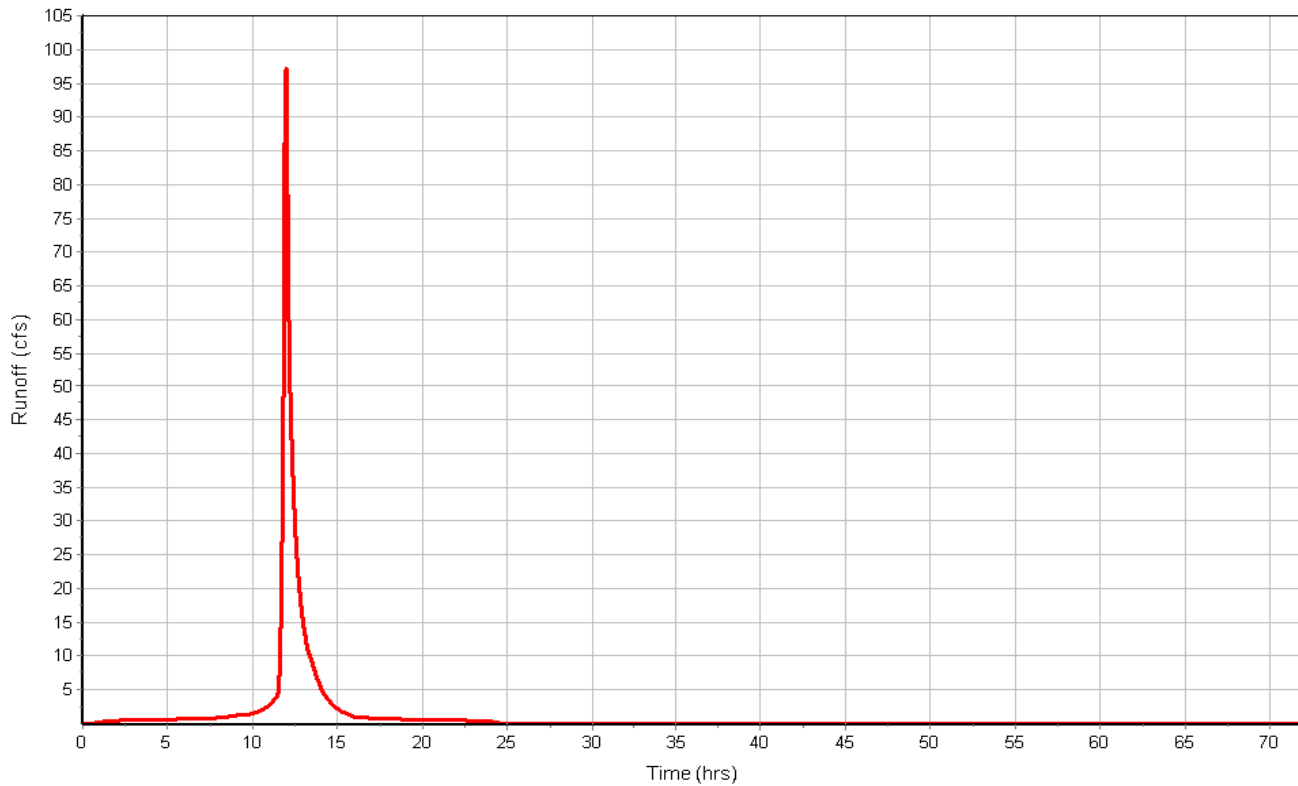

Subbasin : Sub-Pond1-2N

Input Data


Area (ac) 2.78
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.7330
Total Runoff (in) 6.47
Peak Runoff (cfs) 33.27
Time of Concentration (days hh:mm:ss) 0 00:35:35

Subbasin : Sub-Pond1-2N

Rainfall Intensity Graph

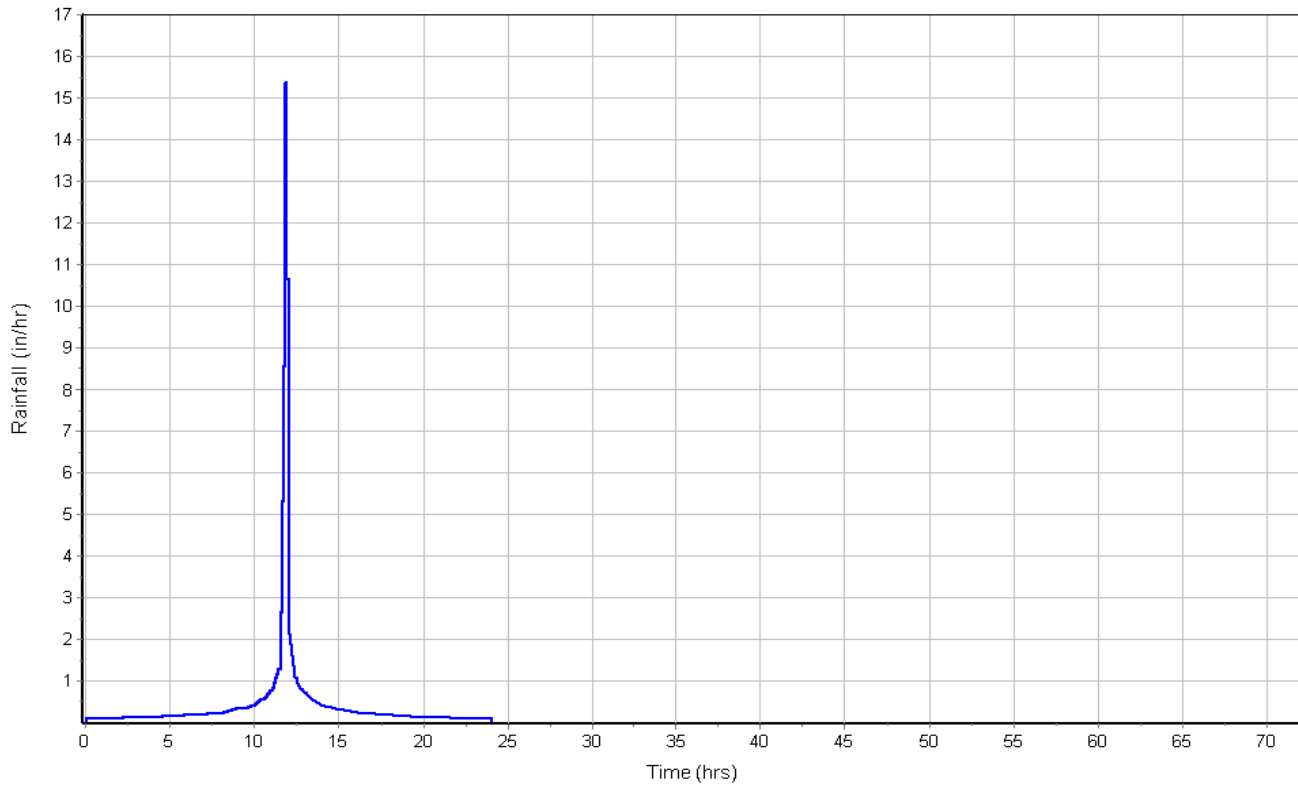

Runoff Hydrograph

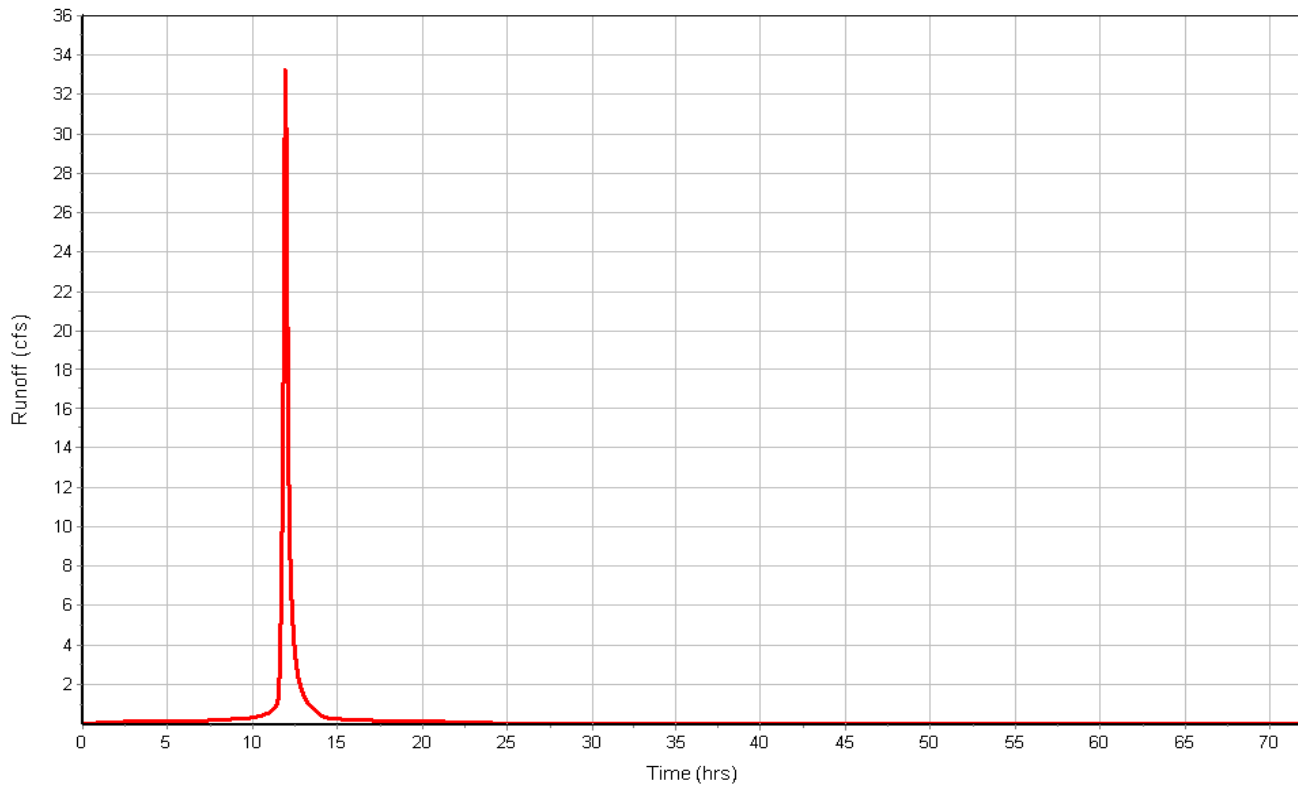

Subbasin : Sub-Pond1-2S

Input Data


Area (ac) 2.09
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.7180
Total Runoff (in) 6.49
Peak Runoff (cfs) 26.59
Time of Concentration (days hh:mm:ss) 0 00:29:58

Subbasin : Sub-Pond1-2S

Rainfall Intensity Graph

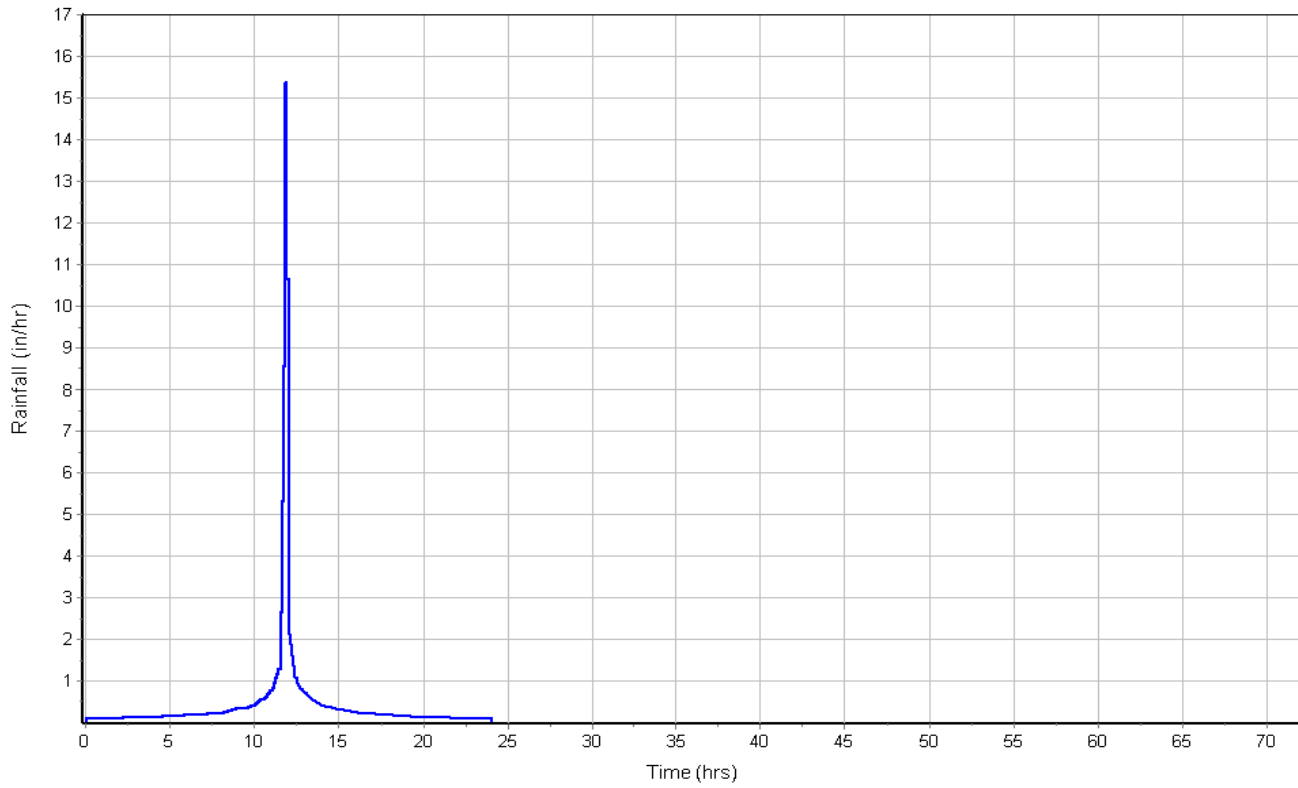

Runoff Hydrograph

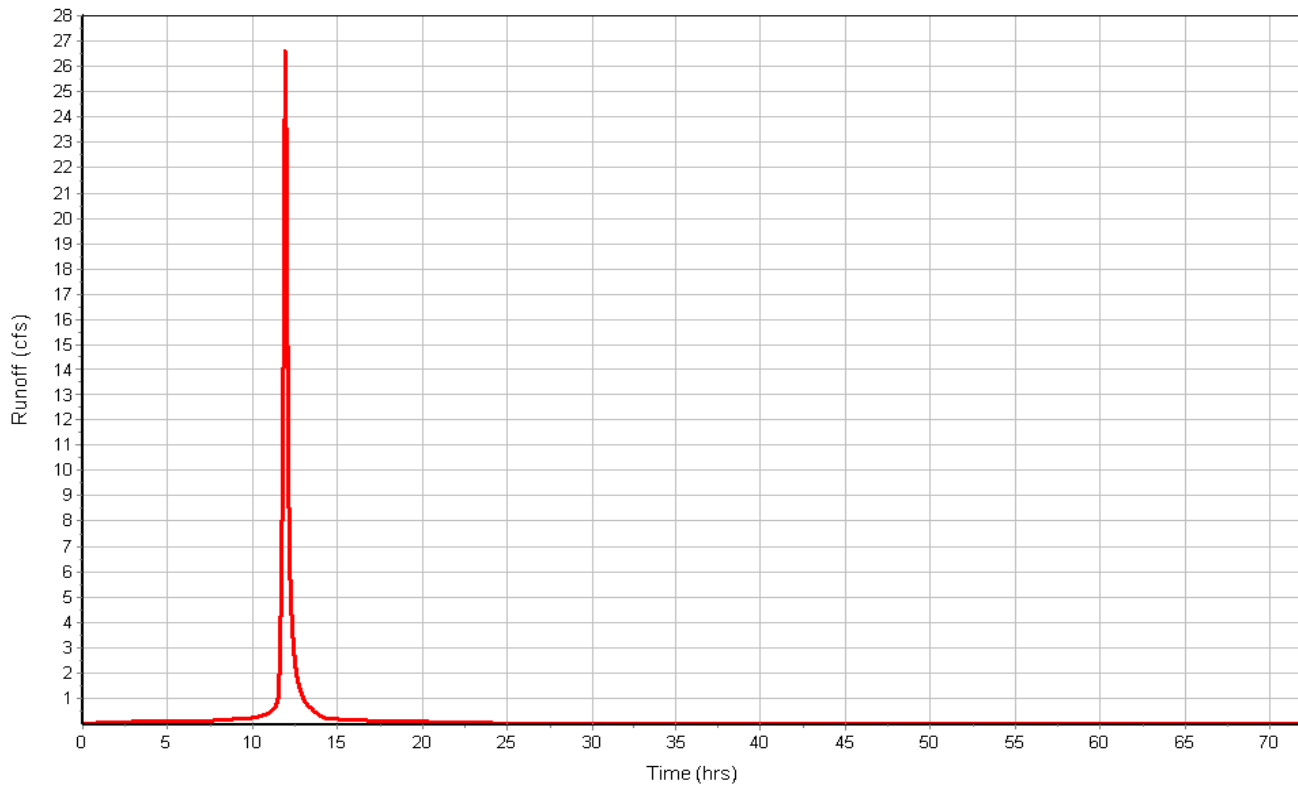

Subbasin : Sub-Pond3N

Input Data


Area (ac) 5.02
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.7810
Total Runoff (in) 6.42
Peak Runoff (cfs) 50.77
Time of Concentration (days hh:mm:ss) 0 00:50:45

Subbasin : Sub-Pond3N

Rainfall Intensity Graph

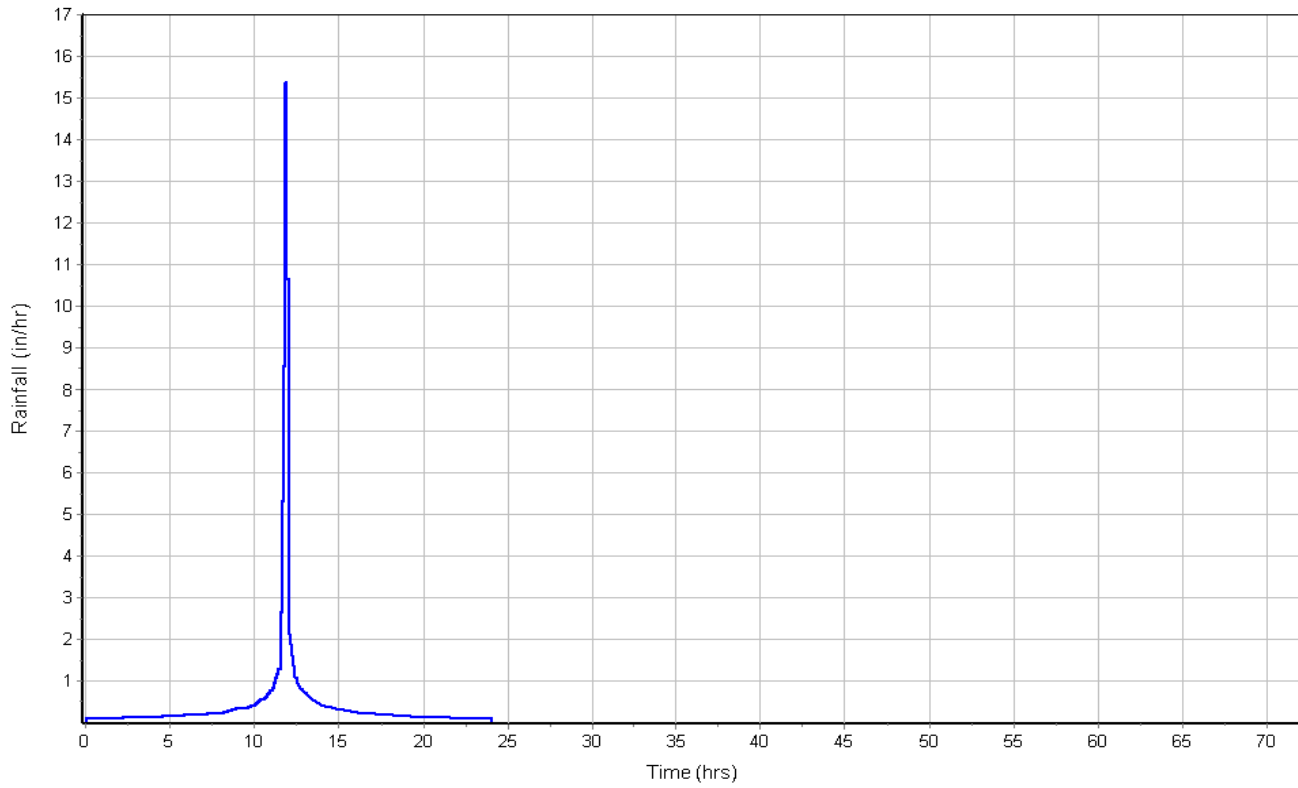

Runoff Hydrograph

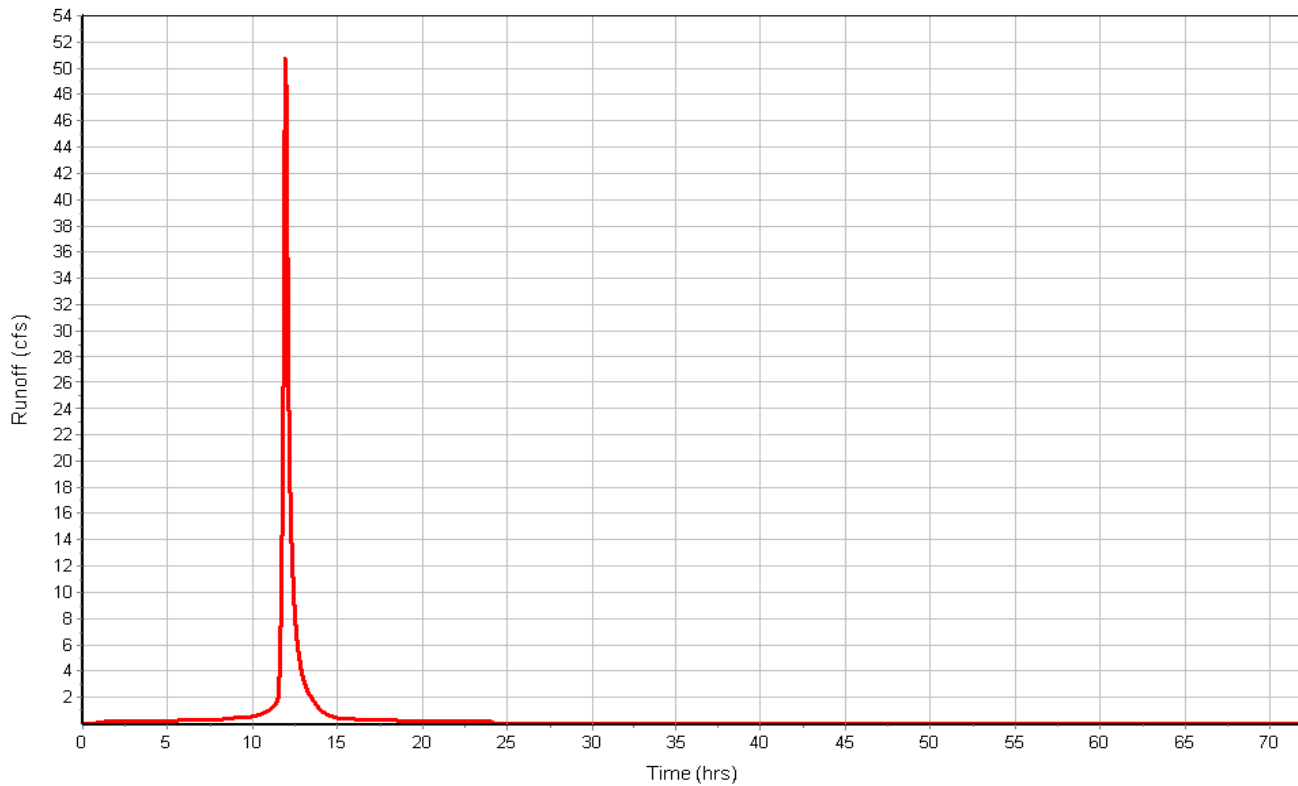

Subbasin : Sub-Pond3S

Input Data


Area (ac) 4.52
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.7710
Total Runoff (in) 6.43
Peak Runoff (cfs) 47.26
Time of Concentration (days hh:mm:ss) 0 00:47:38

Subbasin : Sub-Pond3S

Rainfall Intensity Graph

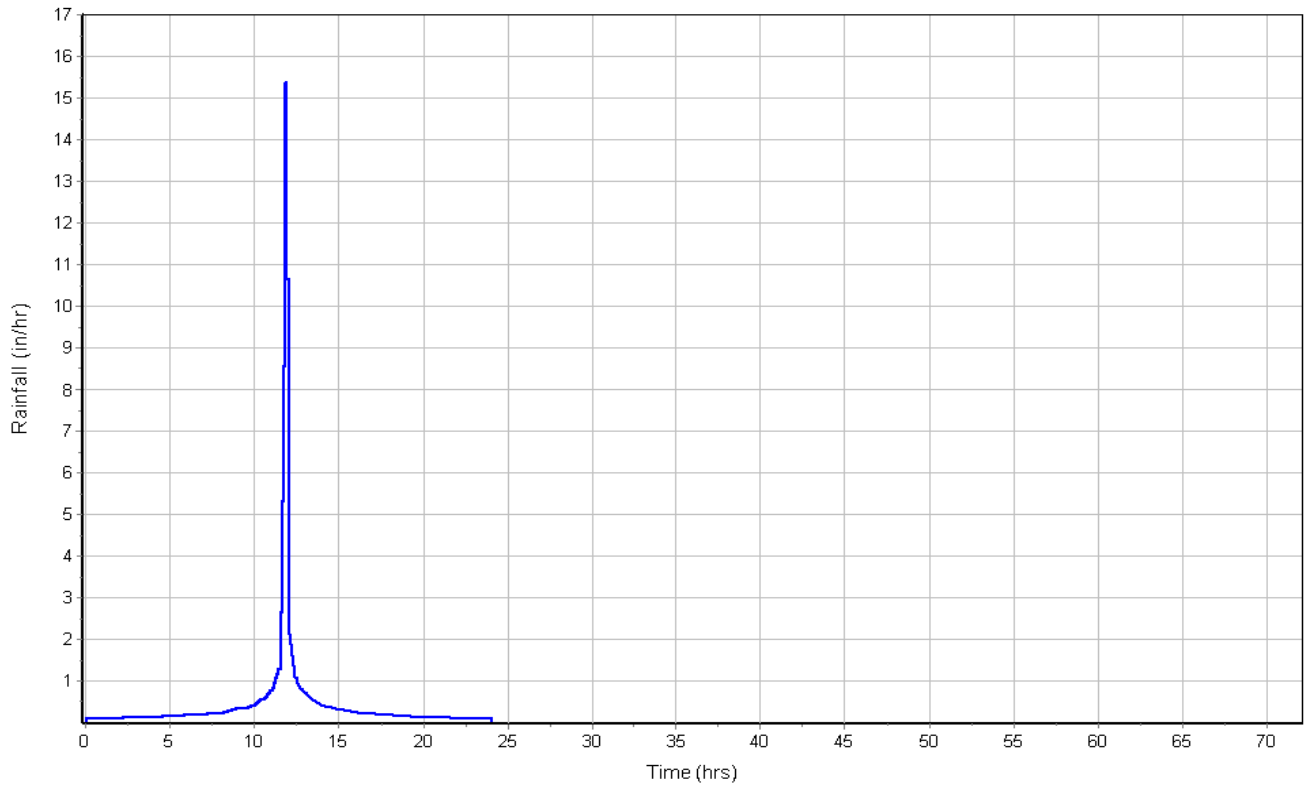

Runoff Hydrograph

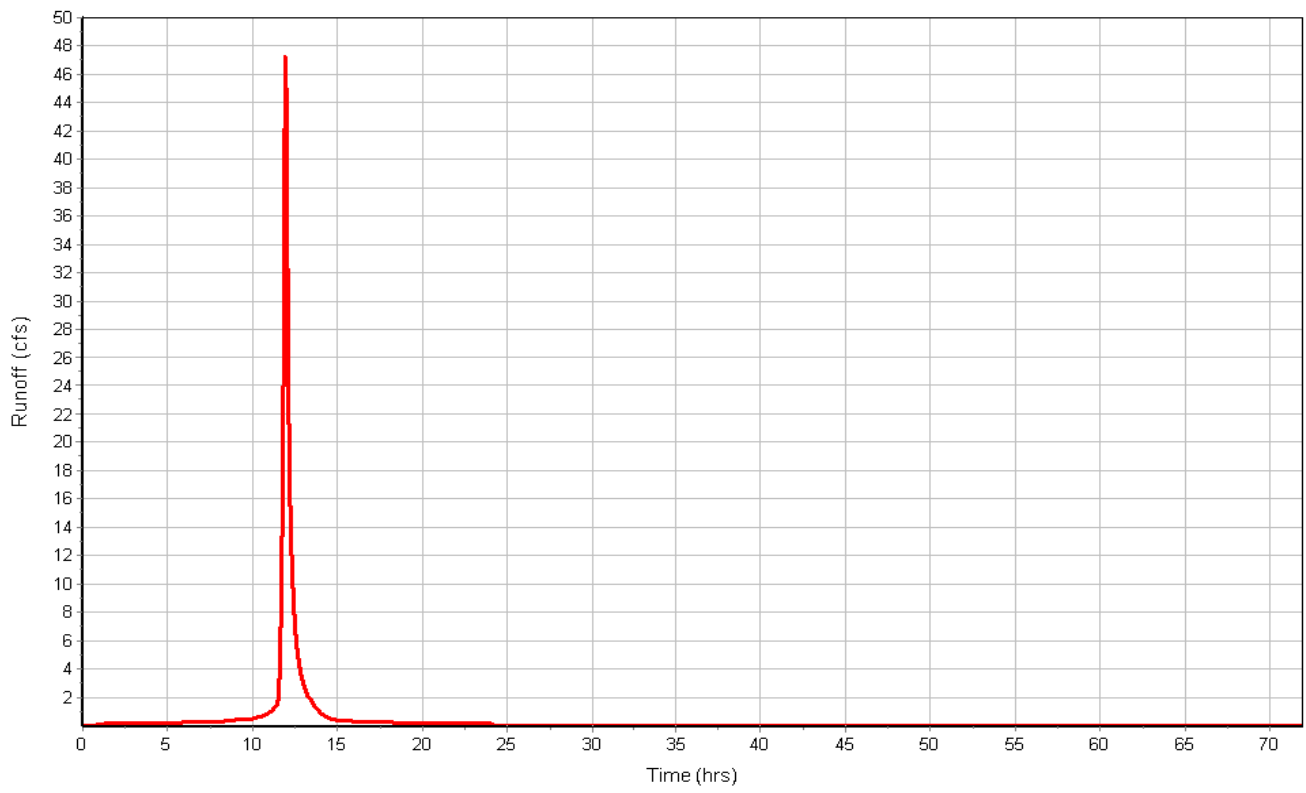

Subbasin : Sub-PondA

Input Data


Area (ac) 11.13
Impervious Area (%) 25.00
Max Infiltration Rate (in/hr) 3.0000
Min Infiltration Rate (in/hr) 0.5000
Drying Time (days) 7.00
Decay Constant (1/hrs) 4.0000
Max Volume (in) 0.00
Average Slope (%) 0.5000
Equivalent Width (ft) 500.00
Impervious Area
 Manning's Roughness 0.0150
Pervious Area
 Manning's Roughness 0.1000
Curb & Gutter Length (ft) 0.00
Rain Gage ID Rain Gage-01

Subbasin Runoff Results


Total Rainfall (in) 11.20
Total Runon (in) 0.00
Total Evaporation (in) 0.0000
Total Infiltration (in) 4.9040
Total Runoff (in) 6.30
Peak Runoff (cfs) 85.30
Time of Concentration (days hh:mm:ss) 0 01:21:50

Subbasin : Sub-PondA

Rainfall Intensity Graph

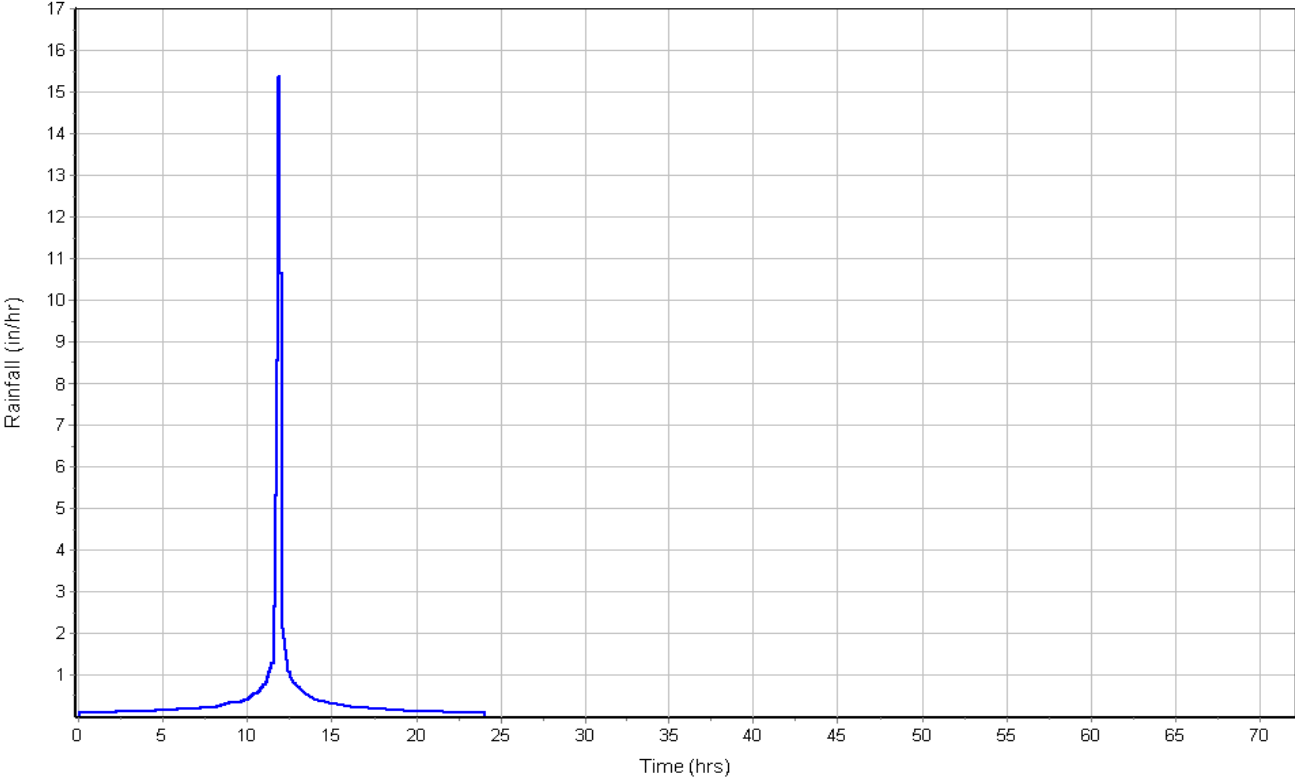

Runoff Hydrograph

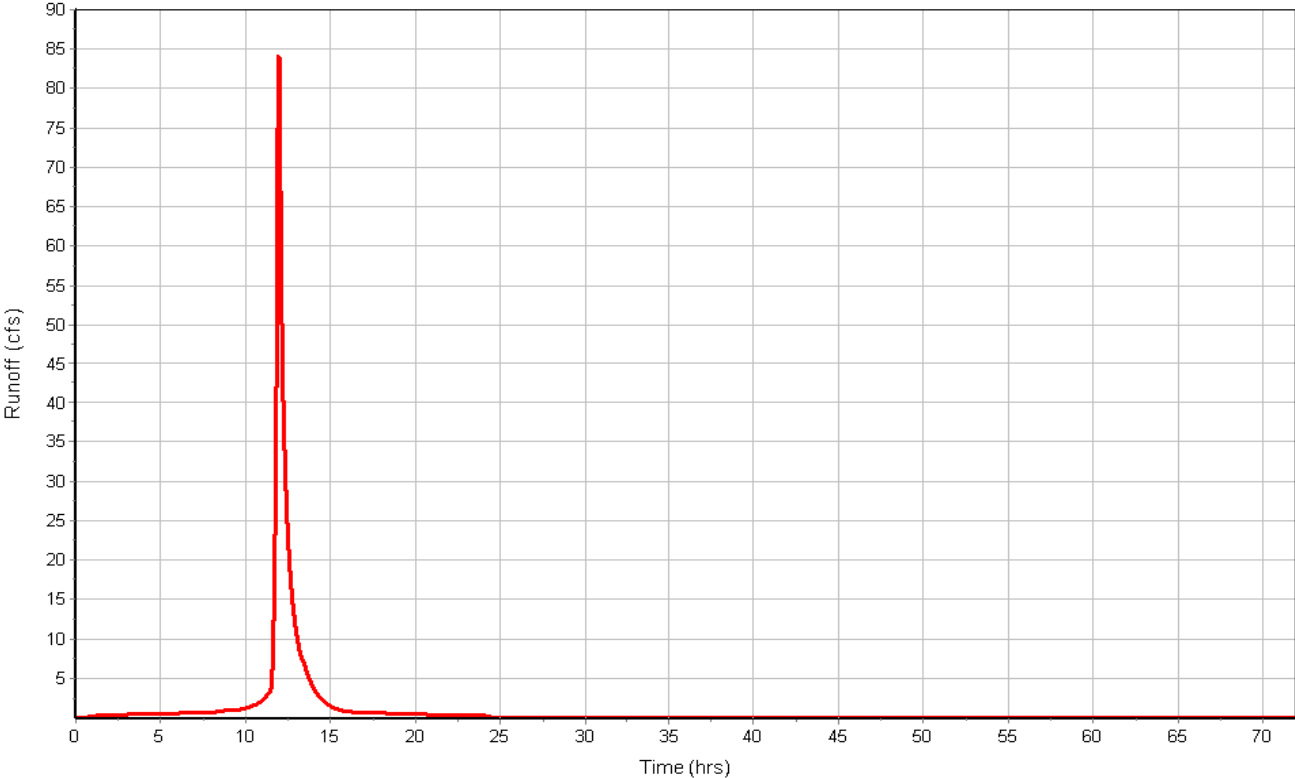

Junction Input

SN Element ID	Invert Elevation (ft)	Ground/Rim (Max) Elevation (ft)	Ground/Rim (Max) Offset (ft)	Initial Water Elevation (ft)	Initial Water Depth (ft)	Surcharge Elevation (ft)	Surcharge Depth (ft)	Ponded Area (ft ²)	Minimum Pipe Cover (ft)
1 Jun-10	619.90	631.46	11.56	0.00	-619.90	0.00	-631.46	0.00	0.00
2 Jun-101	616.82	625.00	8.18	0.00	-616.82	0.00	-625.00	0.00	0.00
3 Jun-103	618.16	632.32	14.16	0.00	-618.16	0.00	-632.32	0.00	0.00
4 Jun-104	623.00	631.60	8.60	0.00	-623.00	0.00	-631.60	0.00	0.00
5 Jun-105	628.00	633.20	5.20	0.00	-628.00	0.00	-633.20	0.00	0.00
6 Jun-11	619.06	632.11	13.05	0.00	-619.06	0.00	-632.11	0.00	0.00
7 Jun-12	608.50	610.50	2.00	0.00	-608.50	0.00	-610.50	0.00	0.00
8 Jun-12N-Out	618.36	631.07	12.71	0.00	-618.36	6.00	-625.07	0.00	0.00
9 Jun-12S-Out	617.72	624.87	7.15	0.00	-617.72	0.00	-624.87	0.00	0.00
10 Jun-13	613.50	619.50	6.00	0.00	-613.50	0.00	-619.50	0.00	0.00
11 Jun-3N-Out	623.46	631.99	8.53	0.00	-623.46	6.00	-625.99	0.00	0.00
12 Jun-3S-Out	622.10	633.70	11.60	0.00	-622.10	6.00	-627.70	0.00	0.00

Junction Results

SN Element ID	Peak Inflow	Peak Lateral Inflow	Max HGL Elevation Attained	Max HGL Depth Attained	Max Surcharge Depth Attained	Min Freeboard Attained	Average HGL Elevation Attained	Average HGL Depth Attained	Time of Max HGL Occurrence	Time of Peak Flooding Occurrence	Total Flooded Volume	Total Time Flooded
	(cfs)	(cfs)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	(days hh:mm)	(days hh:mm)	(ac-in)	(min)
1 Jun-10	7.93	0.00	623.61	3.71	0.00	7.85	623.36	3.46	2 21:00	0 00:00	0.00	0.00
2 Jun-101	59.83	0.00	618.78	1.96	0.00	6.22	617.77	0.95	0 12:07	0 00:00	0.00	0.00
3 Jun-103	84.35	0.00	632.32	14.16	0.00	0.00	618.39	0.23	0 12:01	0 12:01	0.03	0.00
4 Jun-104	105.20	0.00	631.60	8.60	0.00	0.00	623.17	0.17	0 12:11	0 12:11	0.02	0.00
5 Jun-105	98.76	98.76	630.98	2.98	0.00	2.22	628.14	0.14	0 12:01	0 00:00	0.00	0.00
6 Jun-11	7.93	0.00	621.67	2.61	0.00	10.44	621.56	2.50	2 21:00	0 00:00	0.00	0.00
7 Jun-12	14.53	0.00	609.30	0.80	0.00	1.20	609.24	0.74	0 15:27	0 00:00	0.00	0.00
8 Jun-12N-Out	47.66	40.28	620.40	2.04	0.00	10.67	619.23	0.87	0 12:04	0 00:00	0.00	0.00
9 Jun-12S-Out	23.17	22.45	619.10	1.38	0.00	5.77	617.80	0.08	0 12:06	0 00:00	0.00	0.00
10 Jun-13	14.53	0.00	617.02	3.52	0.00	2.48	616.09	2.59	0 15:27	0 00:00	0.00	0.00
11 Jun-3N-Out	3.05	0.00	626.37	2.91	0.00	5.62	625.98	2.52	2 21:00	0 00:00	0.00	0.00
12 Jun-3S-Out	7.93	0.00	626.02	3.92	0.00	7.68	625.63	3.53	2 21:00	0 00:00	0.00	0.00

Channel Input

SN Element ID	Length (ft)	Inlet Invert Elevation (ft)	Inlet Invert Offset (ft)	Outlet Invert Elevation (ft)	Outlet Invert Offset (ft)	Total Drop (ft)	Average Slope (%)	Shape	Height (ft)	Width (ft)	Manning's Roughness	Entrance Losses	Exit/Bend Losses	Additional Losses	Initial Flow (cfs)	Flap Gate
1 Ditch-001	1154.00	618.36	0.00	616.82	0.00	1.54	0.1300	Trapezoidal	7.000	28.000	0.0350	0.0000	0.0000	0.0000	0.00	No
2 Ditch-002	558.30	617.72	0.00	616.82	0.00	0.90	0.1600	Trapezoidal	7.000	28.000	0.0350	0.0000	0.0000	0.0000	0.00	No
3 Ditch-003	753.20	628.00	0.00	623.00	0.00	5.00	0.6600	Trapezoidal	5.000	22.000	0.0350	0.0000	0.0000	0.0000	0.00	No
4 Ditch-004	504.30	623.00	0.00	618.16	0.00	4.84	0.9600	Trapezoidal	5.000	22.000	0.0350	0.0000	0.0000	0.0000	0.00	No

Channel Results

SN Element ID	Peak Flow	Time of Peak Flow Occurrence	Design Flow Capacity	Peak Flow/ Design Flow Ratio	Peak Flow Velocity	Travel Time	Peak Flow Depth	Peak Flow Depth/ Total Depth Ratio	Total Time Surcharged	Froude Number	Reported Condition
	(cfs)	(days hh:mm)	(cfs)		(ft/sec)	(min)	(ft)		(min)		
1 Ditch-001	39.54	0 12:06	462.65	0.09	2.02	9.52	1.98	0.28	0.00	0.23	
2 Ditch-002	21.24	0 12:01	508.49	0.04	1.46	6.37	1.65	0.24	0.00	0.01	
3 Ditch-003	105.20	0 12:02	378.54	0.28	4.77	2.63	3.88	0.78	0.00	0.26	
4 Ditch-004	84.35	0 12:01	455.15	0.19	3.48	2.42	5.00	1.00	19.00	0.32	

Pipe Input

SN Element ID	Length (ft)	Inlet Invert Elevation (ft)	Inlet Invert Offset (ft)	Outlet Invert Elevation (ft)	Outlet Invert Offset (ft)	Total Drop (ft)	Average Slope (%)	Pipe Shape	Pipe Diameter or Height (ft)	Pipe Width (ft)	Manning's Roughness	Entrance Losses	Exit/Bend Losses	Additional Losses	Initial Flow (cfs)	Flap Gate
1 Link-17	285.40	619.90	0.00	619.16	0.10	0.74	0.2600	CIRCULAR	1.500	1.500	0.0130	0.5000	0.5000	0.0000	0.00	No
2 Link-18	192.01	619.06	0.00	619.03	0.67	0.03	0.0200	CIRCULAR	1.500	1.500	0.0130	0.5000	0.5000	0.0000	0.00	No
3 Pipe-001	658.20	623.46	0.00	622.08	-0.02	1.38	0.2100	CIRCULAR	1.500	1.500	0.0130	0.5000	1.0000	0.0000	0.00	No
4 Pipe-002	341.45	622.10	0.00	620.00	0.10	2.10	0.6200	CIRCULAR	1.500	1.500	0.0130	0.5000	1.0000	0.0000	0.00	No
5 Pipe-Outfall01	173.41	617.37	0.55	589.75	0.00	27.62	15.9300	CIRCULAR	2.500	2.500	0.0250	0.5000	1.0000	0.0000	0.00	No
6 Pipe-Pond12N-Outlet	78.49	619.08	15.08	618.36	0.00	0.72	0.9200	CIRCULAR	2.000	2.000	0.0250	0.5000	1.0000	0.0000	0.00	No
7 Pipe-Pond12S-Outlet	59.89	618.78	18.78	617.72	0.00	1.06	1.7700	CIRCULAR	2.000	2.000	0.0250	0.5000	1.0000	0.0000	0.00	No
8 Pipe-Pond3N-Outlet	109.20	625.34	21.34	623.56	0.10	1.78	1.6300	CIRCULAR	1.500	1.500	0.0130	0.5000	1.0000	0.0000	0.00	No
9 Pipe-Pond3S-Outlet	119.51	624.66	20.66	622.08	-0.02	2.58	2.1600	CIRCULAR	1.500	1.500	0.0130	0.5000	1.0000	0.0000	0.00	No
10 Pipe-PondA-In1	99.23	625.93	0.93	614.05	14.05	11.88	11.9700	CIRCULAR	2.500	2.500	0.0250	0.5000	1.0000	0.0000	0.00	No
11 Pipe-PondA-In2	100.72	618.16	0.00	615.82	15.82	2.34	2.3200	CIRCULAR	2.000	2.000	0.0130	0.5000	1.0000	0.0000	0.00	No
12 Pipe-PondA-In3	640.00	616.82	0.00	615.14	15.14	1.68	0.2600	CIRCULAR	2.000	2.000	0.0130	0.5000	1.0000	0.0000	0.00	No
13 Pipe-PondA-Outlet1	345.00	613.50	0.00	608.50	0.00	5.00	1.4500	CIRCULAR	2.000	2.000	0.0250	0.5000	0.5000	0.0000	0.00	No
14 Pipe-PondA-Outlet2	65.00	608.50	0.00	596.80	0.00	11.70	18.0000	CIRCULAR	2.000	2.000	0.0250	0.5000	0.5000	0.0000	0.00	No

Pipe Results

SN Element ID	Peak Flow	Time of Peak Flow Occurrence	Design Flow Capacity	Peak Flow/ Design Flow Ratio	Peak Flow Velocity	Travel Time	Peak Flow Depth	Peak Flow Depth/ Total Depth Ratio	Total Time Surcharged	Froude Number
	(cfs)	(days hh:mm)	(cfs)		(ft/sec)	(min)	(ft)		(min)	
1 Link-17	7.93	2 21:00	5.35	1.48	4.49	1.06	1.50	1.00	4031.00	0.01
2 Link-18	7.93	2 21:00	1.31	6.04	4.89	0.65	1.43	0.96	0.00	0.67
3 Pipe-001	3.05	0 13:00	4.77	0.64	1.78	6.16	1.50	1.00	3657.00	0.02
4 Pipe-002	7.93	2 21:00	8.24	0.96	4.49	1.27	1.50	1.00	3938.00	0.03
5 Pipe-Outfall01	44.78	0 12:07	85.12	0.53	16.54	0.17	1.32	0.54	0.00	3.02
6 Pipe-Pond12N-Outlet	5.28	0 12:03	11.27	0.47	2.80	0.47	1.45	0.74	0.00	0.30
7 Pipe-Pond12S-Outlet	2.46	0 12:25	15.65	0.16	3.57	0.28	0.89	0.45	0.00	1.15
8 Pipe-Pond3N-Outlet	3.05	0 12:58	13.41	0.23	3.83	0.48	1.30	0.87	0.00	0.29
9 Pipe-Pond3S-Outlet	6.03	2 18:00	15.37	0.39	4.77	0.42	1.50	1.00	3199.00	0.12
10 Pipe-PondA-In1	22.57	0 12:28	73.80	0.31	6.25	0.26	1.72	0.69	0.00	0.04
11 Pipe-PondA-In2	55.57	0 12:11	34.48	1.61	17.69	0.09	2.00	1.00	59.00	0.25
12 Pipe-PondA-In3	11.84	0 12:08	11.59	1.02	4.16	2.56	1.72	0.86	0.00	0.38
13 Pipe-PondA-Outlet1	14.53	0 15:27	14.16	1.03	6.35	0.91	1.40	0.70	0.00	0.96
14 Pipe-Pond-A-Outlet2	14.53	0 15:27	49.91	0.29	13.05	0.08	0.77	0.38	0.00	3.06

Storage Nodes

Storage Node : Stor-100

Input Data


Invert Elevation (ft) 625.00
Max (Rim) Elevation (ft) 632.00
Max (Rim) Offset (ft) 7.00
Initial Water Elevation (ft) 625.93
Initial Water Depth (ft) 0.93
Ponded Area (ft²) 0.00
Evaporation Loss 0.00

Storage Area Volume Curves

Storage Curve : Storage-100

Stage	Storage Area	Storage Volume
(ft)	(ft ²)	(ft ³)
0	4000	0.000
1	24000	14000.00
2	180000	116000.00
3	460000	436000.00
4	630000	981000.00
7	650000	2901000.00

Storage Area Volume Curves

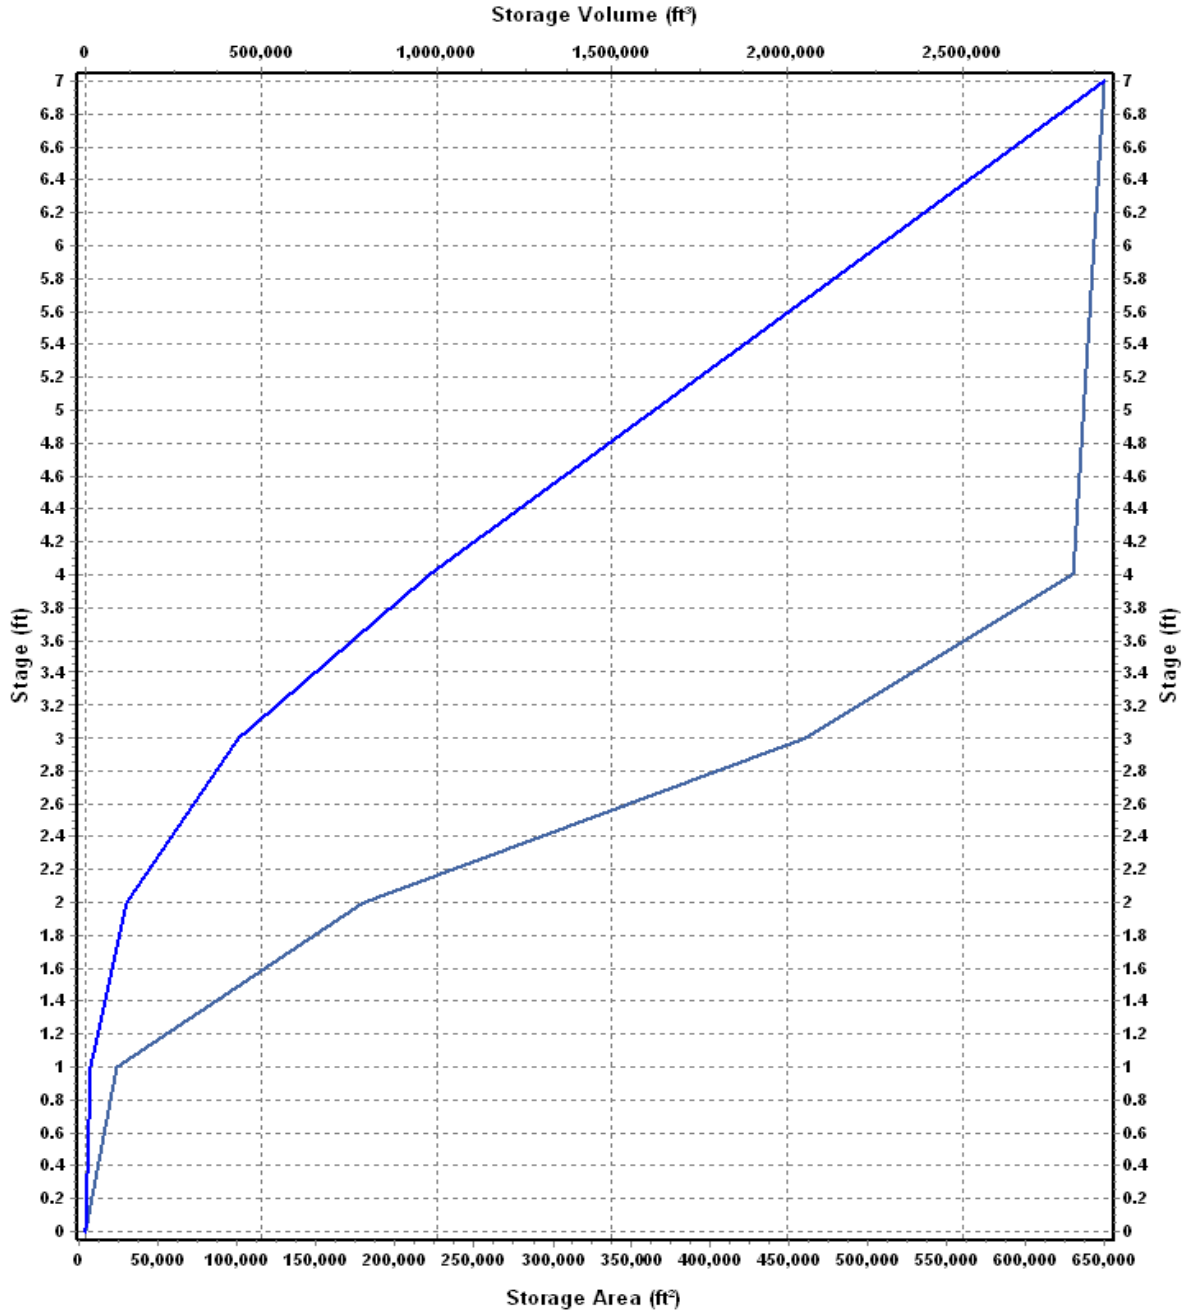

— Storage Area — Storage Volume

Storage Node : Stor-100 (continued)

Output Summary Results

Peak Inflow (cfs)	73.17
Peak Lateral Inflow (cfs)	73.17
Peak Outflow (cfs)	22.57
Peak Exfiltration Flow Rate (cfm)	0.00
Max HGL Elevation Attained (ft)	626.88
Max HGL Depth Attained (ft)	1.88
Average HGL Elevation Attained (ft)	626.02
Average HGL Depth Attained (ft)	1.02
Time of Max HGL Occurrence (days hh:mm)	0 12:28
Total Exfiltration Volume (1000-ft ³)	0.000
Total Flooded Volume (ac-in)	0
Total Time Flooded (min)	0
Total Retention Time (sec)	0.00

Storage Node : Stor-Pond1-2N

Input Data


Invert Elevation (ft) 604.00
Max (Rim) Elevation (ft) 626.00
Max (Rim) Offset (ft) 22.00
Initial Water Elevation (ft) 619.08
Initial Water Depth (ft) 15.08
Ponded Area (ft²) 0.00
Evaporation Loss 0.00

Storage Area Volume Curves

Storage Curve : Storage-Pond12N

Stage (ft)	Storage Area (ft ²)	Storage Volume (ft ³)
0	4955.10	0.000
2	15820.19	20775.29
4	25676.42	62271.90
6	36648.10	124596.42
8	46410.19	207654.71
10	53887.47	307952.37
12	61209.12	423048.96
14	69122.69	553380.77
16	85688.98	708192.44
18	90544.27	884425.69
20	96239.46	1071209.42
22	102428.12	1269877.00

Storage Area Volume Curves

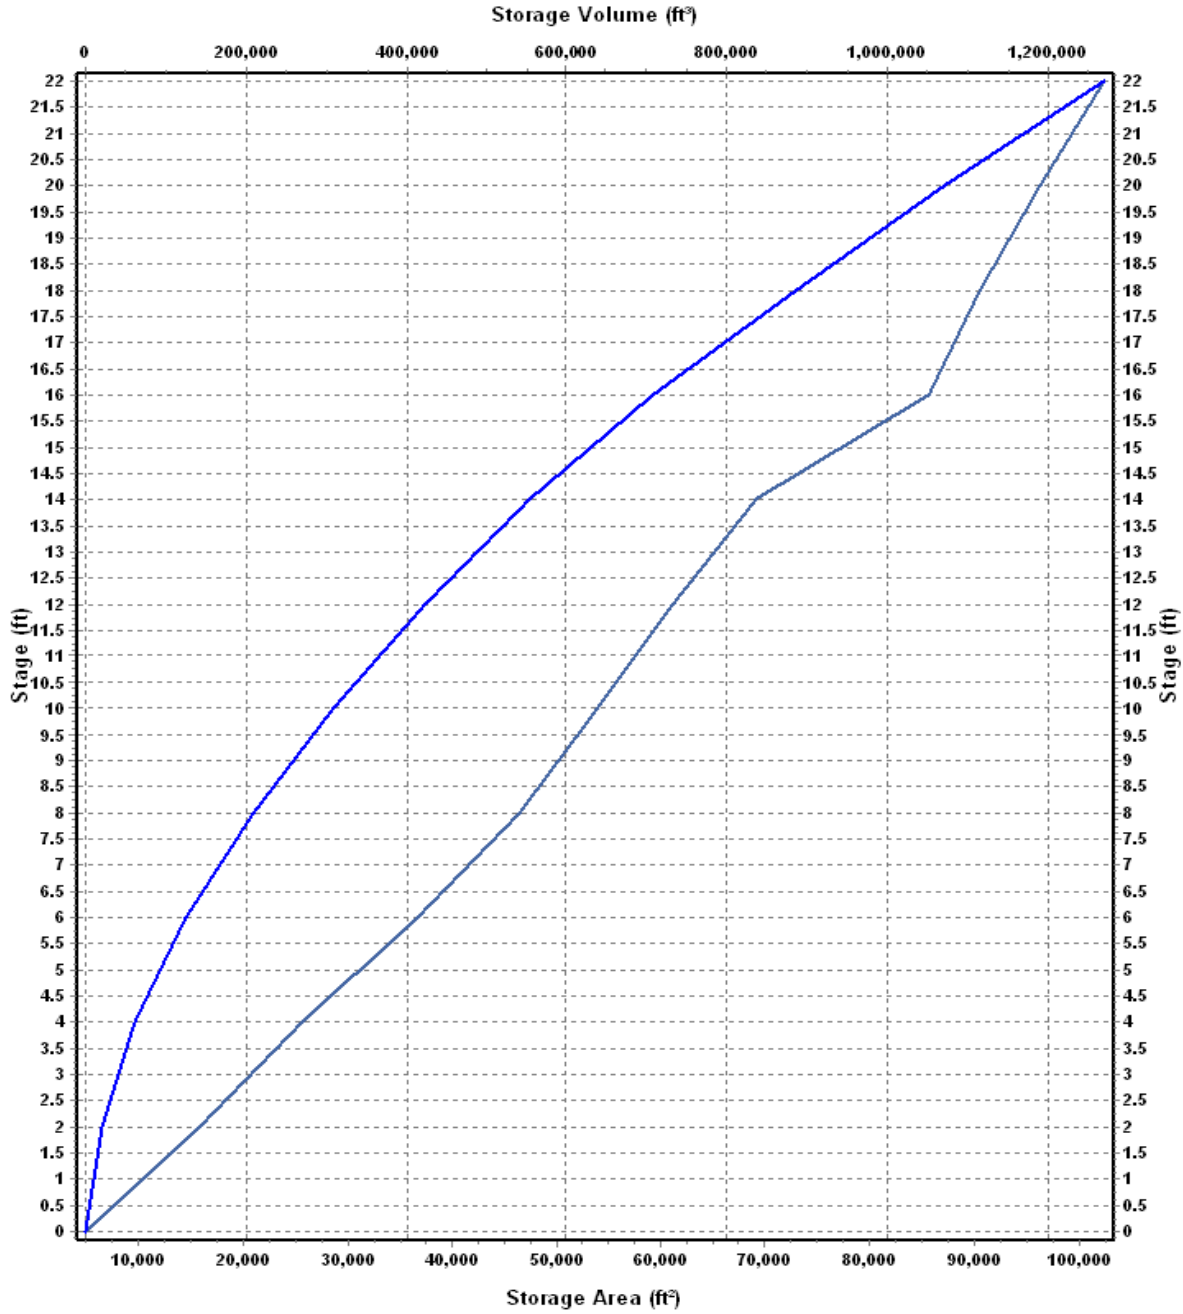

— Storage Area — Storage Volume

Storage Node : Stor-Pond1-2N (continued)

Output Summary Results

Peak Inflow (cfs)	44.90
Peak Lateral Inflow (cfs)	40.36
Peak Outflow (cfs)	5.21
Peak Exfiltration Flow Rate (cfm)	0.00
Max HGL Elevation Attained (ft)	620.14
Max HGL Depth Attained (ft)	16.14
Average HGL Elevation Attained (ft)	619.49
Average HGL Depth Attained (ft)	15.49
Time of Max HGL Occurrence (days hh:mm)	0 12:28
Total Exfiltration Volume (1000-ft³)	0.000
Total Flooded Volume (ac-in)	0
Total Time Flooded (min)	0
Total Retention Time (sec)	0.00

Storage Node : Stor-Pond1-2S

Input Data


Invert Elevation (ft) 600.00
Max (Rim) Elevation (ft) 626.00
Max (Rim) Offset (ft) 26.00
Initial Water Elevation (ft) 618.78
Initial Water Depth (ft) 18.78
Ponded Area (ft²) 0.00
Evaporation Loss 0.00

Storage Area Volume Curves

Storage Curve : Storage-Pond12S

Stage (ft)	Storage Area (ft ²)	Storage Volume (ft ³)
0	3604.98	0.000
2	17159.40	20764.38
4	27121.01	65044.79
6	36533.37	128699.17
8	42427.01	207659.55
10	46794.54	296881.10
12	50912.71	394588.35
14	54856.85	500357.91
16	58996.35	614211.11
18	62792.91	736000.37
20	66866.07	865659.35
22	71514.01	1004039.43
24	76770.32	1152323.76
26	90921.00	1320015.08

Storage Area Volume Curves

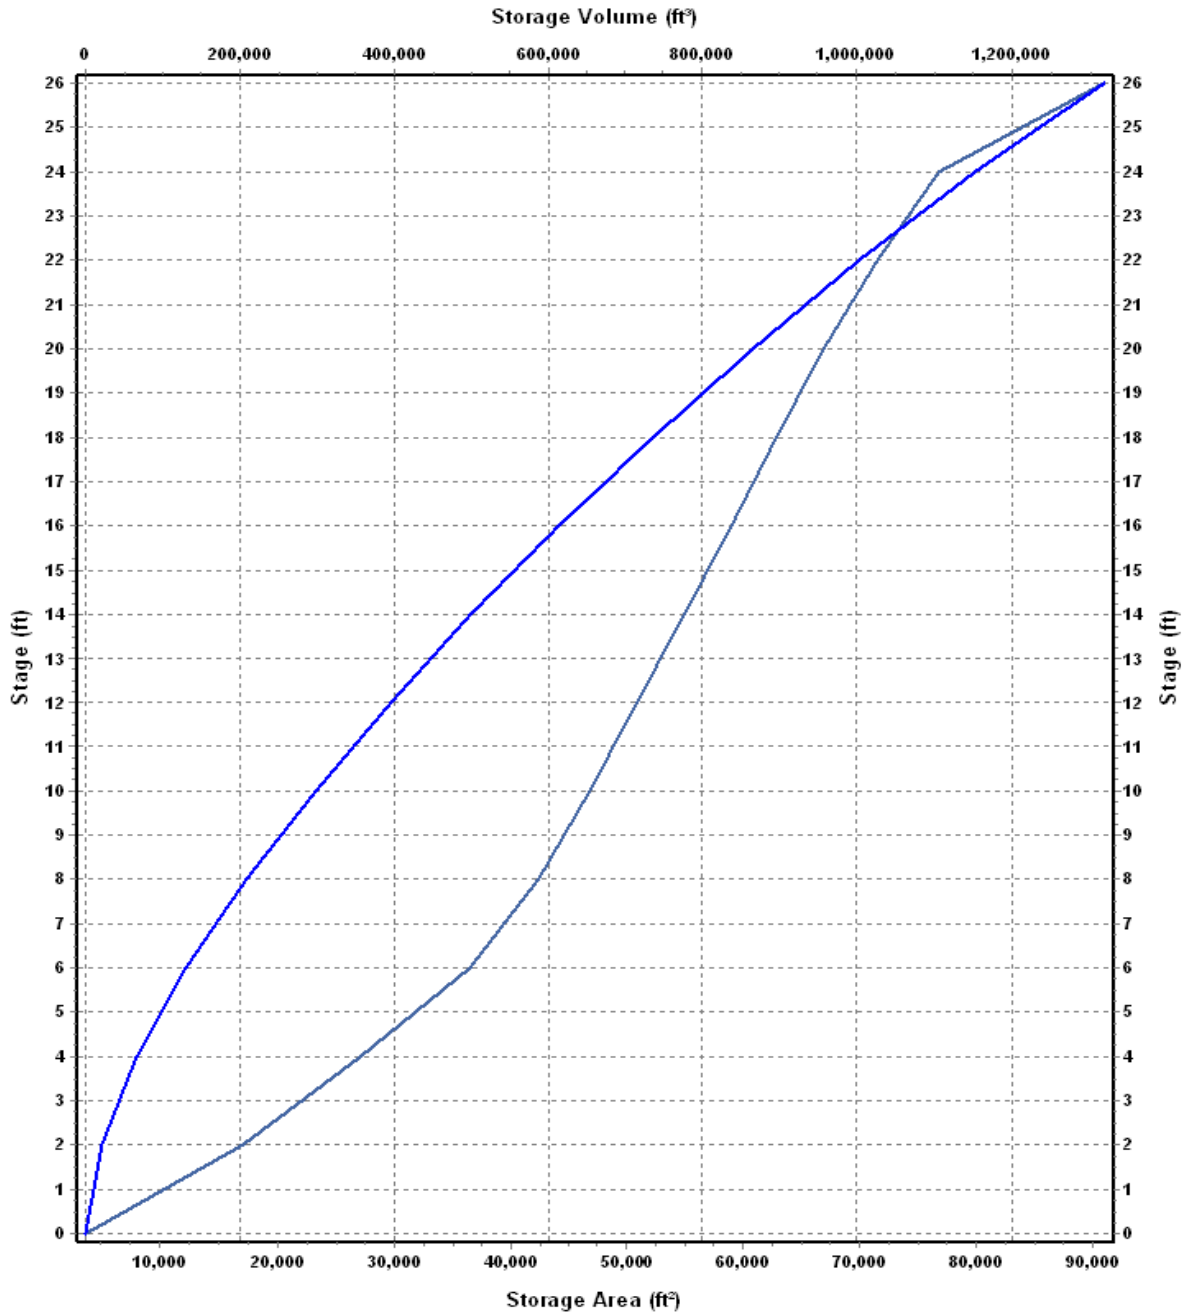

— Storage Area — Storage Volume

Storage Node : Stor-Pond1-2S (continued)

Output Summary Results

Peak Inflow (cfs)	26.57
Peak Lateral Inflow (cfs)	26.57
Peak Outflow (cfs)	2.46
Peak Exfiltration Flow Rate (cfm)	0.00
Max HGL Elevation Attained (ft)	619.32
Max HGL Depth Attained (ft)	19.32
Average HGL Elevation Attained (ft)	618.9
Average HGL Depth Attained (ft)	18.90
Time of Max HGL Occurrence (days hh:mm)	0 12:38
Total Exfiltration Volume (1000-ft³)	0.000
Total Flooded Volume (ac-in)	0
Total Time Flooded (min)	0
Total Retention Time (sec)	0.00

Storage Node : Stor-Pond3N

Input Data


Invert Elevation (ft) 604.00
Max (Rim) Elevation (ft) 632.00
Max (Rim) Offset (ft) 28.00
Initial Water Elevation (ft) 625.34
Initial Water Depth (ft) 21.34
Ponded Area (ft²) 0.00
Evaporation Loss 0.00

Storage Area Volume Curves

Storage Curve : Storage-Pond3N

Stage (ft)	Storage Area (ft ²)	Storage Volume (ft ³)
0	49967.95	0.000
2	78356.09	128324.04
4	89739.44	296419.57
6	98856.66	485015.67
8	107309.16	691181.49
10	115789.97	914280.62
12	124461.94	1154532.53
14	133313.10	1412307.57
16	142403.76	1688024.43
18	152229.55	1982657.74
20	162328.39	2297215.68
22	172534.85	2632078.92
24	182457.24	2987071.01
26	192696.07	3362224.32
28	218974.00	3773894.39

Storage Area Volume Curves

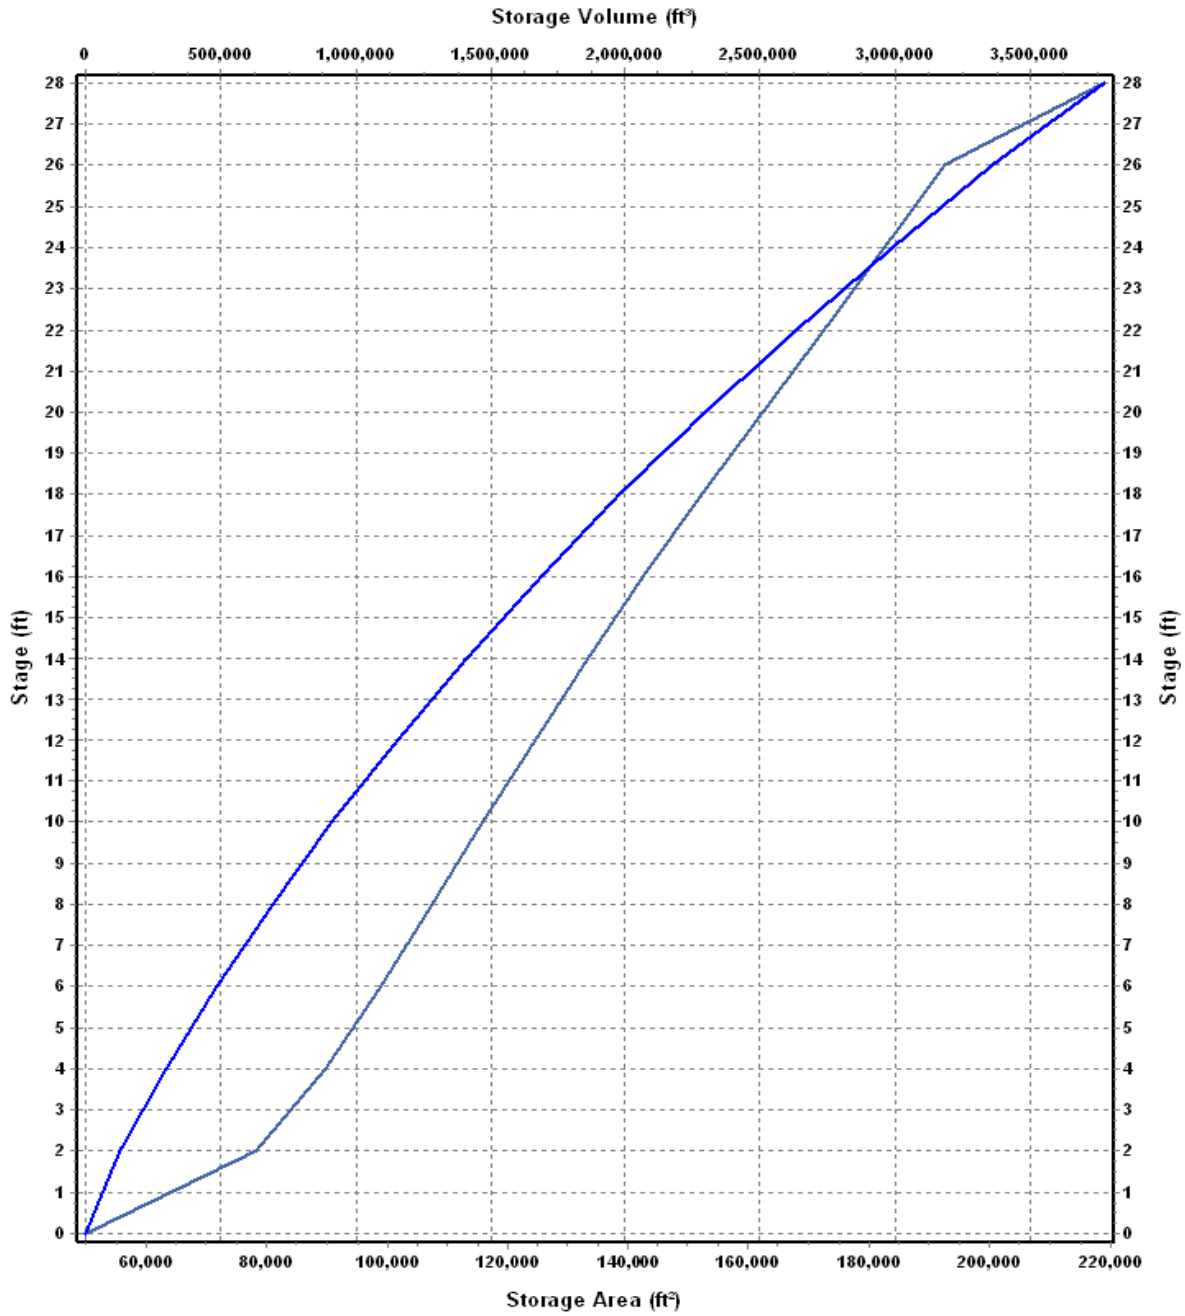

— Storage Area — Storage Volume

Storage Node : Stor-Pond3N (continued)

Output Summary Results

Peak Inflow (cfs)	56.66
Peak Lateral Inflow (cfs)	56.66
Peak Outflow (cfs)	3.05
Peak Exfiltration Flow Rate (cfm)	0.00
Max HGL Elevation Attained (ft)	626.44
Max HGL Depth Attained (ft)	22.44
Average HGL Elevation Attained (ft)	626.2
Average HGL Depth Attained (ft)	22.20
Time of Max HGL Occurrence (days hh:mm)	2 21:00
Total Exfiltration Volume (1000-ft³)	0.000
Total Flooded Volume (ac-in)	0
Total Time Flooded (min)	0
Total Retention Time (sec)	0.00

Storage Node : Stor-Pond3S

Input Data


Invert Elevation (ft) 604.00
Max (Rim) Elevation (ft) 632.00
Max (Rim) Offset (ft) 28.00
Initial Water Elevation (ft) 624.66
Initial Water Depth (ft) 20.66
Ponded Area (ft²) 0.00
Evaporation Loss 0.00

Storage Area Volume Curves

Storage Curve : Storage-Pond3S

Stage (ft)	Storage Area (ft ²)	Storage Volume (ft ³)
0	41626.09	0.000
2	72438.46	114064.55
4	82587.06	269090.07
6	89505.89	441183.02
8	96741.54	627430.45
10	104521.74	828693.73
12	112486.68	1045702.15
14	120990.09	1279178.92
16	129285.30	1529454.31
18	137679.45	1796419.06
20	146088.97	2080187.48
22	154269.17	2380545.62
24	162544.34	2697359.13
26	170930.02	3030833.49
28	196791.00	3398554.51

Storage Area Volume Curves

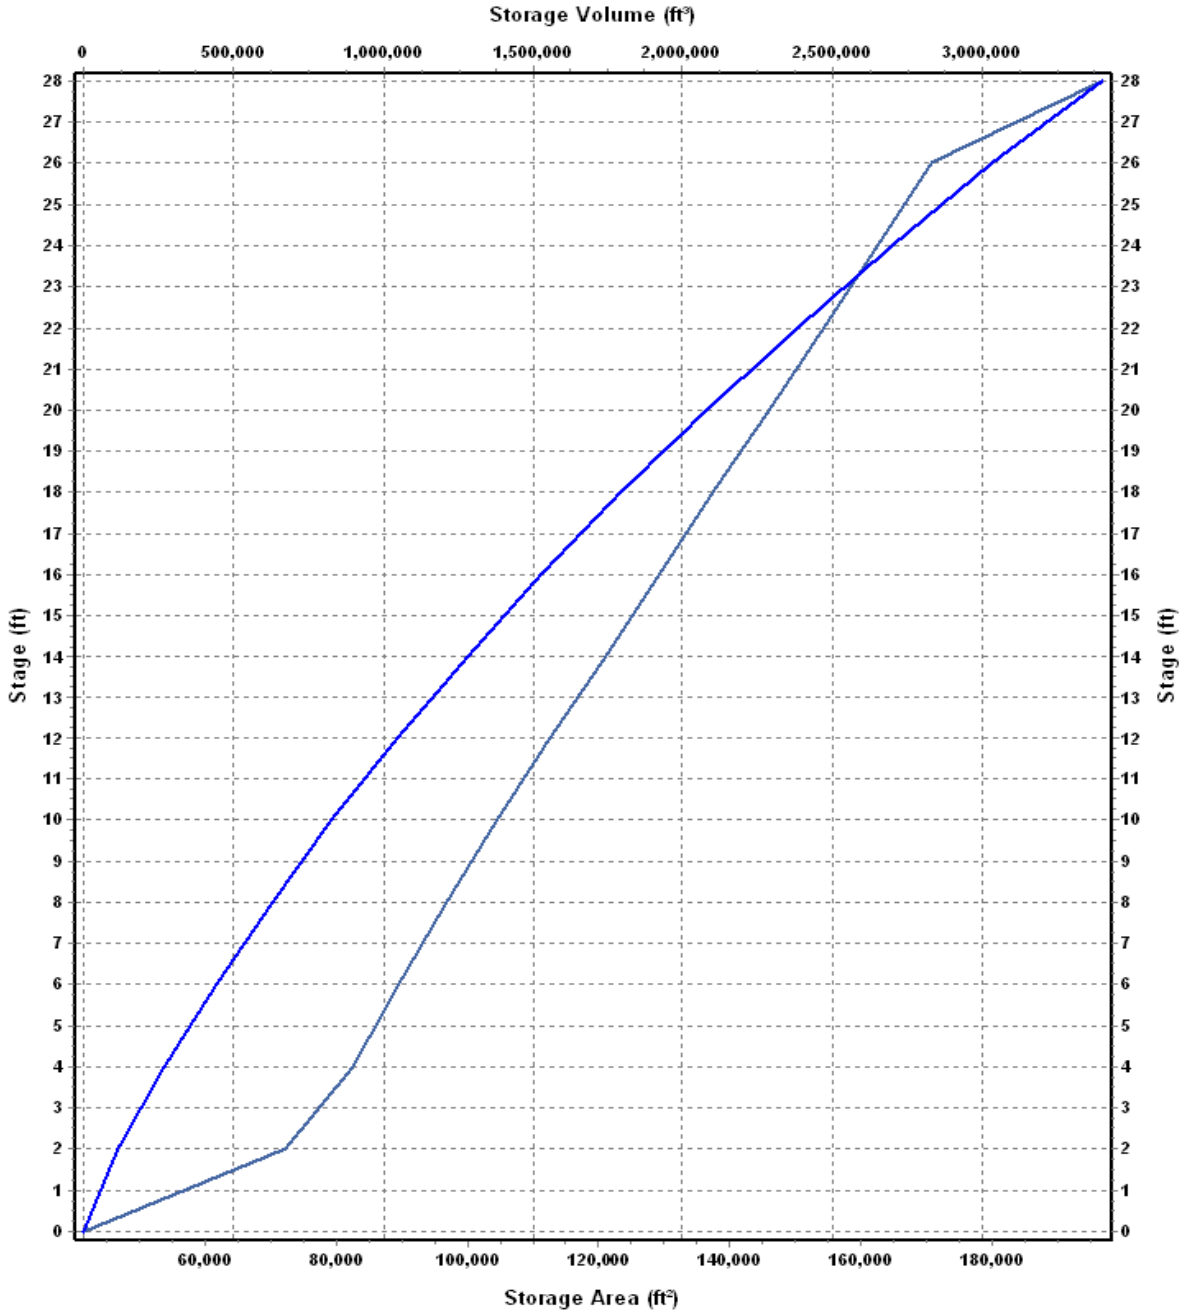

— Storage Area — Storage Volume

Storage Node : Stor-Pond3S (continued)

Output Summary Results

Peak Inflow (cfs)	53.26
Peak Lateral Inflow (cfs)	53.26
Peak Outflow (cfs)	6.03
Peak Exfiltration Flow Rate (cfm)	0.00
Max HGL Elevation Attained (ft)	626.62
Max HGL Depth Attained (ft)	22.62
Average HGL Elevation Attained (ft)	626.29
Average HGL Depth Attained (ft)	22.29
Time of Max HGL Occurrence (days hh:mm)	3 00:00
Total Exfiltration Volume (1000-ft³)	0.000
Total Flooded Volume (ac-in)	0
Total Time Flooded (min)	0
Total Retention Time (sec)	0.00

Storage Node : Stor-PondA

Input Data


Invert Elevation (ft) 600.00
Max (Rim) Elevation (ft) 626.00
Max (Rim) Offset (ft) 26.00
Initial Water Elevation (ft) 615.50
Initial Water Depth (ft) 15.50
Ponded Area (ft²) 0.00
Evaporation Loss 0.00

Storage Area Volume Curves

Storage Curve : Storage-PondA

Stage (ft)	Storage Area (ft ²)	Storage Volume (ft ³)
0	169	0.000
2	82304	82473.00
4	165720	330497.00
6	199134	695351.00
8	235912	1130397.00
10	262021	1628330.00
12	283586	2173937.00
14	302913	2760436.00
16	333408	3396757.00
18	359569	4089734.00
20	375557	4824860.00
22	391075	5591492.00
24	406267	6388834.00
26	484900	7280001.00

Storage Area Volume Curves

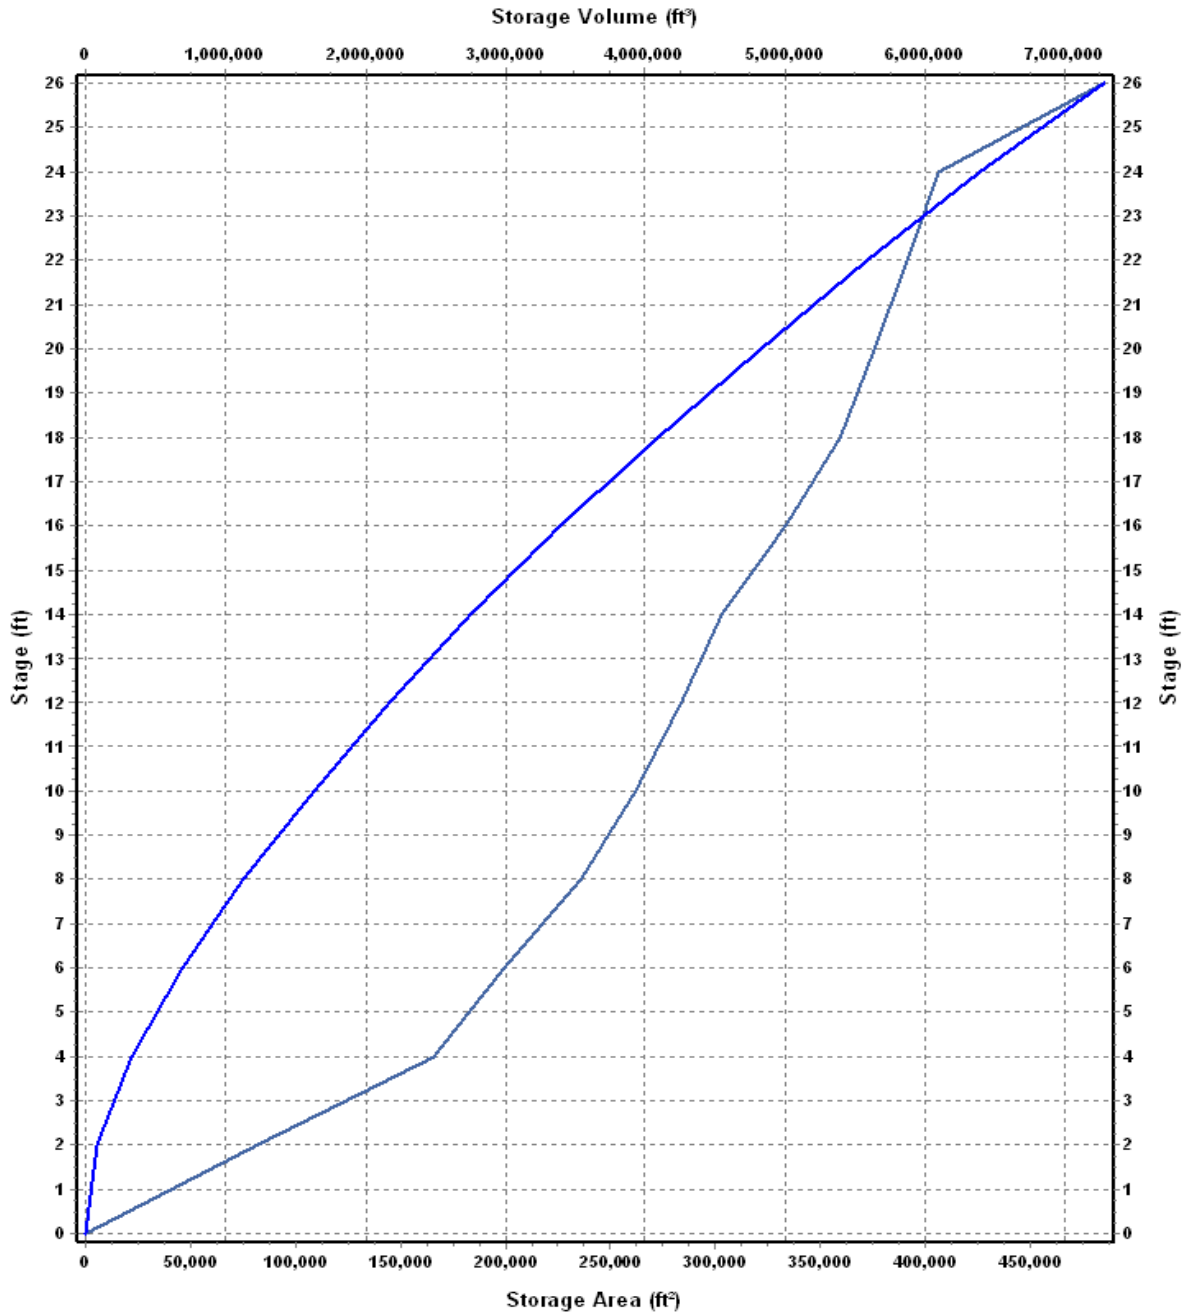

— Storage Area — Storage Volume

Storage Node : Stor-PondA (continued)

Outflow Orifices

SN Element ID	Orifice Type	Orifice Shape	Flap Gate	Circular Orifice Diameter (ft)	Rectangular Orifice Height (ft)	Rectangular Orifice Width (ft)	Orifice Invert Elevation (ft)	Orifice Coefficient
1 Orifice-01	Bottom	CIRCULAR	No	2.00			615.50	0.61

Output Summary Results

Peak Inflow (cfs)	164.96
Peak Lateral Inflow (cfs)	91.27
Peak Outflow (cfs)	14.53
Peak Exfiltration Flow Rate (cfm)	0.00
Max HGL Elevation Attained (ft)	617.9
Max HGL Depth Attained (ft)	17.90
Average HGL Elevation Attained (ft)	616.94
Average HGL Depth Attained (ft)	16.94
Time of Max HGL Occurrence (days hh:mm)	0 15:26
Total Exfiltration Volume (1000-ft ³)	0.000
Total Flooded Volume (ac-in)	0
Total Time Flooded (min)	0
Total Retention Time (sec)	0.00

Established in 1960, Golder Associates is a global, employee-owned organization that helps clients find sustainable solutions to the challenges of finite resources, energy and water supply and management, waste management, urbanization, and climate change. We provide a wide range of independent consulting, design, and construction services in our specialist areas of earth, environment, and energy. By building strong relationships and meeting the needs of clients, our people have created one of the most trusted professional services organizations in the world.

Africa	+ 27 11 254 4800
Asia	+ 852 2562 3658
Australasia	+ 61 3 8862 3500
Europe	+ 356 21 42 30 20
North America	+ 1 800 275 3281
South America	+ 56 2 2616 2000

solutions@golder.com
www.golder.com

Golder Associates Inc.
15851 South U.S. 27, Suite 50
Lansing, MI 48906 USA
Tel: (517) 482-2262
Fax: (517) 482-2460



Engineering Earth's Development, Preserving Earth's Integrity

Golder, Golder Associates and the GA globe design are trademarks of Golder Associates Corporation