

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 9/24/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1300
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Sunny	Temperature: 57
Weather (PM): Sunny	Temperature: 70
Precipitation: None	Wind: W, 4-12 mph

EQUIPMENT ON SITE
1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION																												
Work performed while Golder was onsite:																												
Ryan Central -1 Foreman, 3 Operators, 2 Laborers																												
<ul style="list-style-type: none"> Continued placement of protective cover in Pond 1. Placed structural fill outside of Pond 2. Began placement of topsoil in Chemical Ponds. Import structural. Import protective cover. Import topsoil. Water truck used for dust control and to maintain fill moisture. 																												
<u>Summary of Dewatering:</u>																												
<table> <thead> <tr> <th><u>Week 1</u></th> <th><u>Week 2</u></th> <th><u>Week 3</u></th> <th><u>Week 4</u></th> </tr> </thead> <tbody> <tr> <td>05/06/19: 281,988 gal.</td> <td>05/13/19: 399,021 gal.</td> <td>05/20/19: 328,687 gal.</td> <td>05/27/19: Holiday</td> </tr> <tr> <td>05/07/19: 387,165 gal.</td> <td>05/14/19: 484,537 gal.</td> <td>05/21/19: 402,720 gal.</td> <td>05/28/19: 386,176 gal.</td> </tr> <tr> <td>05/08/19: 405,104 gal.</td> <td>05/15/19: 486,473 gal.</td> <td>05/22/19: 487,716 gal.</td> <td>05/29/19: 468,094 gal.</td> </tr> <tr> <td>05/09/19: 404,705 gal.</td> <td>05/16/19: 481,499 gal.</td> <td>05/23/19: 408,516 gal.</td> <td>05/30/19: 357,569 gal.</td> </tr> <tr> <td>05/10/19: 410,498 gal.</td> <td>05/17/19: 484,331 gal.</td> <td>05/24/19: 484,613 gal.</td> <td>05/31/19: 161,965 gal.</td> </tr> <tr> <td>05/11/19: 64,691 gal.</td> <td>05/18/19: 249,566 gal.</td> <td>05/25/19: None</td> <td>06/01/19: None</td> </tr> </tbody> </table>	<u>Week 1</u>	<u>Week 2</u>	<u>Week 3</u>	<u>Week 4</u>	05/06/19: 281,988 gal.	05/13/19: 399,021 gal.	05/20/19: 328,687 gal.	05/27/19: Holiday	05/07/19: 387,165 gal.	05/14/19: 484,537 gal.	05/21/19: 402,720 gal.	05/28/19: 386,176 gal.	05/08/19: 405,104 gal.	05/15/19: 486,473 gal.	05/22/19: 487,716 gal.	05/29/19: 468,094 gal.	05/09/19: 404,705 gal.	05/16/19: 481,499 gal.	05/23/19: 408,516 gal.	05/30/19: 357,569 gal.	05/10/19: 410,498 gal.	05/17/19: 484,331 gal.	05/24/19: 484,613 gal.	05/31/19: 161,965 gal.	05/11/19: 64,691 gal.	05/18/19: 249,566 gal.	05/25/19: None	06/01/19: None
<u>Week 1</u>	<u>Week 2</u>	<u>Week 3</u>	<u>Week 4</u>																									
05/06/19: 281,988 gal.	05/13/19: 399,021 gal.	05/20/19: 328,687 gal.	05/27/19: Holiday																									
05/07/19: 387,165 gal.	05/14/19: 484,537 gal.	05/21/19: 402,720 gal.	05/28/19: 386,176 gal.																									
05/08/19: 405,104 gal.	05/15/19: 486,473 gal.	05/22/19: 487,716 gal.	05/29/19: 468,094 gal.																									
05/09/19: 404,705 gal.	05/16/19: 481,499 gal.	05/23/19: 408,516 gal.	05/30/19: 357,569 gal.																									
05/10/19: 410,498 gal.	05/17/19: 484,331 gal.	05/24/19: 484,613 gal.	05/31/19: 161,965 gal.																									
05/11/19: 64,691 gal.	05/18/19: 249,566 gal.	05/25/19: None	06/01/19: None																									

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

<u>Week 5</u> 06/03/19: 185,365 gal. 06/04/19: 409,662 gal. 06/05/19: 345,122 gal. 06/06/19: 311,007 gal. 06/07/19: 276,790 gal. 06/08/19: 65,064 gal.	<u>Week 6</u> 06/10/19: 175,022 gal. 06/11/19: 184,365 gal. 06/12/19: 178,934 gal. 06/13/19: 147,219 gal. 06/14/19: 13,156 gal. 06/15/19: 142,063 gal.	<u>Week 7</u> 06/17/2019: 247,813 gal. 06/18/2019: 68,510 gal. 06/19/2019: 215,872 gal. 06/20/2019: 207,117 gal. 06/21/2019: 200,874 gal. 06/22/2019: 102,207 gal.	<u>Week 8</u> 06/24/2019: 218,008 gal. 06/25/2019: 208,371 gal. 06/26/2019: 181,215 gal. 06/27/2019: 216,650 gal. 06/28/2019: 208,921 gal. 06/29/2019: 135,907 gal.
<u>Week 9</u> 07/01/19: 175,586 gal. 07/02/19: 129,459 gal. 07/03/19: 13,878 gal. 07/04/19: None 07/05/19: 137,112 gal. 07/06/19: 95,100 gal.	<u>Week 10</u> 07/08/19: 107,894 gal. 07/09/19: 44,007 gal. 07/10/19: 25,922 gal. 07/11/19: 27,943 gal. 07/12/19: 18,335 gal. 07/13/19: None	<u>Week 11</u> 07/15/19: None 07/16/19: 17,852 gal. 07/17/19: 20,293 gal. 07/18/19: None 07/19/19: 20,316 gal. 07/20/19: None	<u>Week 12</u> 07/22/19: 15,890 gal. 07/23/19: 15,310 gal. 07/24/19: 23,572 gal. 07/25/19: None 07/26/19: None 07/27/19: None
<u>Week 13</u> 07/29/19: None 07/30/19: 23,124 gal.	<u>Week 14</u> 08/16/19: 49,780 gal. 08/22/19: 94,717 gal. Total: 14,006,131 gal.		

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of protective cover in Pond 1 in minimum 18 inch loose lift using D6T LGP dozer.
- Golder observed placement of structural fill outside liner limits of Pond 2's southeast corner and compacted using Cat 815.
- Golder observed placement of single 6 inch lift of topsoil in the Chemical Pond work area.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:




DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Placement of topsoil in the Chemical Pond work area, looking west.

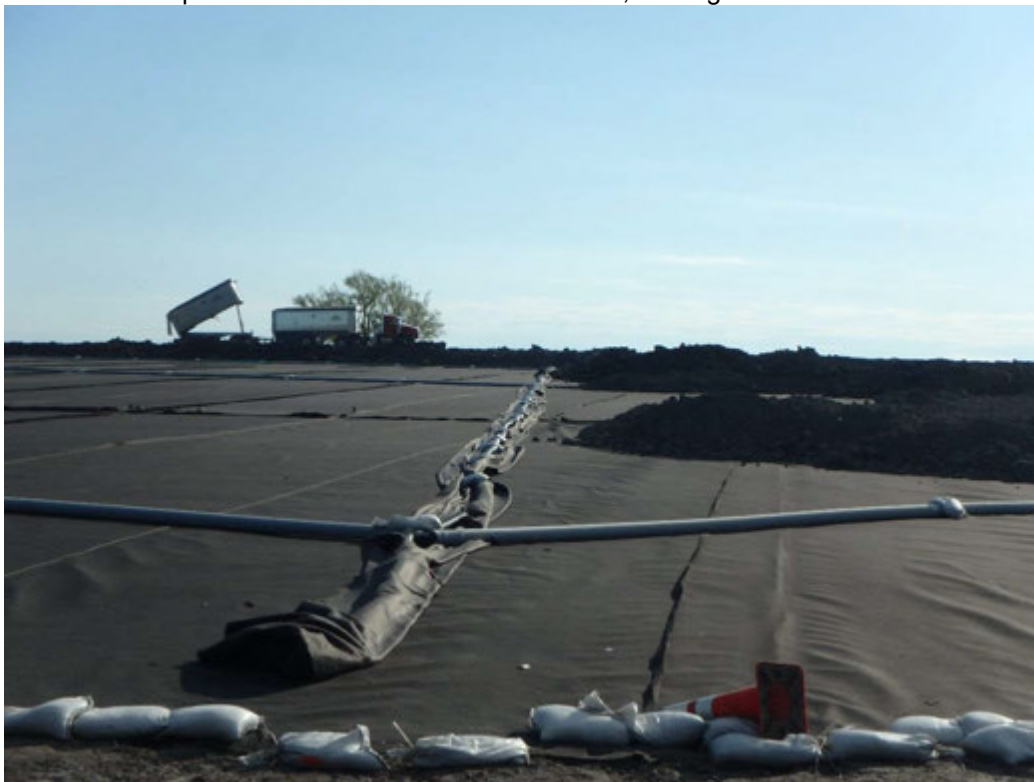

Protective cover on Pond 1 geotextile, looking east.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Placement of structural fill outside of Pond 2's southeast corner, looking east.



Finished liner sub-grade in Pond 2, looking north.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 9/25/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1500
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Partly Sunny	Temperature: 63
Weather (PM): Mostly Cloudy	Temperature: 70
Precipitation: None	Wind: NW, 3-15 mph

EQUIPMENT ON SITE
1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION	
Work performed while Golder was onsite:	
Ryan Central -1 Foreman, 3 Operators, 2 Laborers	
<ul style="list-style-type: none"> Continued placement of protective cover in Pond 1. Continued placement of topsoil in Chemical Ponds. Leistered textile for the burrito used on the above-cap pipe in Pond 1. Import protective cover. Import topsoil. Water truck used for dust control and to maintain fill moisture. 	
<u>Summary of Dewatering:</u>	
<u>Week 1</u>	<u>Week 2</u>
05/06/19: 281,988 gal.	05/13/19: 399,021 gal.
05/07/19: 387,165 gal.	05/14/19: 484,537 gal.
05/08/19: 405,104 gal.	05/15/19: 486,473 gal.
05/09/19: 404,705 gal.	05/16/19: 481,499 gal.
05/10/19: 410,498 gal.	05/17/19: 484,331 gal.
05/11/19: 64,691 gal.	05/18/19: 249,566 gal.
<u>Week 3</u>	<u>Week 4</u>
05/20/19: 328,687 gal.	05/27/19: Holiday
05/21/19: 402,720 gal.	05/28/19: 386,176 gal.
05/22/19: 487,716 gal.	05/29/19: 468,094 gal.
05/23/19: 408,516 gal.	05/30/19: 357,569 gal.
05/24/19: 484,613 gal.	05/31/19: 161,965 gal.
05/25/19: None	06/01/19: None
<u>Week 5</u>	<u>Week 6</u>
06/03/19: 185,365 gal.	06/10/19: 175,022 gal.
06/04/19: 409,662 gal.	06/11/19: 184,365 gal.
06/05/19: 345,122 gal.	06/12/19: 178,934 gal.
06/06/19: 311,007 gal.	06/13/19: 147,219 gal.
06/07/19: 276,790 gal.	06/14/19: 13,156 gal.
06/08/19: 65,064 gal.	06/15/19: 142,063 gal.
<u>Week 7</u>	<u>Week 8</u>
06/17/2019: 247,813 gal.	06/24/2019: 218,008 gal.
06/18/2019: 68,510 gal.	06/25/2019: 208,371 gal.
06/19/2019: 215,872 gal.	06/26/2019: 181,215 gal.
06/20/2019: 207,117 gal.	06/27/2019: 216,650 gal.
06/21/2019: 200,874 gal.	06/28/2019: 208,921 gal.
06/22/2019: 102,207 gal.	06/29/2019: 135,907 gal.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

Week 9	Week 10	Week 11	Week 12
07/01/19: 175,586 gal.	07/08/19: 107,894 gal.	07/15/19: None	07/22/19: 15,890 gal.
07/02/19: 129,459 gal.	07/09/19: 44,007 gal.	07/16/19: 17,852 gal.	07/23/19: 15,310 gal.
07/03/19: 13,878 gal.	07/10/19: 25,922 gal.	07/17/19: 20,293 gal.	07/24/19: 23,572 gal.
07/04/19: None	07/11/19: 27,943 gal.	07/18/19: None	07/25/19: None
07/05/19: 137,112 gal.	07/12/19: 18,335 gal.	07/19/19: 20,316 gal.	07/26/19: None
07/06/19: 95,100 gal.	07/13/19: None	07/20/19: None	07/27/19: None
<u>Week 13</u>	<u>Week 14</u>		
07/29/19: None	08/16/19: 49,780 gal.		
07/30/19: 23,124 gal.	08/22/19: 94,717 gal.		
	Total: 14,006,131 gal.		

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of protective cover in Pond 1 in minimum 18 inch loose lift using D6T LGP dozer.
- Golder observed placement of single 6 inch lift of topsoil in the Chemical Pond work area.
- Golder monitored leistering of the textile used to burrito the 6-AA stone used to cover the solid ADS pipe used for the above-cap drain pipe in Pond 1.
- Golder collected and shipped protective samples PC-7 and PC-8.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

Aubrey Proctor (EGLE) and Michelle Marion (CEC) onsite for site visit.

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature: 

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



6AA placed around the solid above-cap drain pipe in Pond 1, looking east.



Burrito of the above-cap drain pipe stone, looking east.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Placement of protective cover in Pond 1, looking east.



Import of protective cover in Pond 1, looking south.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 9/26/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1930
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS

Weather (AM): Partly Sunny	Temperature: 64
Weather (PM): Mostly Sunny	Temperature: 72
Precipitation: Rain	Wind: NW, 2-18 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 3 Operators, 2 Laborers

- Continued placement of protective cover in Pond 1.
- Continued placement of topsoil in Chemical Ponds.
- Rolled liner sub-grade in Pond 2.
- Walked Pond 2 liner sub-grade to remove rocks over 0.75 inches.
- Import protective cover.
- Import topsoil.
- Water truck used for dust control and to maintain fill moisture.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of protective cover in Pond 1 in minimum 18 inch loose lift using D6T LGP dozer.
- Golder observed placement of single 6 inch lift of topsoil in the Chemical Pond work area.
- Golder observed rolling of the liner sub-grade in Pond 2 with Cat CS56B smooth drum roller.
- Golder observed removal of rock over 0.75 inches or with sharp edges from surface of Pond 2's liner sub-grade.
- Golder along with CEC and Ryan representatives completed visual inspection of Pond 2 liner sub-grade. Pond 2 sub-grade approved for deployment of geomembrane.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Rolling of liner sub-grade in Pond 2, looking north.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Placement of protective cover in Pond 1, looking northeast.



Placement of protective cover over the above-cap drain pipe in Pond 1, looking northeast.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Overview of rolled liner sub-grade in Pond 2, looking west.



Overview of protective cover being placed in Pond 1, looking northeast.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 9/27/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1930
Contractor(s):	Ryan Central Inc. Chesapeake	Contractor(s) Rep:	John Johnson (Ryan Central) Greg Parrott

SITE CONDITIONS

Weather (AM): Mostly Sunny	Temperature: 59
Weather (PM): Overcast	Temperature: 72
Precipitation: Rain	Wind: S, 2-10 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 3 Operators, 2 Laborers

- Continued placement of protective cover in Pond 1.
- Continued placement of topsoil in Chemical Ponds.
- Rolled liner sub-grade in Pond 2 ahead of geomembrane deployment.
- Import protective cover.
- Import topsoil.
- Water truck used for dust control and to maintain fill moisture.

Chesapeake – 1 Superintendent, 11 Technicians, 1 operator

- Chesapeake began deployment of geomembrane in Pond 2 deploying panels P-26 thru P-32.
- Chesapeake preformed trial welds for fusion and extrusion prior to any seaming or repairs.
- Chesapeake seamed panels P-26 thru P-31 deployed today using the fusion method.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of protective cover in Pond 1 in minimum 18 inch loose lift using D6T LGP dozer.
- Golder observed placement of single 6 inch lift of topsoil in the Chemical Pond work area.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder observed rolling of the liner sub-grade in Pond 2 prior to deployment of geomembrane using a Cat CS56B smooth drum roller.
- Performed CQA oversight and documentation on 40mil HDPE micro-spike geomembrane deployed today.
- Chesapeake installed approximately 117,530sf of geomembrane on Pond 2 today for a total of 498,680sf to date.
- Golder monitored deployment of 40mil micro-spike geomembrane panels P-26 thru P-32.
- Golder monitored and documented trial seams for fusion in P.M. preformed prior to seaming activities.
- Golder observed seaming of deployed panels P-26 thru P-31 on Ponds by fusion seaming method using 3 wedges.
- Golder marked destructive test locations DS-39 thru DS-47 on geomembrane for removal by Chesapeake and destructive field testing onsite.
- Worked ceased rather suddenly due to weather.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

Pre-Construction meeting on geomembrane installation with CEC, Ryan, Chesapeake and Golder.

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Protective cover in Pond 1, looking north.



Deployment of 40mil geomembrane in Pond 2, looking southeast.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Seaming of geomembrane by fusion method, looking east.



Rub sheet/Tub for generators while on liner, looking south.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Destructive test and defect number.



Destruct ready to be removed for field testing.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Protective cover in Pond 1, looking north.



Deployment of 40mil geomembrane in Pond 2, looking southeast.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Seaming of geomembrane by fusion method, looking east.




Rub sheet/Tub for generators while on liner, looking south.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Destructive test and defect number.

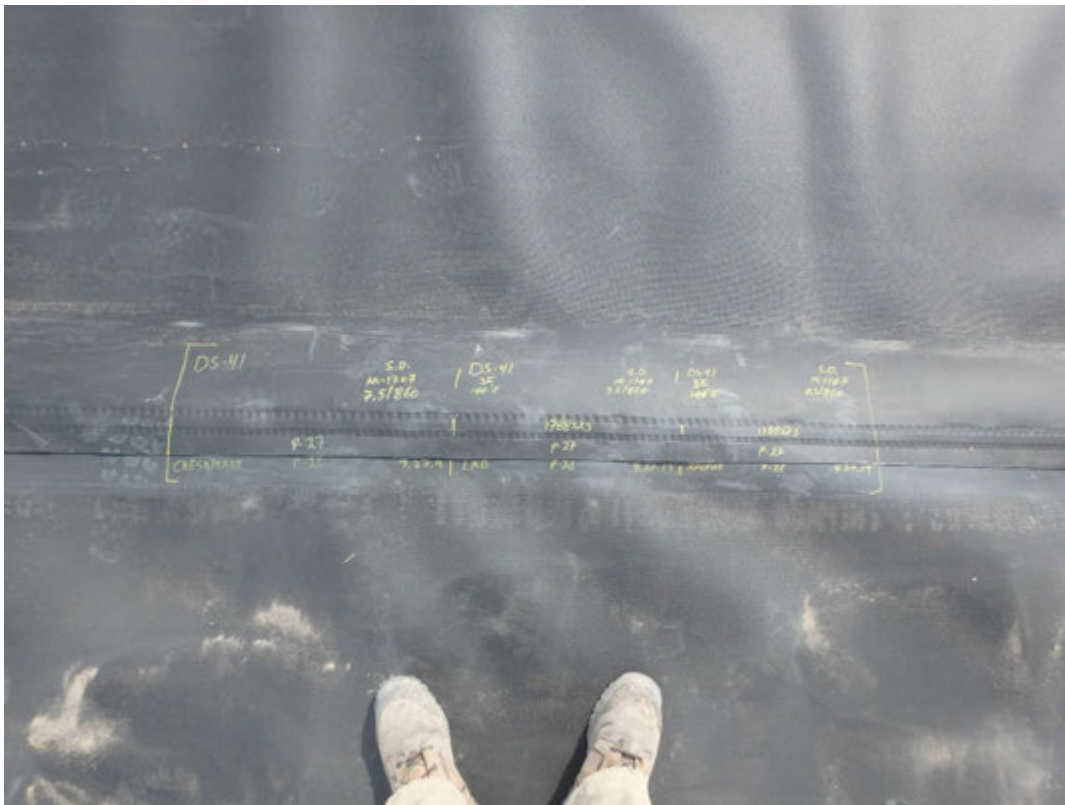

Destruct ready to be removed for field testing.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 9/30/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1730
Contractor(s):	Ryan Central Inc. Chesapeake	Contractor(s) Rep:	John Johnson (Ryan Central) Greg Parrott

SITE CONDITIONS

Weather (AM): Cloudy	Temperature: 62
Weather (PM): Mostly Sunny	Temperature: 75
Precipitation: Rain	Wind: W, 2-7 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 1 Operator

- No Construction due to rain.
- Standby to assist Chesapeake as needed.

Chesapeake – 1 Superintendent, 11 Technicians, 1 operator

- Chesapeake preformed trial welds for extrusion prior to starting repairs.
- Chesapeake preformed air pressure testing of all fusion seams on deployed geomembrane panels P-26 thru P-31.
- Chesapeake made repairs to all defects on panels P-26 thru P-31 deployed.
- Chesapeake vacuum tested repairs.
- Chesapeake field tested destructs DS-39 thru DS-47.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder monitored and documented trial seams for extrusion in P.M. preformed prior to start of repairs.
- Golder monitored non-destructive testing of all fusion seams by air pressure testing to a minimum of 30psi for 5 minutes with a loss of no more than 4psi in accordance to specifications.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder observed repairs to defects by extrusion method.
- Golder monitored vacuum testing of repairs.
- Golder monitored field testing of destructs DS-39 thru DS-47 prior to shipping for third party testing.
- Golder shipped destructs DS-39 thru DS-42, DS-45 and DS-46 to laboratory for testing.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

DS-44 on seam P-27/28 and DS-47 on seam P-30/31 both failed field testing. Both of the seams to be cut out and reconstructed using fusion method, seam P-27/28 will also include removal of DS-43 that passed field testing. Both seams were welded using fusion welder M-65 which is in progress of being inspected and repaired.

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Air pressure testing of fusion seam.



Preparing trial weld.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Destructive samples removed for sampling.



Field test of destructive sample.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/1/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1930	
Contractor(s): Ryan Central Inc. Chesapeake	Contractor(s) Rep: John Johnson (Ryan Central) Greg Parrott	

SITE CONDITIONS

Weather (AM): Mostly Sunny	Temperature: 70
Weather (PM): Mostly Cloudy	Temperature: 87
Precipitation: None	Wind: SW, 2-10 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator

- Continued placement of protective cover in Pond 1.
- Standby to assist Chesapeake as needed.

Chesapeake – 1 Superintendent, 11 Technicians, 1 operator

- Chesapeake preformed trial welds for fusion and extrusion prior to any seaming or repairs.
- Chesapeake preformed seaming using the fusion method.
- Chesapeake preformed air pressure testing of all fusion seams performed today.
- Chesapeake made repairs to all defects on panels P-27 thru P-32.
- Chesapeake continued vacuum testing of repairs.
- Chesapeake field tested destructs DS-43, DS-44, DS-47 thru DS-49.
- Chesapeake continued deployment of geotextile in Pond 2.
- Chesapeake sewed all panels of geotextile deployed today.
- Chesapeake made repairs to all defects on geotextile panels deployed.
- Chesapeake placed sandbags around the outside edges of all deployed geotextile.
- Chesapeake QC shot panel layout and defects.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of protective cover in Pond 1.
- Golder monitored and documented trial seams for fusion and extrusion in P.M. preformed prior to start of seaming or repairs.
- Golder observed reconstruction of seam 27/28, 30/31 and 31/32 using the fusion method.
- Golder monitored non-destructive testing of fusion seams completed today by air pressure testing to a minimum of 30psi for 5 minutes with a loss of no more than 4psi in accordance to specifications.
- Golder marked destructive test locations DS-43, DS-44 and DS-47 thru DS-49 on geomembrane for removal by Chesapeake and destructive field testing onsite.
- Golder observed repairs to defects by extrusion method.
- Golder monitored vacuum testing of repairs.
- Golder monitored field testing of destructs DS-43, DS-44 and DS-47 thru DS-49 prior to shipping for third party testing.
- Golder shipped destructs DS-43, DS-44 and DS-47 thru DS-49 to laboratory for testing.
- Golder monitored deployment of 8oz. geotextile.
- Golder observed sewing of all deployed panels on Pond 2.
- Golder observed repairs to damage of geotextile by patch placed over defect by leistering of 8oz. textile patch over defect.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature: 

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Deployment of geotextile in Pond 2, looking east.



Sewing of geotextile panels.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Fusion seaming of geomembrane panels.



Repair using extrusion method.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Vacuum testing of extrusion weld.



Placement of protective cover in Pond 1, looking north.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/2/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1530	
Contractor(s): Ryan Central Inc. Chesapeake	Contractor(s) Rep: John Johnson (Ryan Central) Greg Parrott	

SITE CONDITIONS

Weather (AM): Mostly Cloudy	Temperature: 70
Weather (PM): Overcast	Temperature: 72
Precipitation: Rain	Wind: W, 1-12 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator

- Continued placement of protective cover in Pond 1.
- Rolled liner sub-grade in Pond 2.
- Standby to assist Chesapeake as needed.

Chesapeake – 1 Superintendent, 11 Technicians, 1 operator

- Chesapeake preformed trial welds for fusion prior to seaming.
- Chesapeake preformed seaming using the fusion method.
- Chesapeake preformed air pressure testing of all fusion seams performed today.
- Chesapeake continued vacuum testing of repairs.
- Chesapeake continued deployment of geotextile in Pond 2.
- Chesapeake sewed all panels of geotextile deployed today.
- Chesapeake made repairs to all defects on geotextile panels deployed.
- Chesapeake placed sandbags around the outside edges of all deployed geotextile.
- Chesapeake QC shot panel layout and defects.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of protective cover in Pond 1.
- Golder observed deployment of 40mil geomembrane panels P-33 thru P-38 in Pond 2.
- Golder monitored and documented trial seams for fusion in A.M. preformed prior to start of seaming.
- Golder monitored non-destructive testing of fusion seams completed today by air pressure testing to a minimum of 30psi for 5 minutes with a loss of no more than 4psi in accordance to specifications.
- Golder marked destructive test locations DS-50 thru DS-58 on geomembrane for removal by Chesapeake and destructive field testing onsite.
- Golder monitored vacuum testing of repairs.
- Golder monitored deployment of 8oz. geotextile.
- Golder observed sewing of all deployed panels on Pond 2.
- Golder observed repairs to damage of geotextile by patch placed over defect by leistering of 8oz. textile patch over defect.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

Bi-Weekly progress/construction meeting with CEC, Ryan, Chesapeake and Golder.

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Rolling sub-grade ahead of liner deployment, looking south



Deployment of geomembrane in Pond 2, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Fusion seaming of geomembrane panel seam in Pond 2.



Sewing of geotextile panel seams in Pond 2.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Overview of geosynthetics in Pond 2, looking south



Overview of protective cover in Pond 1, looking north.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/4/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1900
Contractor(s):	Ryan Central Inc. Chesapeake	Contractor(s) Rep:	John Johnson (Ryan Central) Greg Parrott

SITE CONDITIONS

Weather (AM): Mostly Cloudy	Temperature: 58
Weather (PM): Partly Sunny	Temperature: 67
Precipitation: None	Wind: NE, 4-13 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator

- Continued placement of protective cover in Pond 1.
- Rolled liner sub-grade in Pond 2.
- Assist Chesapeake as needed.

Chesapeake – 1 Superintendent, 11 Technicians, 1 operator

- Chesapeake continued deployment of geomembrane in Pond 1.
- Chesapeake preformed trial welds for extrusion before start of repairs.
- Chesapeake preformed trial welds for fusion prior to start of seaming and end of day.
- Chesapeake preformed seaming using the fusion method.
- Chesapeake preformed air pressure testing of fusion seams.
- Chesapeake continued vacuum testing of repairs.
- Chesapeake removed and field tested destructs DS-50 thru DS-58 and DS-44P.
- Chesapeake continued deployment of geotextile in Pond 2.
- Chesapeake sewed all panels of geotextile deployed today.
- Chesapeake made repairs to all defects on geotextile panels deployed.
- Chesapeake placed sandbags around the outside edges of all deployed geotextile.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Chesapeake QC shot panel layout and defects.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of protective cover in Pond 1.
- Golder observed deployment of 40mil geomembrane panels P-39 thru P-44 in Pond 2.
- Golder monitored and documented trial seams for extrusion in A.M. preformed before beginning repairs.
- Golder monitored and documented trial seams for fusion in P.M. preformed prior to start of seaming and end of day.
- Golder observed seaming of all deployed panels on Pond 2 by fusion seaming method using 3 wedges.
- Golder monitored non-destructive testing of fusion seams completed today by air pressure testing to a minimum of 30psi for 5 minutes with a loss of no more than 4psi in accordance to specifications.
- Golder marked destructive test locations DS-59 thru DS-67, DS-44P and DS-44N on geomembrane for removal by Chesapeake and destructive field testing onsite.
- Golder monitored vacuum testing of repairs.
- Golder monitored field testing of destructive samples DS-50 thru DS-58 and Ds-44P, samples sent to lab for further testing.
- Golder monitored deployment of 8oz. geotextile.
- Golder observed sewing of all deployed panels on Pond 2.
- Golder observed repairs to damage of geotextile by patch placed over defect by leistering of 8oz. textile patch over defect.
- Chesapeake installed approximately 100,740sf of geomembrane on Pond 2 today for a total of 700,160sf to date for Ponds 1 and 2.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

Destructive test sample DS-44 on seam 27/28 failed testing in lab, procedures for failing destructive test followed in accordance to specifications with two additional samples being marked for testing to identify the section of seam to be capped. One sample collected previous to failed destructive sample DS-44 and one after.

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



Destructive sample removed for field and lab testing

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Shooting location of destructive sample and prepping patch, looking west



Vacuum testing of extrusion weld on repair patch

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Tracking of failed destructive test seam for capping, looking east



Rolling sub-grade ahead of liner deployment, looking southeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/5/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1700	
Contractor(s): Ryan Central Inc. Chesapeake	Contractor(s) Rep: John Johnson (Ryan Central) Greg Parrott	

SITE CONDITIONS

Weather (AM): Mostly Cloudy	Temperature: 56
Weather (PM): Mostly Cloudy	Temperature: 62
Precipitation: None	Wind: NE, 6-15 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozers; 1-John Deere 9520 Tractor; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator

- Rolled liner sub-grade in Pond 2.
- Assist Chesapeake as needed.
- Demobilized John Deere Tractor.

Chesapeake – 1 Superintendent, 11 Technicians, 1 operator

- Chesapeake completed deployment of geomembrane in Pond 2.
- Chesapeake preformed trial welds for extrusion before start of repairs.
- Chesapeake preformed trial welds for fusion prior to start of seaming and end of day.
- Chesapeake preformed seaming using the fusion method.
- Chesapeake preformed air pressure testing of fusion seams.
- Chesapeake made repairs by the extrusion method.
- Chesapeake removed destruct DS-44N.
- Chesapeake placed sandbags around the outside edges of all deployed panels.
- Chesapeake QC shot panel layout and defects.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder observed deployment of 40mil geomembrane panels P-45 thru P-52 in Pond 2. Geomembrane deployment completed for Ponds 1 and 2.
- Golder monitored and documented trial seams for extrusion in P.M. preformed before beginning repairs.
- Golder monitored and documented trial seams for fusion in A.M., P.M. preformed prior to start of seaming and end of day.
- Golder observed seaming of all deployed panels on Pond 2 by fusion seaming method using 3 wedges.
- Golder monitored non-destructive testing of fusion seams completed today by air pressure testing to a minimum of 30psi for 5 minutes with a loss of no more than 4psi in accordance to specifications.
- Golder marked destructive test locations DS-68 thru DS-77 and DX-2 on geomembrane for removal by Chesapeake and destructive field testing onsite.
- Golder observed repairs by extrusion method.
- Chesapeake installed approximately 90,559sf of geomembrane on Pond 2 today for a total of 790,719sf to date for Ponds 1 and 2.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Rolling sub-grade ahead of liner deployment, looking east




Fusion welding of seam in Pond 2, looking southeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Destruct marked for removal and testing

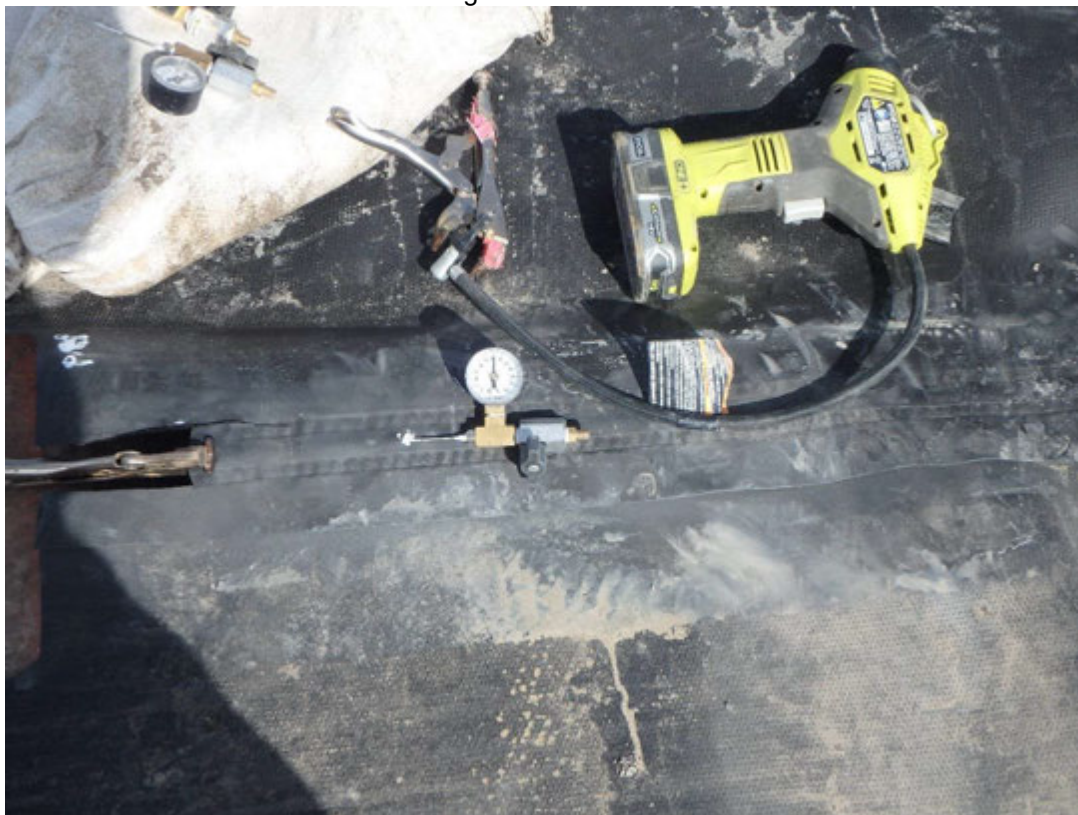

Air pressure testing of fusion seam

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Welding cap over failed seam by extrusion method



Overview of Pond 2, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/7/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1930
Contractor(s):	Ryan Central Inc. Chesapeake	Contractor(s) Rep:	John Johnson (Ryan Central) Greg Parrott

SITE CONDITIONS	
Weather (AM): Mostly Cloudy	Temperature: 58
Weather (PM): Mostly Sunny	Temperature: 67
Precipitation: None	Wind: W, 0-8 mph

EQUIPMENT ON SITE
1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 326F Excavator; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 1 Operator, 2 Laborers
<ul style="list-style-type: none">• Protective cover import.• Placed protective cover in Ponds 1 and 2.• Assist Chesapeake as needed.• Demobilized Cat 815 Compactor.
Chesapeake – 1 Superintendent, 11 Technicians, 1 operator
<ul style="list-style-type: none">• Chesapeake preformed trial welds for extrusion before start of repairs.• Chesapeake preformed air pressure testing of fusion seams.• Chesapeake continued vacuum testing of repairs.• Chesapeake removed and field tested destructs DS-59 thru DS-77, DS-44N, DX-2 and DX-3.• Chesapeake continued deployment of geotextile in Pond 2.• Chesapeake sewed panels of geotextile deployed today.• Chesapeake made repairs to defects on geotextile panels deployed.• Chesapeake placed sandbags around the outside edges of all deployed geotextile.• Chesapeake QC shot panel layout and defects.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder onsite documenting the construction progress.
- Golder observed import and placement of Protective cover to Ponds 1 and 2.
- Golder monitored and documented trial seams for extrusion in A.M. and P.M. performed before beginning repairs.
- Golder monitored non-destructive testing of fusion seams completed today by air pressure testing to a minimum of 30psi for 5 minutes with a loss of no more than 4psi in accordance to specifications.
- Golder monitored field destructive tests for DS-59 thru DS-77, DS-44N, DX-2 and DX-3 removed by Chesapeake.
- Golder observed deployment of geotextile in Pond 2.
- Golder observed sewing of geotextile seams.
- Golder observed repairs by extrusion method.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Air pressure testing of fusion seam in Pond 2



Import of protective cover in Pond 2, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Leistering patch in preparation of extrusion welding



Deploying geotextile in Pond 2, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Sewing of geotextile seam in Pond 2, looking north



CEC observing field test of destructive sample

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/8/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1630	
Contractor(s): Ryan Central Inc. Chesapeake	Contractor(s) Rep: John Johnson (Ryan Central) Greg Parrott	

SITE CONDITIONS

Weather (AM): Sunny	Temperature: 45
Weather (PM): Sunny	Temperature: 68
Precipitation: None	Wind: W, 0-6 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator, 2 Laborers

- Protective cover import.
- Placed protective cover in Pond 2.
- Finish grading of protective cover in Pond 1.
- Assist Chesapeake as needed.
- Demobilized Cat 326F Excavator.

Chesapeake – 1 Superintendent, 11 Technicians, 1 operator

- Chesapeake completed deployment of geotextile in Pond 2.
- Chesapeake sewed all panels of geotextile.
- Chesapeake made repairs to defects on geotextile panels deployed.
- Chesapeake placed sandbags around the outside edges of all deployed geotextile.
- Chesapeake of the Pond 2 work area.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed import and placement of Protective cover to Pond 2.
- Golder observed finish grading of protective cover in Pond 1.
- Golder observed deployment of geotextile in Pond 2.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder observed sewing of geotextile seams.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



Sewing textile seam in Pond 2

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Above-Cap drain pipe installed in Pond 2



Finish grading of protective cover in Pond 1, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Deployment of geotextile in Pond 2, looking north



Overview of protective cover in Pond 1, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/9/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1930
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Sunny	Temperature: 45
Weather (PM): Sunny	Temperature: 67
Precipitation: None	Wind: E, 1-6 mph

EQUIPMENT ON SITE
1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-John Deere 644G Loader; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer; 1-JLG 10054 Sky-Trak.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 2 Operator, 2 Laborers
<ul style="list-style-type: none">• Protective cover import to Pond 2.• Placed protective cover in Pond 2.• Finish grading of protective cover in Pond 1.• Topsoil import to Pond 1.• Placed topsoil in Pond 1.• Continued install of the above-cap drain pipe in Pond 2.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder observed import and placement of Protective cover to Pond 2.• Golder observed finish grading of protective cover in Pond 1.• Golder observed import and placement of topsoil to Pond 1.• Golder observed installation of the above-cap drain pipe in Pond 2.• Golder observed surveyor from Rowe shoot protective cover in Pond 1, liner limits and the placed above-cap drain pipe in Pond 2.

SUMMARY OF SURVEYOR'S ACTIVITIES
Rowe surveyor shot protective cover in Pond 1, edge of liner placed in Pond 2 and above-cap drain pipe installed in Pond 2.

SUMMARY OF PROBLEMS AND RESOLUTIONS
None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Placing protective cover in Pond 2, looking west

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Import of protective cover to Pond 2, looking north



Rowe shooting protective cover placed in Pond 1, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

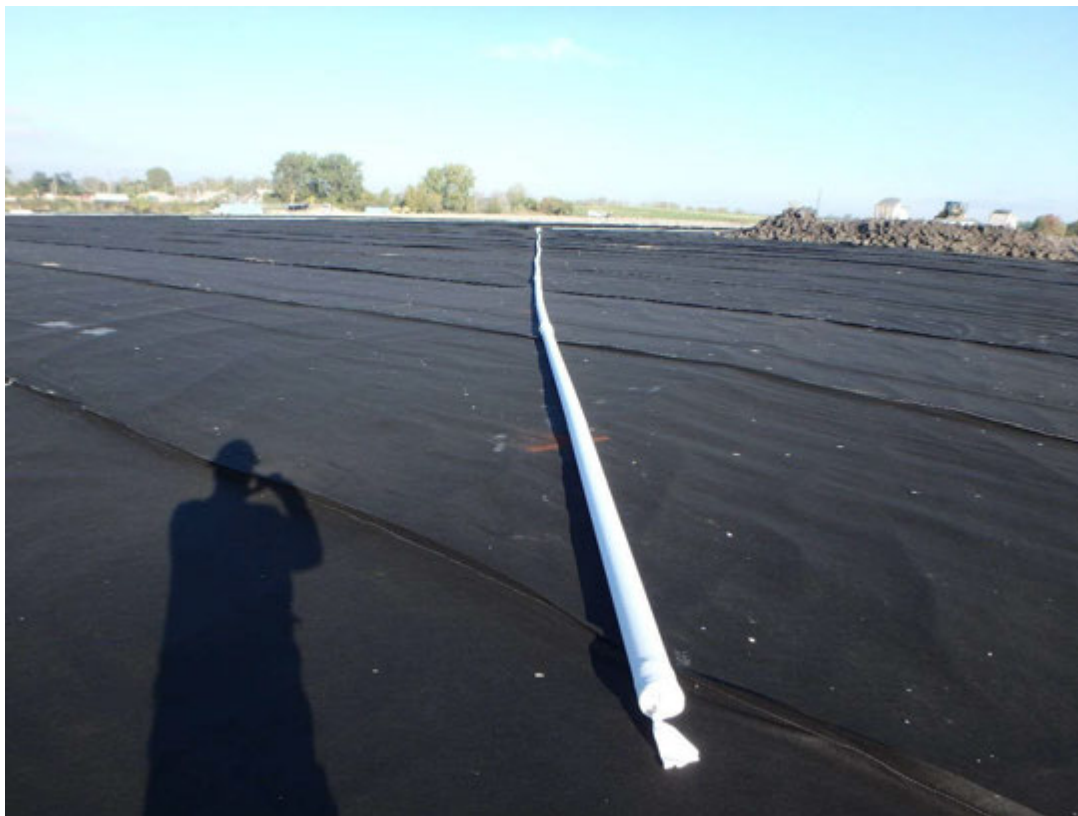

Above-cap drain pipe installed in Pond 2, looking northwest



First load of topsoil received and placed in Pond 1, looking northwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/10/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1530	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Mostly Sunny	Temperature: 50
Weather (PM): Mostly Sunny	Temperature: 70
Precipitation: None	Wind: E, 3-12 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 1 Operator, 1 Laborer

- Protective cover import to Pond 2.
- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Placed topsoil in Pond 1.
- Continued install of the above-cap drain pipe in Pond 2.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed import and placement of Protective cover to Pond 2.
- Golder observed import and placement of topsoil to Pond 1.
- Golder observed installation of the above-cap drain pipe in Pond 2.
- Golder collected protective cover samples PC-13 and PC-14 from imported material.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Placing protective cover in Pond 2, looking northeast



Above-Cap drain pipe with sock

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Above-cap drain pipe installed in Pond 2, looking northwest



Overview of Pond 2, looking southeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/11/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 1030/1400	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Overcast	Temperature: 60
Weather (PM): Overcast	Temperature: 66
Precipitation: Rain	Wind: W, 2-6 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 1 Operator, 1 Laborer

- Protective cover import to Pond 2.
- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Shut down due to rain.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed import and placement of Protective cover to Pond 2.
- Golder observed import of topsoil to Pond 1.
- Golder observed Rowe surveyor shoot remaining Pond 2 above-cap drain pipe not already surveyed.
- Golder shipped protective cover samples PC-9 and PC-14 from imported material to lab for sieve analysis.

SUMMARY OF SURVEYOR'S ACTIVITIES

Rowe onsite, shot remaining above-cap drain pipe for Pond 2.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson

Signature:

PHOTOGRAPHS



Import and placement of protective cover in Pond 2, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Overview Pond 2 , looking east



Overview Pond 2, looking northwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/14/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1530
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Mostly Cloudy	Temperature: 45
Weather (PM): Partly Sunny	Temperature: 63
Precipitation: None	Wind: NW, 5-10 mph

EQUIPMENT ON SITE
1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite: Ryan Central -1 Foreman, 1 Operator, 1 Laborer <ul style="list-style-type: none">• Protective cover import to Pond 2.• Placed protective cover in Pond 1 and Pond 2.• Topsoil import to Pond 1.• Placed topsoil in Pond 1.
GAI CQA ACTIVITIES AND TEST RESULTS
Construction: <ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder observed import of Protective cover to Pond 2.• Golder observed placement of protective cover in Pond 1 and Pond 2.• Golder observed import of topsoil to Pond 1.• Golder observed placement of topsoil in Pond 1.

SUMMARY OF SURVEYOR'S ACTIVITIES
None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



Import of protective cover to Pond 2, looking southwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Placement of protective cover east side of Pond 2



Overview Pond 2, looking southwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/15/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1230	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Mostly Sunny	Temperature: 37
Weather (PM): Mostly Sunny	Temperature: 52
Precipitation: None	Wind: NW, 3-9 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator, 1 Laborer

- Protective cover import to Pond 2.
- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Placed topsoil in Pond 1.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed import of Protective cover to Pond 2.
- Golder observed placement of protective cover in Pond 1 and Pond 2.
- Golder observed import of topsoil to Pond 1.
- Golder observed placement of topsoil in Pond 1.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Placement of protective cover in Pond 2, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Overview of Pond 2's southeast corner, looking north



Overview from Pond 2's southwest corner, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/16/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1630	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Cloudy	Temperature: 50
Weather (PM): Cloudy	Temperature: 52
Precipitation: Rain	Wind: W, 10-22 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator, 1 Laborer

- Protective cover import to Pond 2.
- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Placed topsoil in Pond 1.
- Class II sand import for access road.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed import of Protective cover to Pond 2.
- Golder observed placement of protective cover in Pond 1 and Pond 2.
- Golder observed import of topsoil to Pond 1.
- Golder observed placement of topsoil in Pond 1.
- Golder observed import of Class II sand for access road.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)


Bi-Weekly construction meeting with CEC, Ryan and Golder.

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature: 

PHOTOGRAPHS



23A imported stone for access road placed atop 10 oz. textile in chemical ponds, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Class II sand imported for access road, looking north from southeast corner of Pond 2



Overview of Pond 2, looking south from Pond 1

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/17/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1630	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Mostly Sunny	Temperature: 43
Weather (PM): Mostly Cloudy	Temperature: 54
Precipitation: None	Wind: NW, 3-10 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operator, 1 Laborer

- Protective cover import to Pond 2.
- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Placed topsoil in Pond 1.
- Class II sand import for access road.
- Placed class II sand on east access road.
- Compacted class II sand using smooth drum roller.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed import of Protective cover to Pond 2.
- Golder monitored placement of protective cover in Pond 2 in single 18 inch lift using GPS dozer.
- Golder observed import of topsoil to Pond 1, material stockpiled along western edge of Pond 1.
- Golder observed import of Class II sand for access road.
- Golder monitored placement of Class II sand along east access road (see attached lift/test map) in single 12 inch lift and compacted using a Cat CS56B smooth drum roller.
- Golder performed Standard test on Troxler 3440 prior to density testing.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Performed density test's SBDT-1 thru SBDT-3 on 12-inch compacted class II fill lift 1 placed along east access road east of Pond 2 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested class II fill met all specifications.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



Protective cover import to Pond 2, looking southwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Class II sand imported for access road, looking east from Pond 2



Topsoil placed in Pond 1, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Performing standard on nuclear density gauge prior to testing, looking east



Density test of class II sand placed and compacted for east access road, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

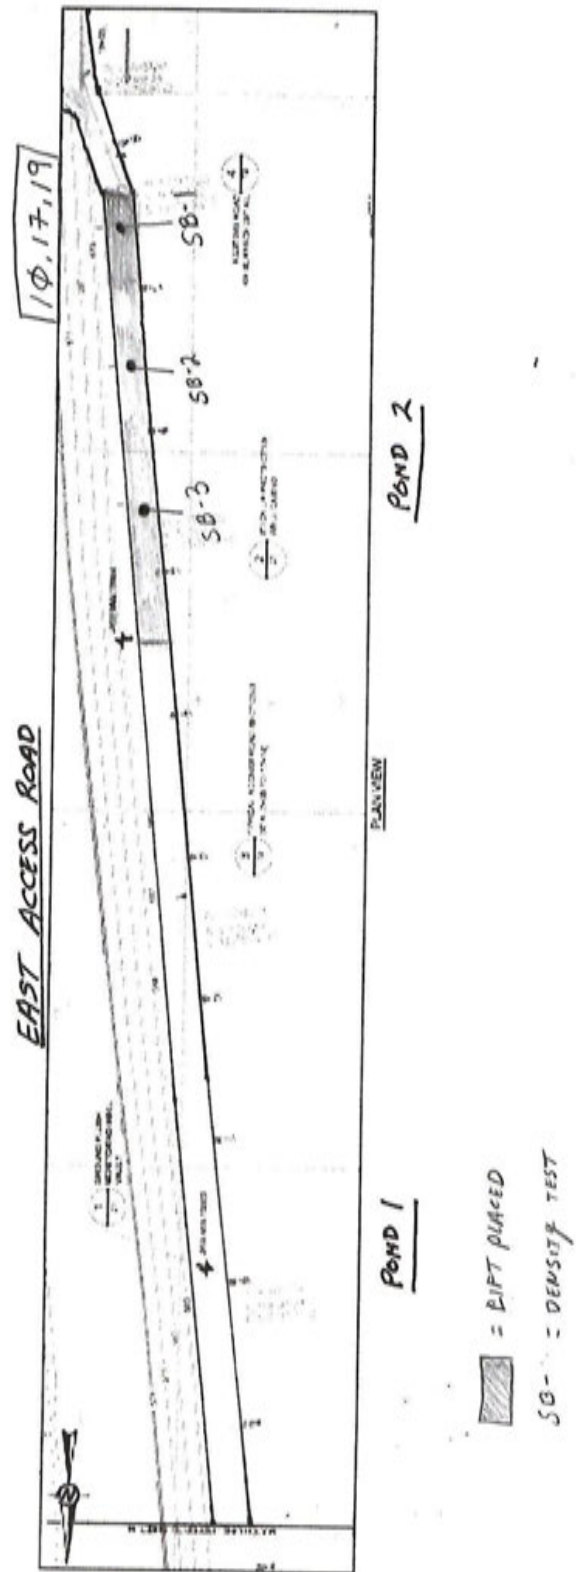

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/18/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0630/1230	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Sunny	Temperature: 37
Weather (PM): Sunny	Temperature: 42
Precipitation: None	Wind: NW, 2-7 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 1 Operator, 1 Laborer

- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Placed topsoil in Pond 1.
- Class II sand import for access road.
- Placed class II sand on east access road.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder monitored placement of protective cover in Pond 2 in single 18 inch lift using GPS dozer.
- Golder observed import of topsoil to Pond 1, material stockpiled along western edge of Pond 1.
- Golder observed import of Class II sand for access road.
- Golder monitored placement of Class II sand along east access road (see attached lift/test map) in single 12 inch lift and compacted using a Cat CS56B smooth drum roller.
- Golder performed Standard test on Troxler 3440 prior to density testing.
- Performed density test's SBDT-4 and SBDT-5 on 12-inch compacted class II fill lift 1 placed along east access road east of Pond 2 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested class II fill met all specifications.

SUMMARY OF SURVEYOR'S ACTIVITIES

None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Class II placed for east access road sub-base east of Pond 2, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Protective cover placed along east side of Pond's 1 and 2, looking north



Overview of protective cover in Pond 2, looking southwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

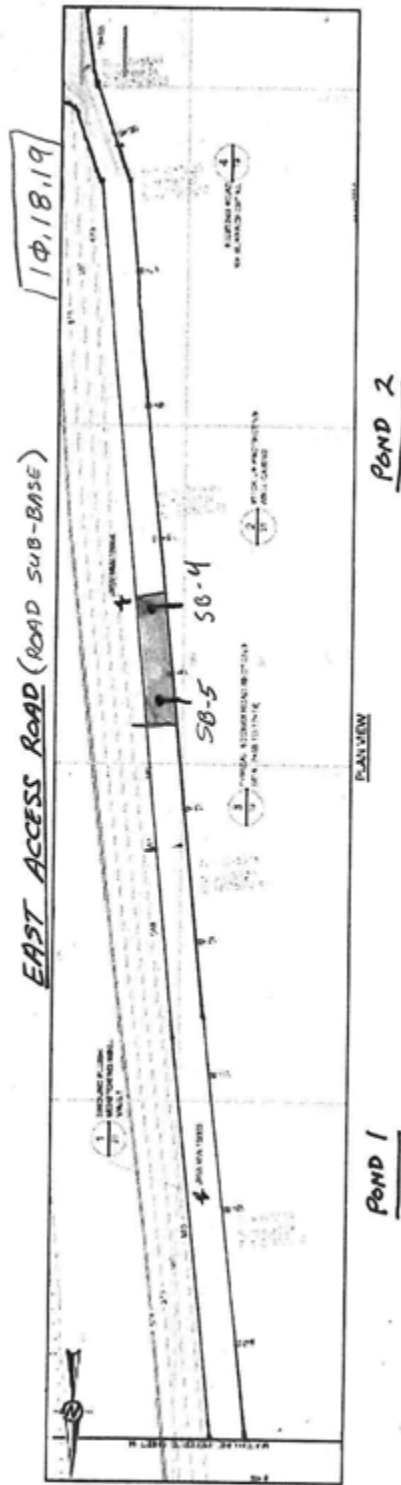

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/21/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1430
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS

Weather (AM): Mostly Cloudy	Temperature: 53
Weather (PM): Cloudy	Temperature: 60
Precipitation: None	Wind: NE, 4-15 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer; 1-Cat 326F Excavator.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 1 Operator, 1 Laborer

- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Placed topsoil in Pond 1.
- Class II sand import for access road sub-base.
- Placed class II sand on east access road.
- Mobilized Cat 326F Excavator.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder monitored placement of protective cover in Pond 2 in single 18 inch lift using GPS dozer.
- Golder observed import of topsoil to Pond 1, material being pushed in 3 foot lift for haul road from the western edge of Pond 1.
- Golder observed import of Class II sand for access road sub-base layer.
- Golder monitored placement of Class II sand along east access road (see attached lift/test map) in single 12 inch lift.
- Golder performed Standard test on Troxler 3440 prior to density testing.
- Performed density test's SBDT-6 and SBDT-7 on 12-inch compacted class II fill lift 1 placed along east access road east of Pond 2 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested class II fill met all specifications for road sub-base.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



Placement of protective cover over Pond 2 geosynthetics, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




East access road sub-base, looking south



Import of protective cover to Pond 2, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

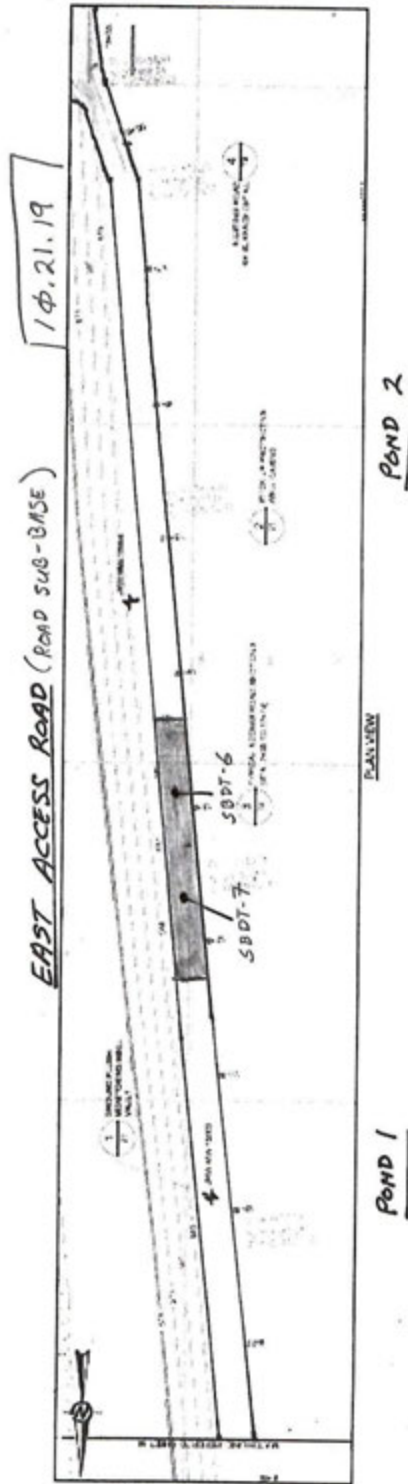

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/22/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1430
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Sunny	Temperature: 52
Weather (PM): Mostly Cloudy	Temperature: 57
Precipitation: None	Wind: W, 3-20 mph

EQUIPMENT ON SITE
1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer; 1-Cat 326F Excavator.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 1 Operator, 1 Laborer
<ul style="list-style-type: none">• Protective cover import to Pond 2.• Placed protective cover in Pond 2.• Topsoil import to Pond 1.• Placed topsoil in Pond 1.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder monitored placement of protective cover in Pond 2 in single 18 inch lift using GPS dozer.• Golder observed import of topsoil to Pond 1, material being pushed in 3 foot lift for haul road from the western edge of Pond 1.

SUMMARY OF SURVEYOR'S ACTIVITIES
None

SUMMARY OF PROBLEMS AND RESOLUTIONS
None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Resurfacing of access road to chemical ponds, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



East access road sub-base, looking north



Building topsoil haul road in Pond 1, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/23/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1430
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Mostly Sunny	Temperature: 43
Weather (PM): Mostly Sunny	Temperature: 50
Precipitation: None	Wind: W, 4-22 mph

EQUIPMENT ON SITE
1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer; 1-Cat 326F Excavator.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 1 Operator, 1 Laborer
<ul style="list-style-type: none">• Protective cover import to Pond 2.• Placed protective cover in Pond 2.• Topsoil import to Pond 1.• Placed topsoil in Pond 1.• Road base import and placement for east access road.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder monitored placement of protective cover in Pond 2 in single 18 inch lift using GPS dozer.• Golder observed import of topsoil to Pond 1, material being pushed in 3 foot lift for haul road from the western edge of Pond 1.• Golder observed deployment of 10oz textile above east access road sub-base.• Golder observed import of 23A stone for access road base, material placed in single 10 inch loose lift atop of the 10oz textile along the east access road. No compaction or testing done.

SUMMARY OF SURVEYOR'S ACTIVITIES
None

SUMMARY OF PROBLEMS AND RESOLUTIONS
None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



Placement of protective cover in Pond 2, looking northwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Overview of remaining area of Pond 2 to be covered with protective cover, looking southwest



Road base placed for east access road, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

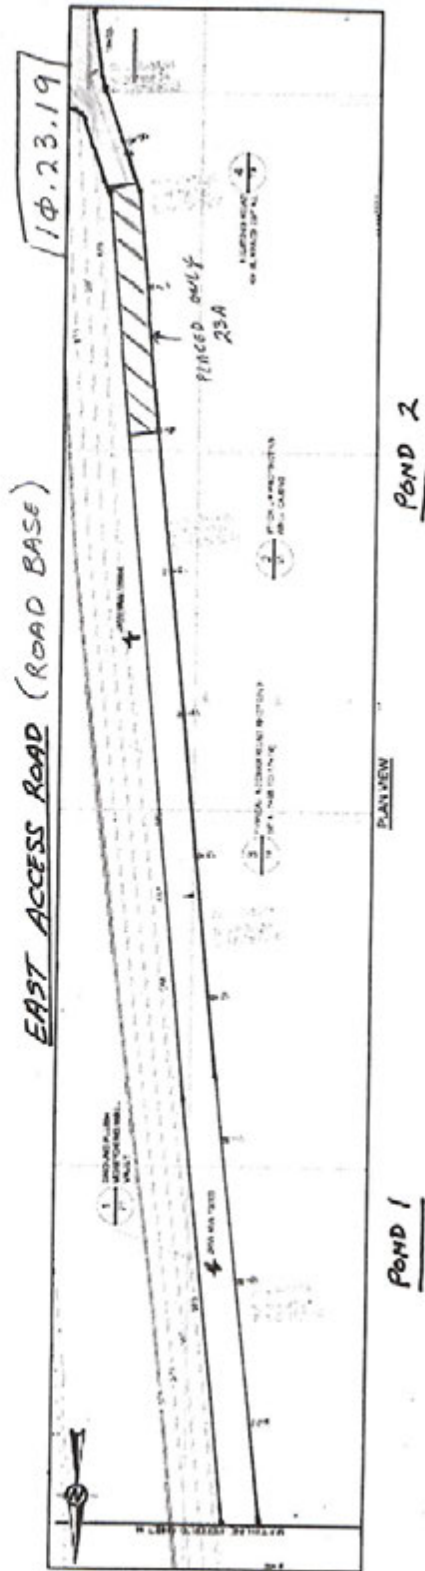

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/24/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1430
Contractor(s):	Ryan Central Inc. Rowe	Contractor(s) Rep:	John Johnson (Ryan Central) Will Smith (Rowe)

SITE CONDITIONS

Weather (AM): Partly Sunny	Temperature: 54
Weather (PM): Mostly Cloudy	Temperature: 58
Precipitation: None	Wind: W, 5-12 mph

EQUIPMENT ON SITE

1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer; 1-Cat 326F Excavator.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 1 Operator, 1 Laborer

- Protective cover import to Pond 2.
- Placed protective cover in Pond 2.
- Topsoil import to Pond 1.
- Placed topsoil in Pond 1.
- Road base import and placement for east access road.
- Road sub-base import and placement for east access road.
- Cut and removed 15 foot section of 24 inch steel pipe in discharge channel.
- Demobilized Cat 326F Excavator.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder monitored placement of protective cover in Pond 2 in single 18 inch lift using GPS dozer.
- Golder observed import of topsoil to Pond 1, material being pushed in 3 foot lift for haul road from the western edge of Pond 1.
- Golder observed deployment of 10oz textile on east access road for placement of road sub-base and road base material.
- Golder monitored placement of Class II sand along east access road (see attached lift/test map) in single 12 inch lift.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder observed import of 23A stone for access road base (see attached lift/test map), material placed in single 10 inch loose lift atop of the 10oz textile along the east access road. No compaction or testing done.
- Golder performed Standard test on Troxler 3440 prior to density testing.
- Performed density test's SBDT-8 thru SBDT-10 on 12-inch compacted class II fill lift 1 placed along east access road east of Pond 2 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested class II fill met all specifications for road sub-base.
- Golder observed cutting and removal of a 15 foot section of 24 inch steel pipe located in discharge channel (see attached map for location).

SUMMARY OF SURVEYOR'S ACTIVITIES

Rowe shot protective cover in Pond 2.

SUMMARY OF PROBLEMS AND RESOLUTIONS

Unidentified 24 inch steel pipe found running from the northeast corner of the discharge channel toward the north (see attached map). Pipe was found due to water level in discharge channel dropping and fully exposing the pipe. Ryan cut off and removed the section of pipe exposed, section removed was approximately 15 feet in length. Tom Shields with CEC was asked how they wanted to deal with the remaining pipe running north, Tom told Ryan to place sandbags into the pipe and install a 4 to 6 inch grout cap.

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



Topsoil import to Pond 1, looking northeast



24 inch steel pipe discovered in the northeast corner of the discharge channel, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Cutting 24 inch pipe into discharge channel for removal, looking south




End of 24 inch pipe from discharge channel to be capped, looking west

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

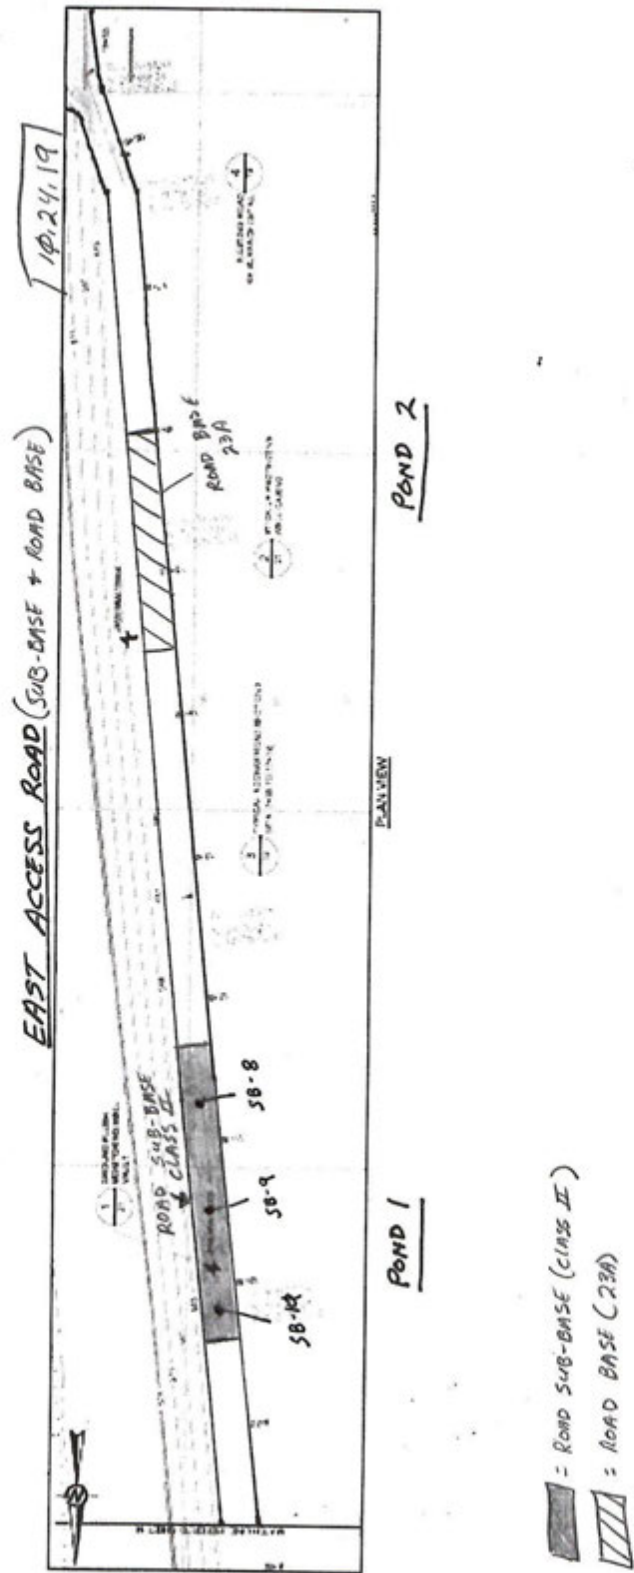

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

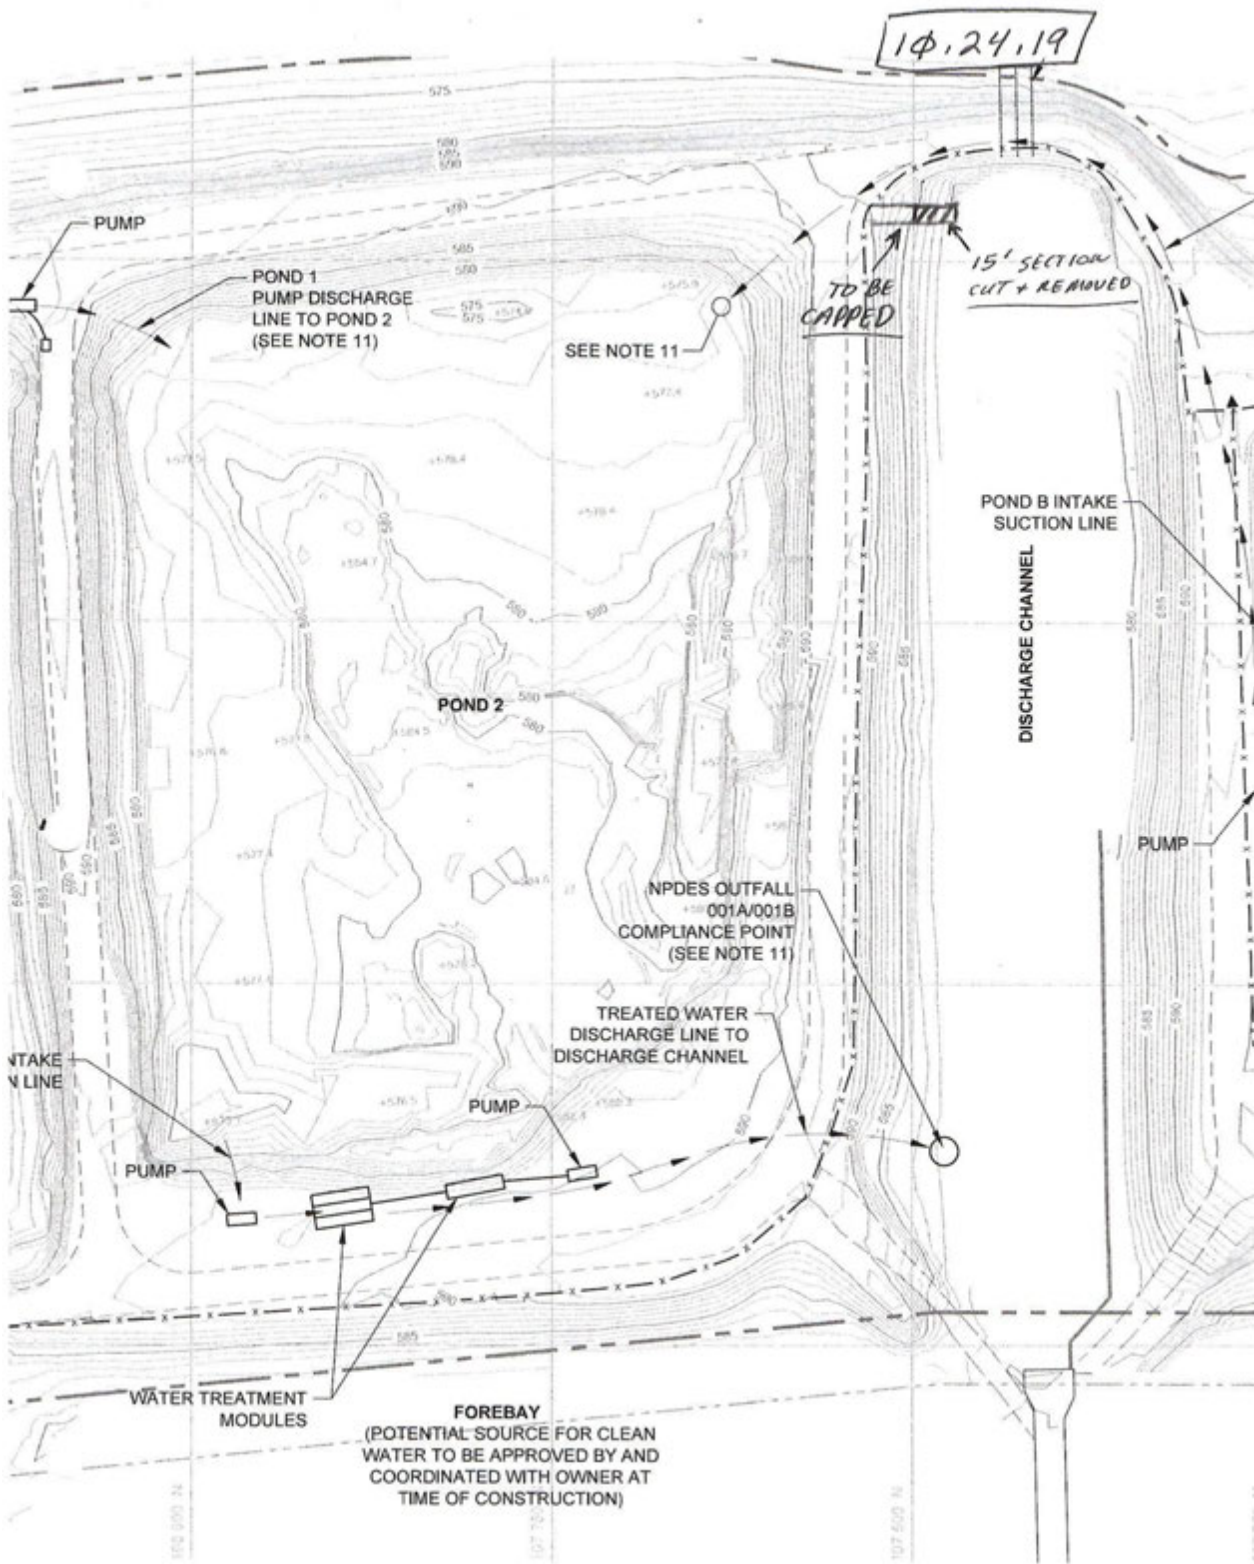

Location of 24 inch steel pipe found in discharge channel

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/25/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1830
Contractor(s):	Ryan Central Inc. Rowe	Contractor(s) Rep:	John Johnson (Ryan Central) Will Smith (Rowe)

SITE CONDITIONS	
Weather (AM): Cloudy	Temperature: 46
Weather (PM): Cloudy	Temperature: 52
Precipitation: None	Wind: E, 3-9 mph

EQUIPMENT ON SITE
1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 1 Operator, 1 Laborer
<ul style="list-style-type: none">• Protective cover import to Pond 2.• Placed protective cover in Pond 2.• Topsoil import to Pond 1.• Placed topsoil in Pond 1.• Road base import and placement for east access road.• Road sub-base import and placement for east access road.• Capped 24 inch steel pipe in discharge channel.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder monitored placement of protective cover in Pond 2 in single 18 inch lift using GPS dozer.• Golder observed import of topsoil to Pond 1, material being pushed in 3 foot lift for haul road from the western edge of Pond 1.• Golder observed deployment of 10oz textile on east access road for placement of road sub-base and road base material.• Golder monitored placement of Class II sand along east access road (see attached lift/test map) in single 12 inch lift.• Golder observed import of 23A stone for access road base (see attached lift/test map), material placed in single 10 inch loose lift atop of the 10oz textile along the east access road. No compaction or testing done.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder performed Standard test on Troxler 3440 prior to density testing.
- Performed density test's SBDT-11 thru SBDT-13 on 12-inch compacted class II fill lift 1 placed along east access road east of Pond 2 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested class II fill met all specifications for road sub-base.
- Golder monitored capping of 24 inch steel pipe in discharge channel. Ryan placed sandbags to fill pipe starting 6 inches back from open end then installed a 6 inch cap using grout.

SUMMARY OF SURVEYOR'S ACTIVITIES

Rowe shot protective cover in Pond 2.

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PHOTOGRAPHS



East access road, looking north



Sandbags placed in 24 inch steel pipe being capped

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Grout being placed to cap 24 inch steel pipe




Finished 24 inch pipe cap

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

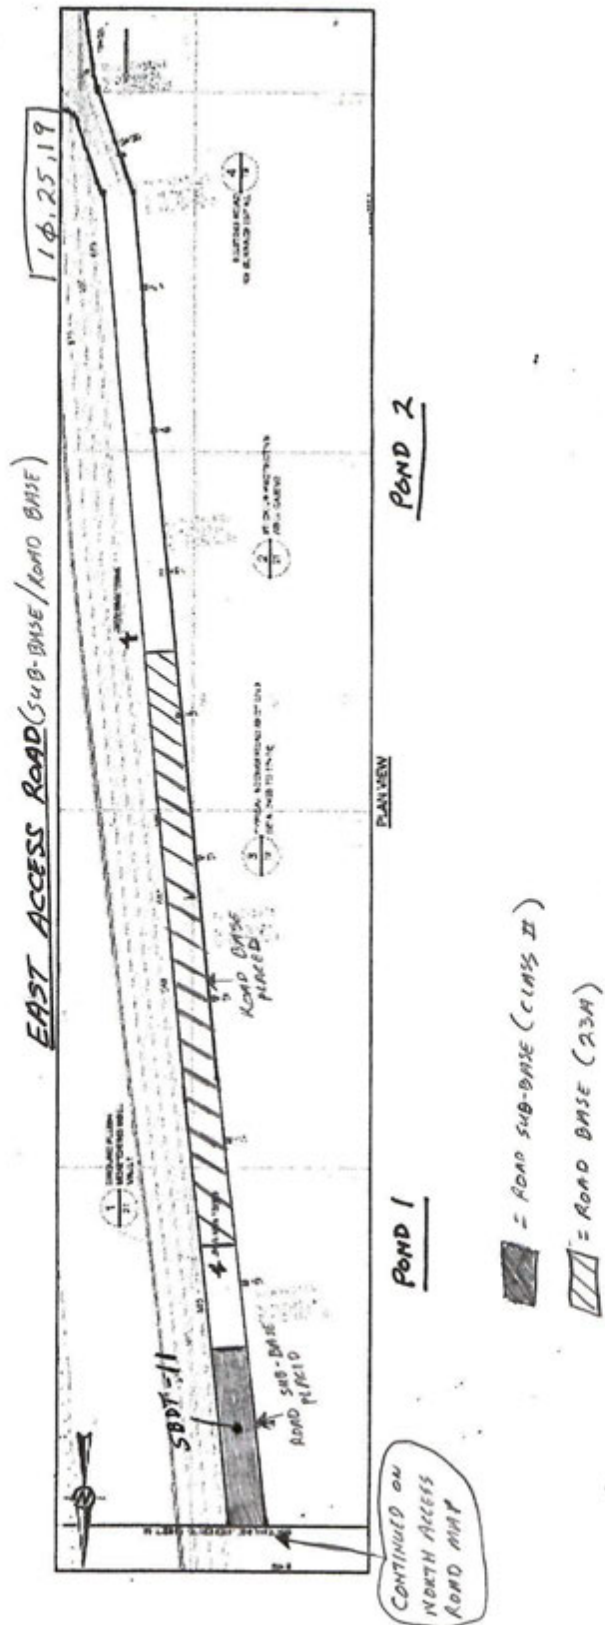

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

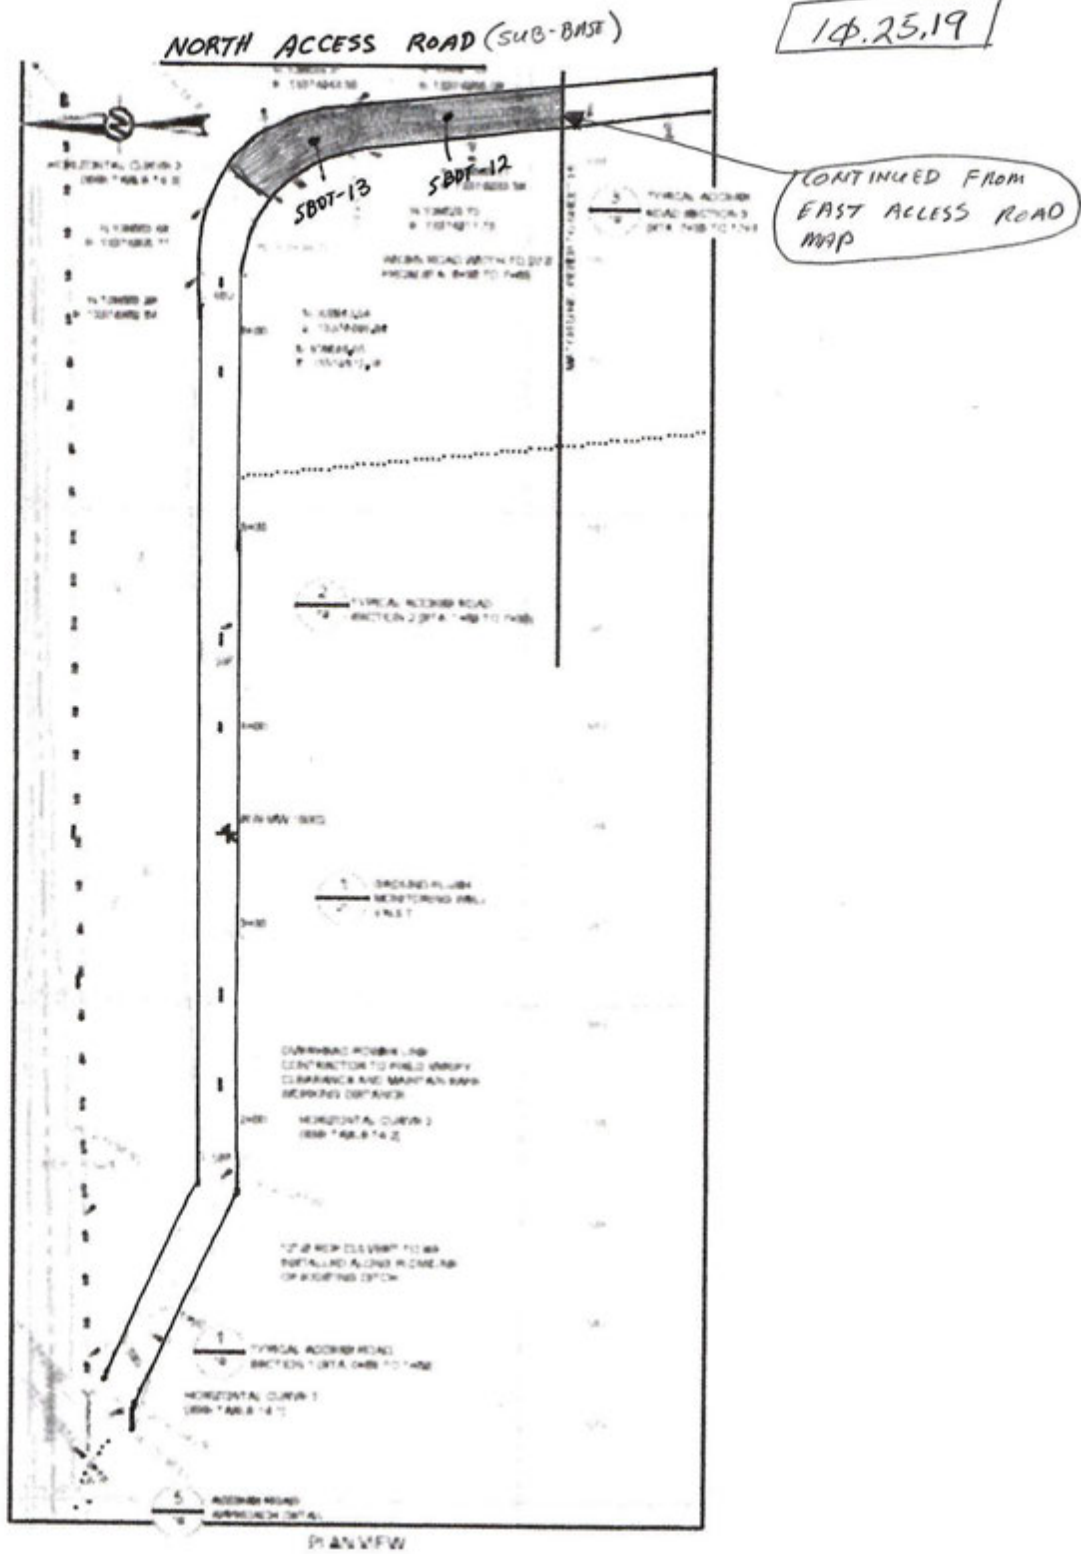

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 10/29/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0630/1530
Contractor(s):	Ryan Central Inc. Rowe	Contractor(s) Rep:	John Johnson (Ryan Central) Will Smith (Rowe)

SITE CONDITIONS	
Weather (AM): Sunny	Temperature: 50
Weather (PM): Mostly Cloudy	Temperature: 58
Precipitation: None	Wind: S, 1-8 mph

EQUIPMENT ON SITE
1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 1 Operator, 1 Laborer
<ul style="list-style-type: none"> • Topsoil import to Pond 1. • Placed topsoil in Pond 1. • Road sub-base import and placement for east access road.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none"> • Golder onsite documenting the construction progress. • Golder observed import of topsoil to Pond 1, material being pushed in 3 foot lift for haul road from the western edge of Pond 1. • Golder observed import of Class II sand for the access road, material stockpiled outside Pond 1's northeast corner. • Golder performed Standard test on Troxler 3440 prior to density testing. • Performed density test's RBDT-1 thru RBDT-9 on 12-inch compacted lift of 23A along east access road east of Pond's 1 and 2 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested 23A fill met all specifications for road sub-base. • Golder collected samples PC-15 thru PC-18 from protective cover for grain size analysis and classification. • Golder observed Young Environmental cleaning Frack Tank for removal.

SUMMARY OF SURVEYOR'S ACTIVITIES
Rowe shot protective cover in Pond's 1 and 2.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



Import of topsoil to Pond 1, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Standard test of Troxler prior to testing



Rowe set-up for survey of protective cover, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

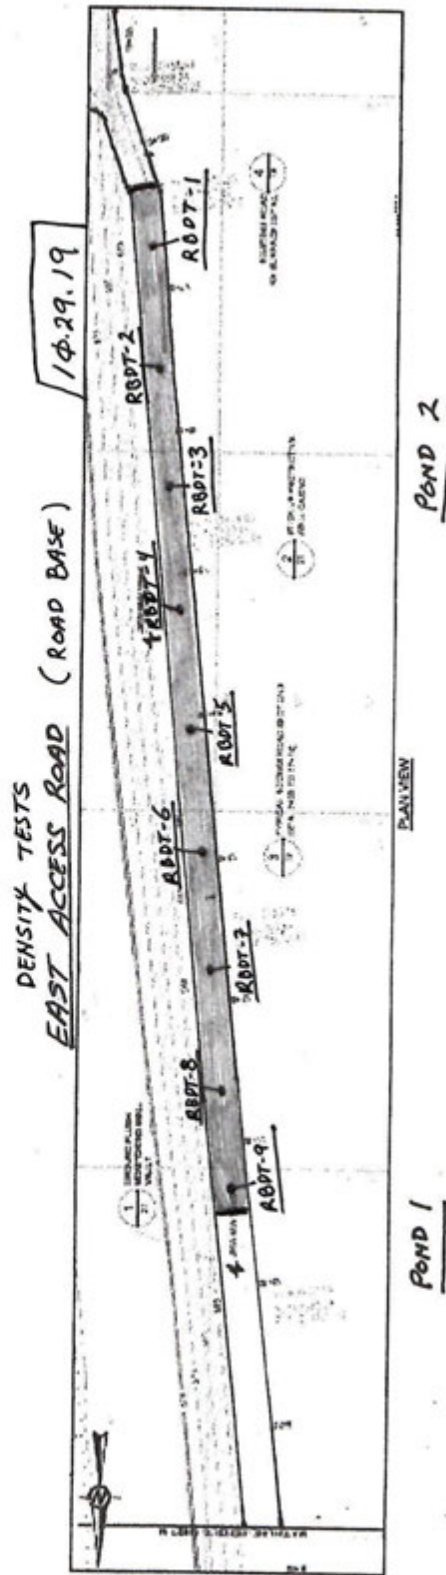

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/05/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0900/1600
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Partly Cloudy	Temperature: 44
Weather (PM): Partly Sunny	Temperature: 52
Precipitation: None	Wind: NW, 5-12 mph

EQUIPMENT ON SITE
1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 2 Operator, 1 Laborer
<ul style="list-style-type: none">• Topsoil import to Pond's 1 and 2.• Placed topsoil in Pond's 1 and 2.• Road sub-base import and placement for north access road.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder observed import of topsoil to Pond's 1 and 2, material being placed in 6 inch lift from the western edge of Pond's 1 and 2.• Golder observed import of Class II sand for the access road, material placed on north access road in single 12 inch lift.• Golder performed Standard test on Troxler 3440 prior to density testing.• Performed density test's SBDT-14 thru SBDT-22 on 12-inch compacted lift of Class II/III sand along north access road north of Pond 1 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested Class II/III fill met all specifications for road sub-base.• Golder observed Young Environmental cleaning Frack Tank for removal.

SUMMARY OF SURVEYOR'S ACTIVITIES
None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature: 
--

PHOTOGRAPHS



Import of Class II/III sand for north access road sub-base, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Overview of completed north access road sub-base, looking east



Density testing of north access road sub-base, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

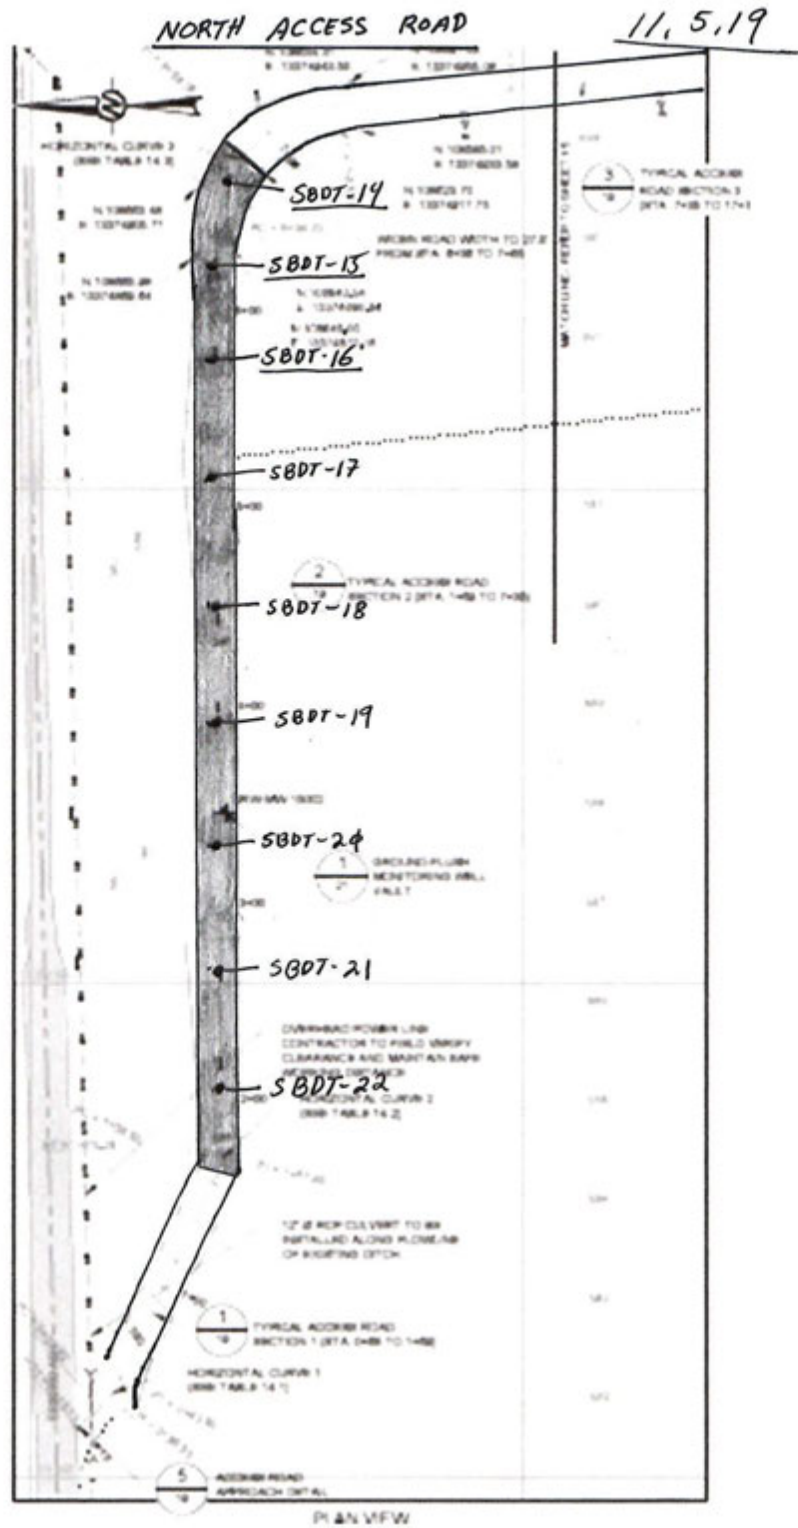

Lift/Density Test Map

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/08/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0700/1330
Contractor(s):	Ryan Central Inc. Rowe	Contractor(s) Rep:	John Johnson (Ryan Central) Will Smith (Rowe)

SITE CONDITIONS	
Weather (AM): Sunny	Temperature: 24
Weather (PM): Sunny	Temperature: 37
Precipitation: None	Wind: NW, 6-15 mph

EQUIPMENT ON SITE
1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 3 Operator, 1 Laborer
<ul style="list-style-type: none">• Topsoil import to Pond's 1 and 2.• Placed topsoil in Pond's 1 and 2.• Road base import and placement for north access road.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder observed import of topsoil to Pond's 1 and 2, material being placed in 6 inch lift from the western edge of Pond's 1 and 2.• Golder observed import of 23A for the north access road, material placed on north access road in single 12 inch lift.

SUMMARY OF SURVEYOR'S ACTIVITIES
Shot topsoil of Pond 1 in limited area of western half of pond ready

SUMMARY OF PROBLEMS AND RESOLUTIONS
None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Rowe shooting cert points in Pond 1, looking north

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Placement of topsoil in Pond 2, looking south



Overview of topsoil placement in Pond 1, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/13/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0930/1430
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS	
Weather (AM): Cloudy	Temperature: 24
Weather (PM): Cloudy	Temperature: 25
Precipitation: None	Wind: NE, 5-9 mph

EQUIPMENT ON SITE
1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 3 Operator, 1 Laborer
<ul style="list-style-type: none">Placed topsoil in Pond's 1 and 2.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">Golder onsite documenting the construction progress.Golder observed placement of topsoil in Pond's 1 and 2, material being placed in 6 inch lift from the western edge of Pond's 1 and 2.Golder performed Standard test on Troxler 3440 prior to density testing.Performed density test's RBDT-10 thru RBDT-25 on 12-inch compacted lift of 23A road base along the east and north access roads of Pond 1 using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested 23A fill met all specifications for road base material.

SUMMARY OF SURVEYOR'S ACTIVITIES
None

SUMMARY OF PROBLEMS AND RESOLUTIONS
None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
Bi-Weekly construction meeting with CEC, Ryan and Golder.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Placement of topsoil along east side of Ponds 1 and 2, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Overview of topsoil placed in Pond's 1 and 2, looking southwest




Density testing of road base material for north access road, looking east

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

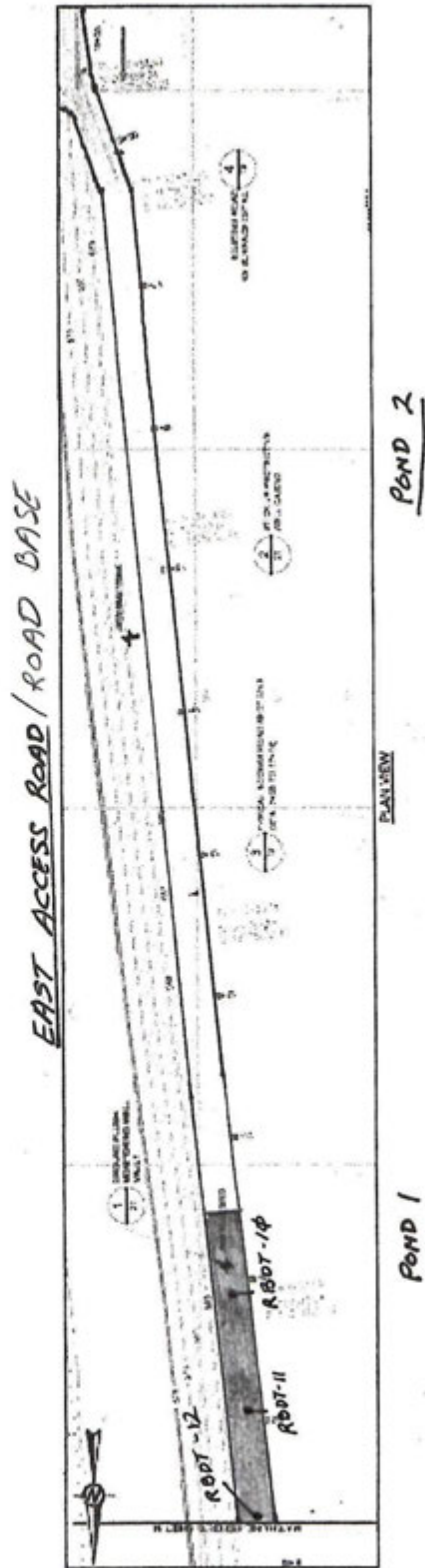

Road Base Density Test Map 1 of 2

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

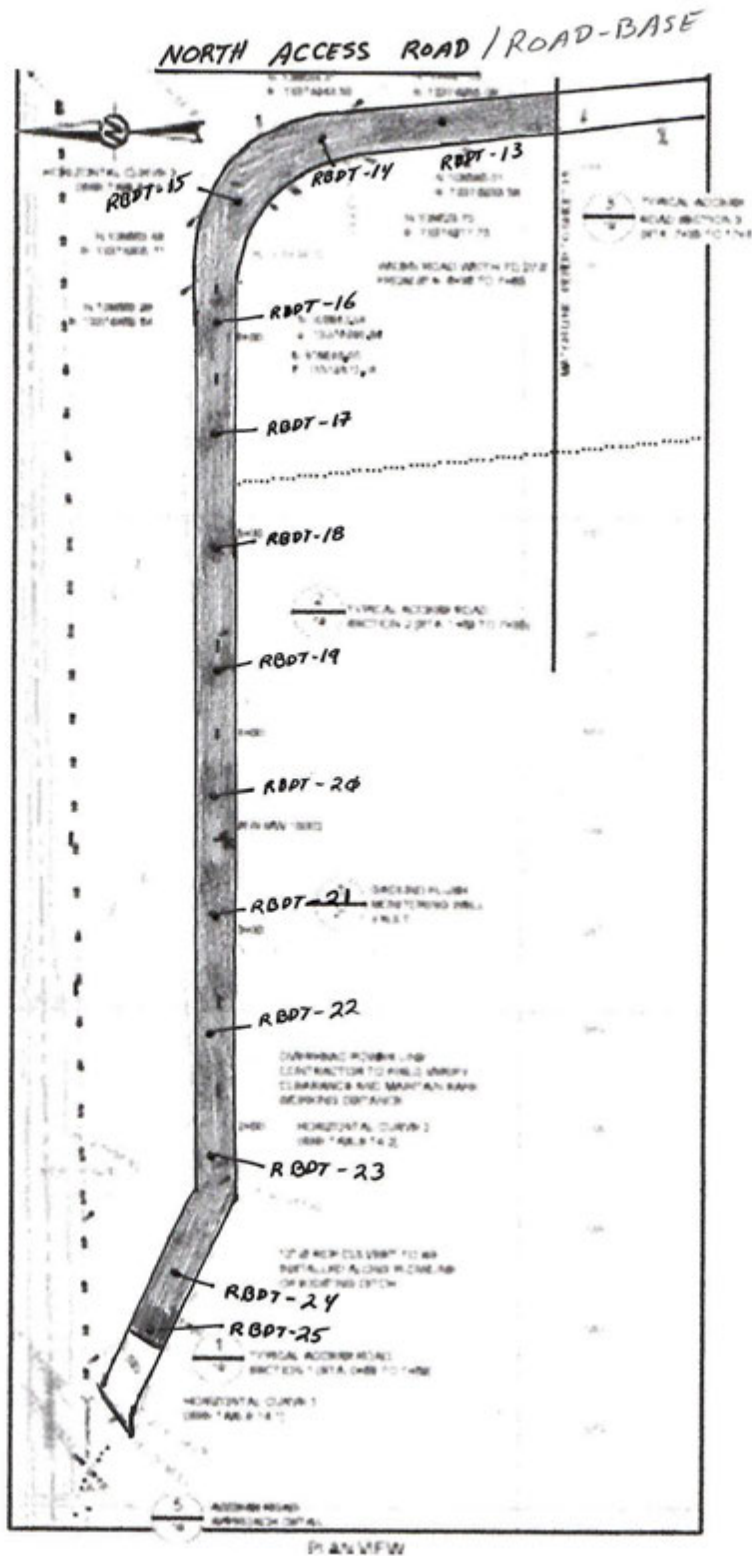

Road Base Density Test Map 2 of 2

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/14/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0930/1430
Contractor(s):	Ryan Central Inc. Rowe	Contractor(s) Rep:	John Johnson (Ryan Central) Will Smith (Rowe)

SITE CONDITIONS	
Weather (AM): Cloudy	Temperature: 24
Weather (PM): Cloudy	Temperature: 28
Precipitation: None	Wind: W, 2-6 mph

EQUIPMENT ON SITE
1-Kubota RTV X1120D; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 3 Operator, 1 Laborer
<ul style="list-style-type: none">Placed topsoil in Pond's 1 and 2.Finish grading topsoil placed in Pond's 1 and 2.
FK Engineering – 2 Techs
<ul style="list-style-type: none">Scoped MW-15006.Flushed MW-15006

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">Golder onsite documenting the construction progress.Golder observed placement of topsoil in Pond's 1 and 2, material being placed in 6 inch lift from the western edge of Pond's 1 and 2.Golder observed finish grading of placed topsoil to specifications.Golder observed survey of protective cover and topsoil certification points in Pond 1.Golder performed depth checks of topsoil to verify minimum 6 inch thickness.Golder monitored flushing of MW-15006 to remove plug and prep for well development on Monday, November 18, 2019.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF SURVEYOR'S ACTIVITIES

Rowe shot remaining certification points for the protective cover in Pond 1 and continued shooting topsoil certification points within pond 1.
--

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

Bi-Weekly construction meeting with CEC, Ryan and Golder.

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature: 
--

PHOTOGRAPHS



Loading topsoil from onsite stockpile for placement in Pond 2, looking northeast

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Preparing to flush MW-15006




Flushing MW-15006

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

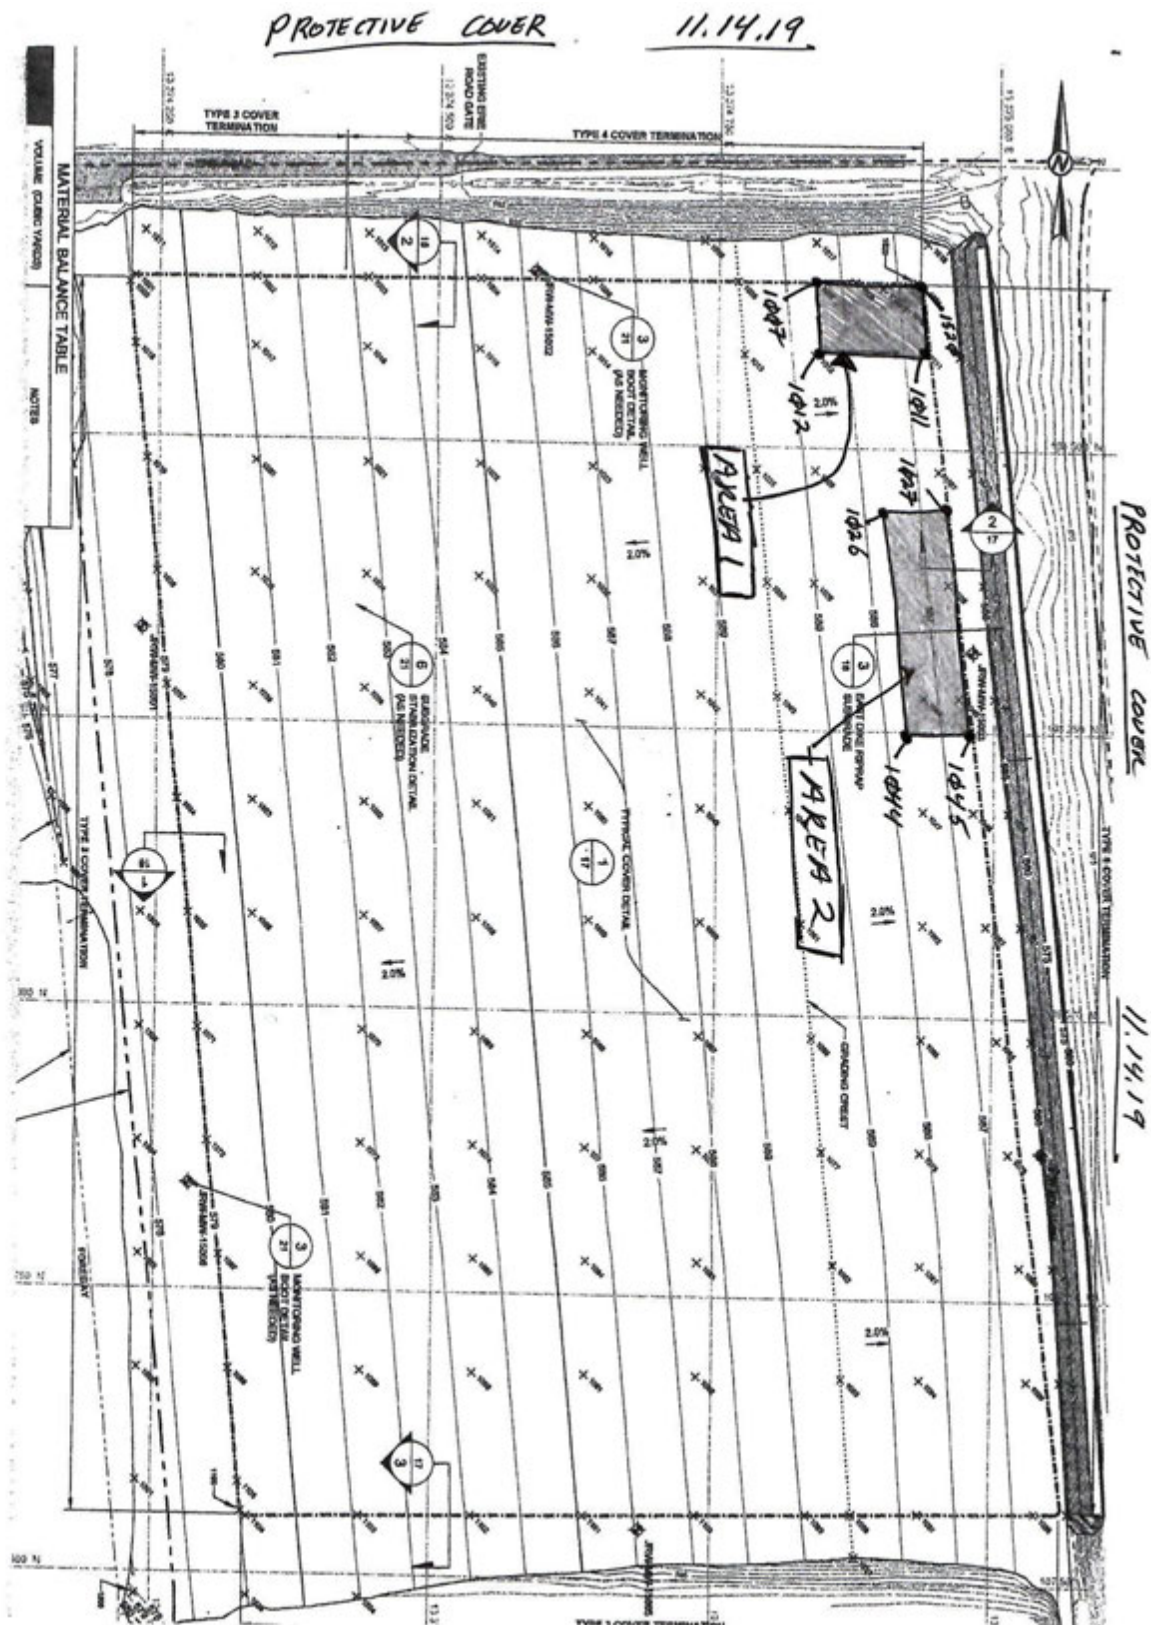

Protective Cover area surveyed

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

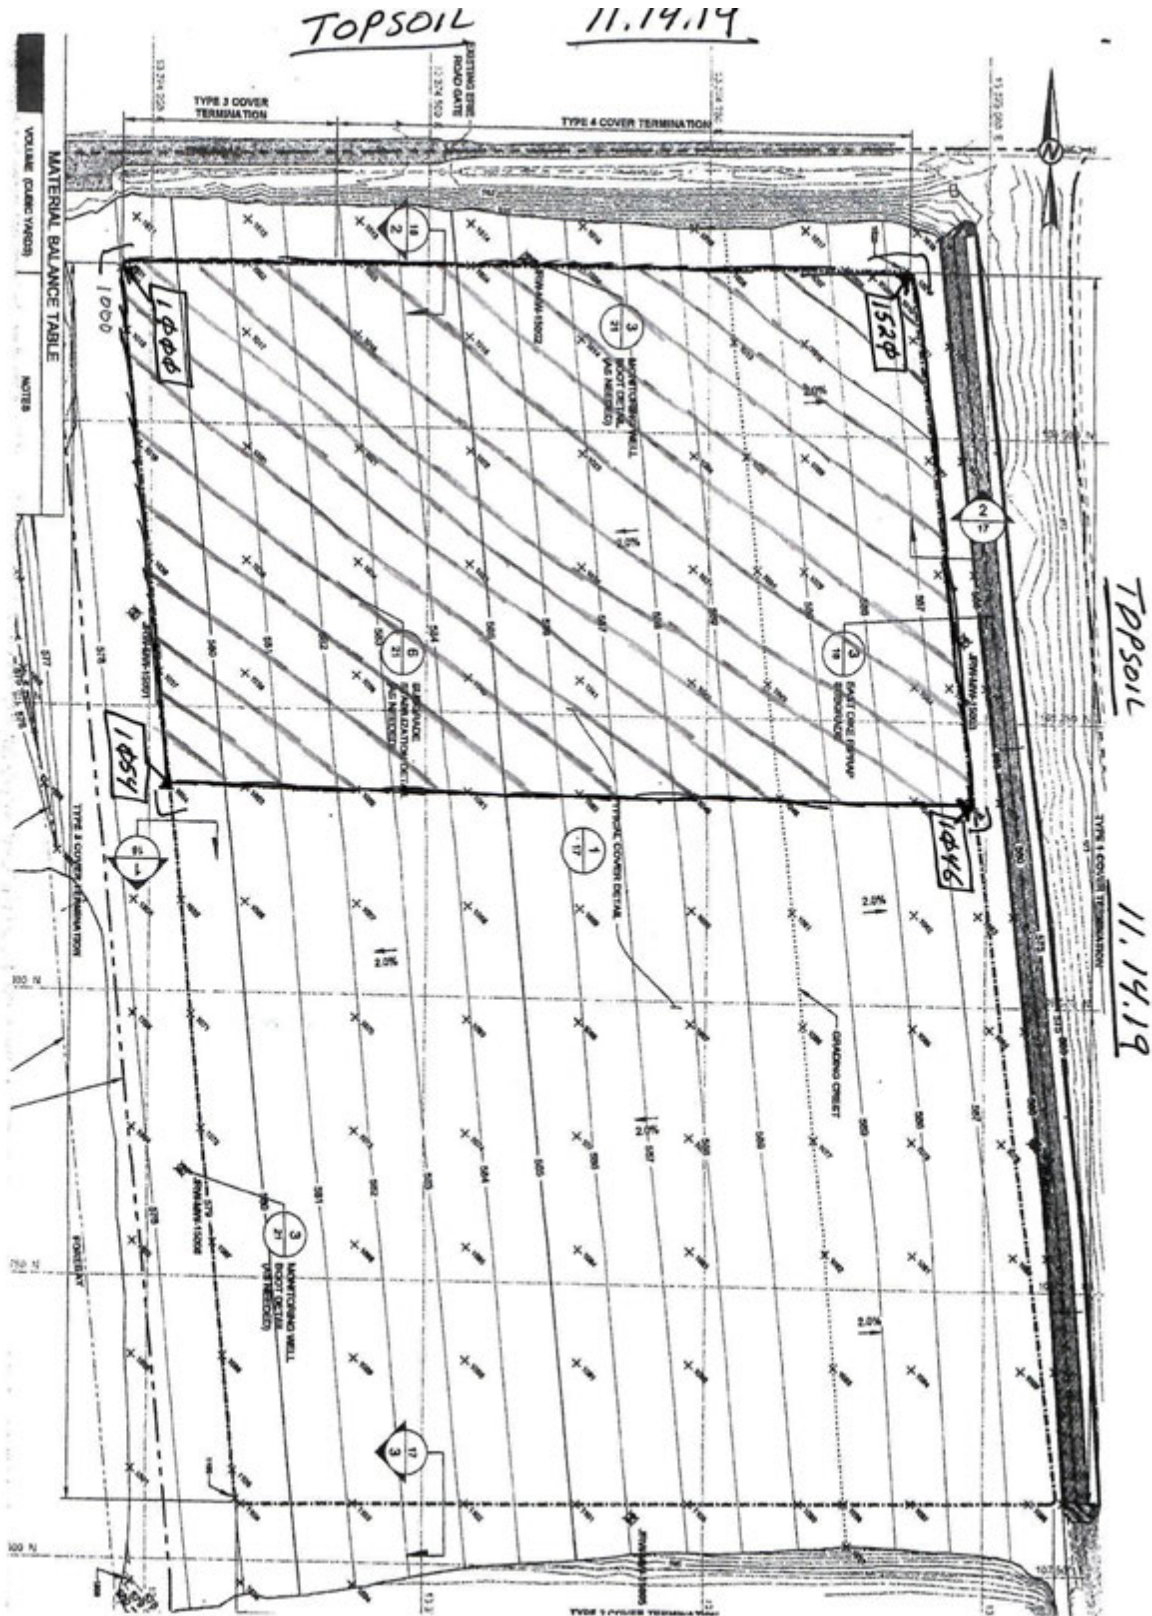

Topsoil area surveyed

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/16/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0730/1400	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Mostly Cloudy	Temperature: 25
Weather (PM): Mostly Cloudy	Temperature: 34
Precipitation: None	Wind: N, 3-8 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 3 Operator

- Placed topsoil in Pond 2.
- Finish grading topsoil placed in Pond 2.
- Import 21AA for asphalt base.
- Placed and compacted asphalt base for access ramp.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of topsoil in Pond 2, material being placed in 6 inch lift.
- Golder observed finish grading of placed topsoil to specifications.
- Golder performed Standard test on Troxler 3440 prior to density testing.
- Performed density test ABDT-1 on 8-inch compacted lift of 21AA asphalt base for access ramp using a Troxler 3440 Nuclear Gauge (see density test map). Compacted and tested 21AA fill met all specifications for asphalt base material.

SUMMARY OF SURVEYOR'S ACTIVITIES


None

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF PROBLEMS AND RESOLUTIONS
None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
None

SUBMITTED BY GOLDER:
<p>CQA Field Manager: David Hutchinson Signature: </p>

PHOTOGRAPHS



Placing 8 inch lift of 21AA for access ramps asphalt base, looking northwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




Compacting 21AA placed for access ramp using smooth drum roller, looking north



Fabric and 21AA placed for Access Ramp, looking northwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

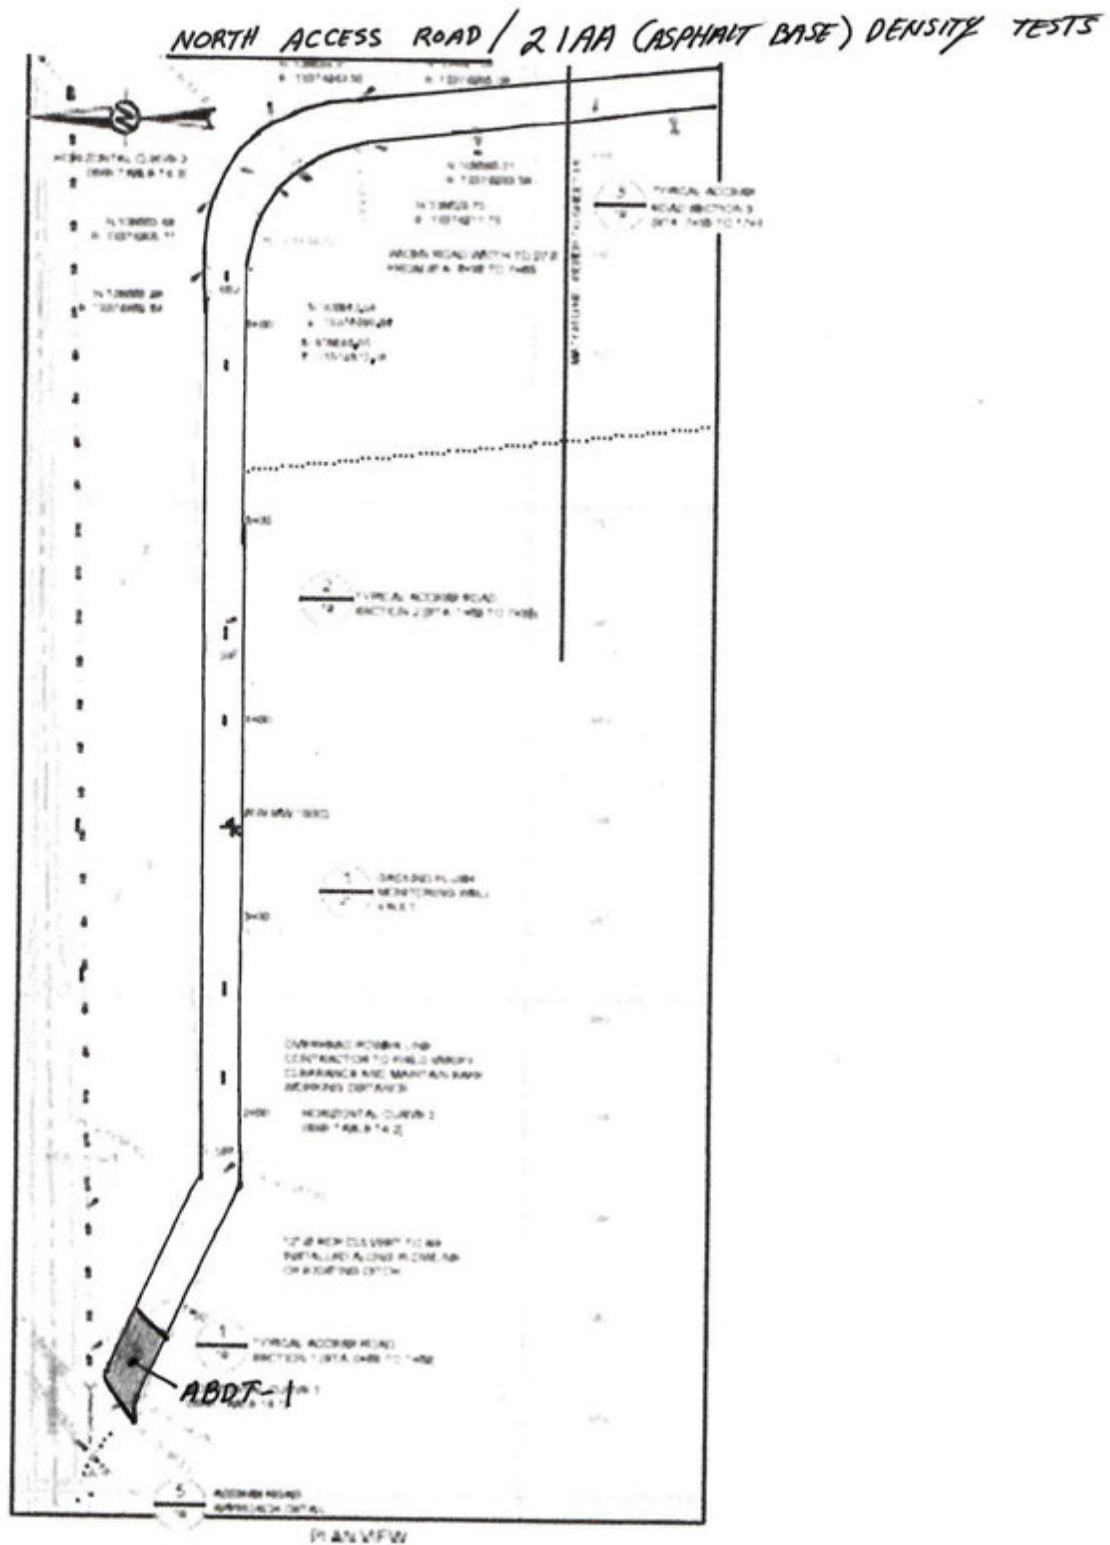

Protective Cover area surveyed

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title: J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/19/2019
Client: Consumers Energy	Site/Location: Erie, MI	
GAI Personnel: David Hutchinson	Arrival/Departure Time: 0700/1400	
Contractor(s): Ryan Central Inc.	Contractor(s) Rep: John Johnson (Ryan Central)	

SITE CONDITIONS

Weather (AM): Cloudy	Temperature: 35
Weather (PM): Cloudy	Temperature: 38
Precipitation: None	Wind: N, 3-6 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operators, 1 Laborer

- Place and finish grading topsoil in Pond 2.
- Installed Jersey Barriers around horseshoe.

Ebony

- Placed and compacted asphalt for access ramp.

NERC

- Seeded, fertilized and covered with straw topsoil in Pond 1.

Future Fence

- Installing fence posts for perimeter fence along west side of Ponds 1 and 2.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of topsoil in Pond 2, material being placed in 6 inch lift.
- Golder observed finish grading of placed topsoil to specifications.
- Golder observed installation of posts for the perimeter fence along west side of Ponds 1 and 2.
- Golder observed seeding, fertilizing of topsoil of Pond 1 in accordance to specifications, straw placed over seeded area.
- Golder observed installation and compaction of asphalt for access ramp.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

SUMMARY OF SURVEYOR'S ACTIVITIES

None

SUMMARY OF PROBLEMS AND RESOLUTIONS
--

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
--

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

None

SUBMITTED BY GOLDR:

CQA Field Manager: David Hutchinson
--

Signature:



PHOTOGRAPHS



Installing Jersey barriers around horseshoe between Pond 2 and Chemical Pond, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



Placement and compaction of asphalt for access ramp, looking southwest



Asphalt being placed for access ramp, looking southwest

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW

Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/21/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0700/1400
Contractor(s):	Ryan Central Inc.	Contractor(s) Rep:	John Johnson (Ryan Central)

SITE CONDITIONS

Weather (AM): Cloudy	Temperature: 38
Weather (PM): Cloudy	Temperature: 48
Precipitation: Rain	Wind: NW, 6-10 mph

EQUIPMENT ON SITE

1-Kubota RTV X112OD; 1-CAT Water Truck; 1-CAT A200 LGP Dozer; 1-Cat CS56B Smooth Drum Roller; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION

Work performed while Golder was onsite:

Ryan Central -1 Foreman, 2 Operators, 1 Laborer

- Import topsoil to chemical pond.
- Place topsoil east end of chemical pond and access road.
- Import 23AA for access road.
- Place 23AA along shoulders of access road asphalt ramp.
- Level sub-grade around monitoring wells.
- Demobilized Cat D6 dozer.

NERC

- Began seed/mulch, fertilize and straw of topsoil in Pond 2.

Future Fence

- Continued installing fence posts for the east and north perimeter.

GAI CQA ACTIVITIES AND TEST RESULTS

Construction:

- Golder onsite documenting the construction progress.
- Golder observed placement of topsoil in chemical pond, material being placed in 6 inch lift.
- Golder observed leveling of sub-grade around monitoring wells for concrete pads.
- Golder observed installation of posts for the east and north perimeter fence of Ponds 1 and 2.
- Golder observed seeding, fertilizing of topsoil of Pond 2 in accordance to specifications, straw placed over seeded area.
- Golder performed depth checks of topsoil to verify minimum 6 inch thickness.

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

- Golder observed installation and compaction of asphalt for access ramp.

SUMMARY OF SURVEYOR'S ACTIVITIES

Rowe shot remaining certification points for topsoil in Pond 2.

SUMMARY OF PROBLEMS AND RESOLUTIONS

None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)

None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:

**PHOTOGRAPHS**

Import of 23AA for shoulder of asphalt access ramp, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure




23AA placed along shoulder of asphalt access ramp, looking southeast



Overview of Pond 1's seed/mulch progress, looking south

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

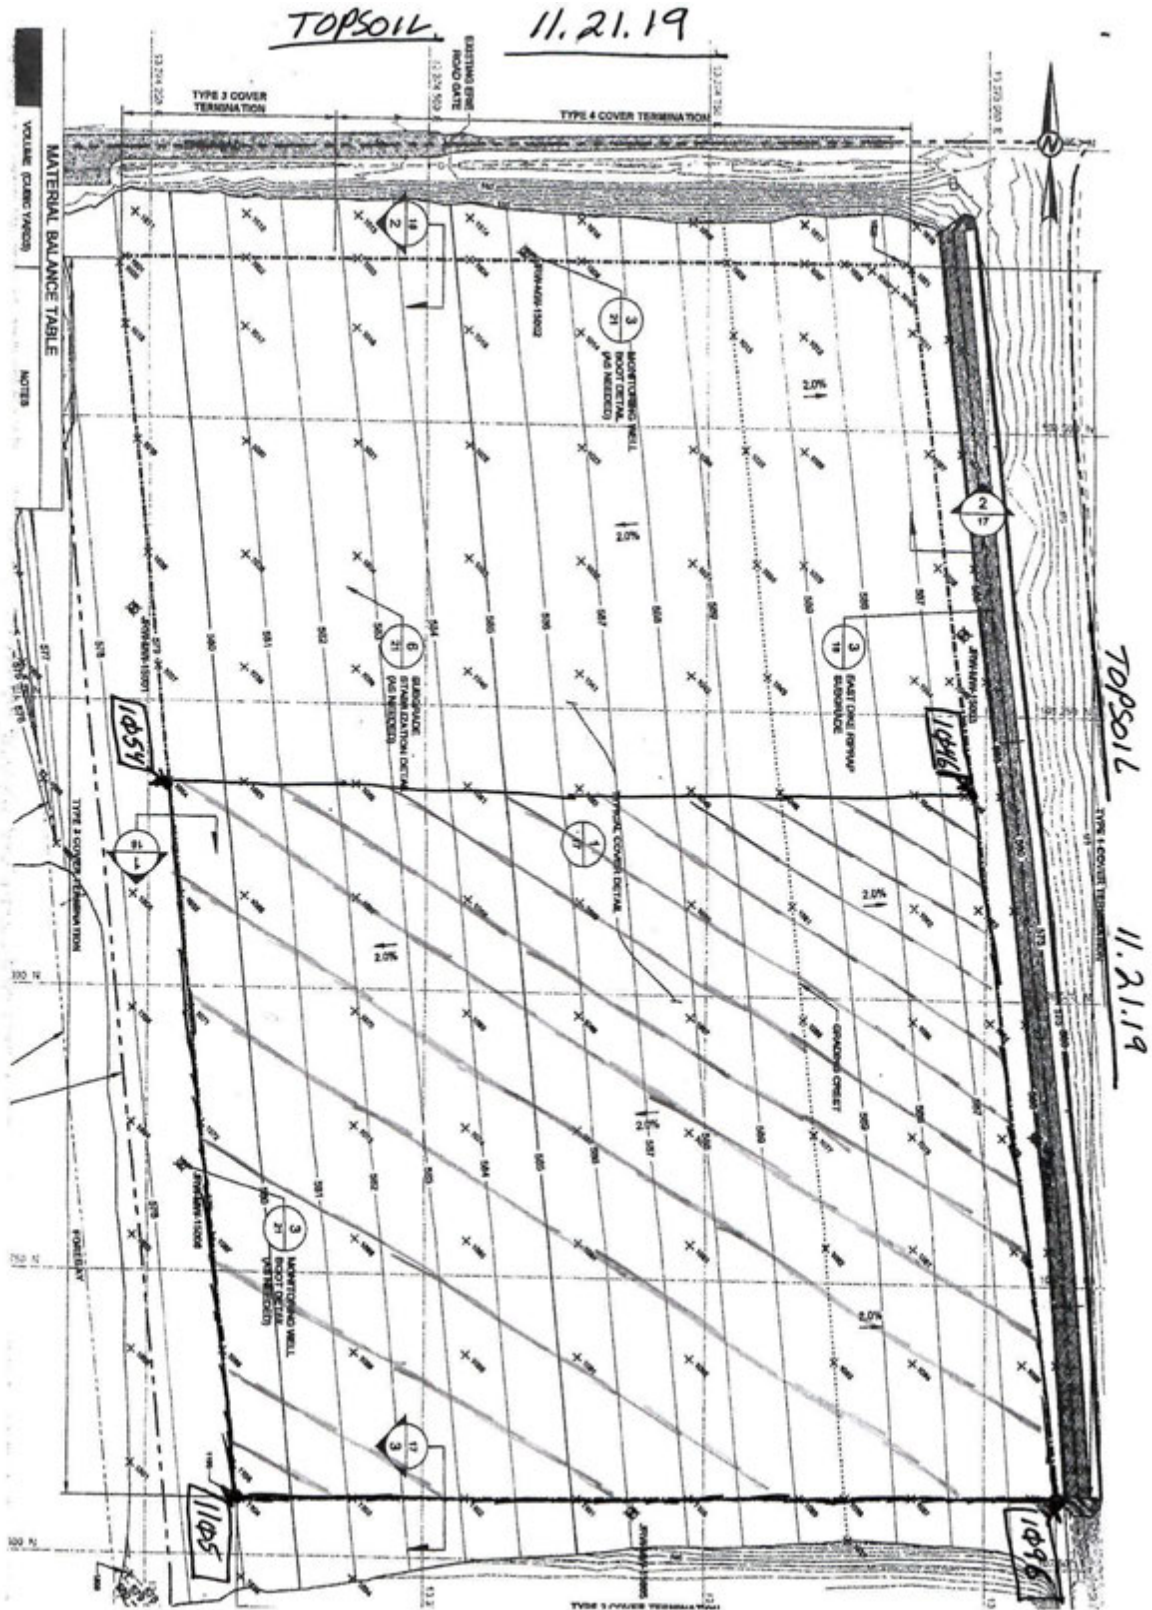

Area surveyed prior to seeding

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

PROJECT OVERVIEW			
Project Title:	J.R. Whiting Ponds 1 and 2 Closure CQA	Project Number: 1788523	Date: 11/27/2019
Client:	Consumers Energy	Site/Location:	Erie, MI
GAI Personnel:	David Hutchinson	Arrival/Departure Time:	0700/1300
Contractor(s):	Ryan Central Inc. Rowe	Contractor(s) Rep:	John Johnson (Ryan Central) Will Smith (Rowe)

SITE CONDITIONS	
Weather (AM): Cloudy	Temperature: 47
Weather (PM): Cloudy	Temperature: 53
Precipitation: Rain	Wind: W, 8-22 mph

EQUIPMENT ON SITE
1-Kubota RTV X112OD; 1-Cat D6T Dozer; 1-Cat 299D Skid Steer.

SUMMARY OF CONSTRUCTION
Work performed while Golder was onsite:
Ryan Central -1 Foreman, 1 Operator
<ul style="list-style-type: none">• Touch-up of access road.• General clean-up of pond construction area.
Future Fence
<ul style="list-style-type: none">• Continued installing perimeter fence.

GAI CQA ACTIVITIES AND TEST RESULTS
Construction:
<ul style="list-style-type: none">• Golder onsite documenting the construction progress.• Golder observed installation of perimeter fence around Ponds 1 and 2.• Golder observed Rowe shooting top of monitoring well pipe casings.• Golder observed Rowe survey of access road and control points along top of rip-rap.

SUMMARY OF SURVEYOR'S ACTIVITIES
Rowe shot top of pipe for monitoring wells, surveyed access road and control points along top of rip-rap.

SUMMARY OF PROBLEMS AND RESOLUTIONS
None

SUMMARY OF MEETINGS/DISCUSSIONS HELD (ATTENDEES AND ISSUES)
None

SUMMARY OF INCIDENTS / ACCIDENTS / HEALTH AND SAFETY ISSUES
--

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure

None

SUBMITTED BY GOLDER:

CQA Field Manager: David Hutchinson

Signature:



PHOTOGRAPHS



MW-15002 with protective casing and bollards installed

DAILY FIELD FORM – J.R. Whiting Ponds 1 and 2 Closure



MW-15003 ground flush in east access road



Overview of perimeter fence along north side of Pond 1

APPENDIX D

Soil Laboratory Testing

APPENDIX D.1

Structural Fill

JR Whiting
Pond 1 and 2
Geotechnical Laboratory Test Results

Sample Identification	Sample Type	Sample Depth (ft)	Soil Classification	In-situ Moisture %	Atterberg Limits				Grain Size Distribution		Modified Proctor		Specific Gravity	Unit Weight		Hydraulic Conductivity (cm/sec)	Additional Tests Conducted (See Notes)
					LL	PL	PI	LI	% Finer #4 sieve	% Finer #200 sieve	Maximum Dry Density (pcf)	Optimum Moisture %		Dry (pcf)	Moisture %		
SF-01	Bulk	-	CL	11.5	25	15	10	-0.35	95.3	69.2	128.6	8.2	-	-	-	-	
SF-02	Bulk	-	CL-ML	12.4	19	13	6	-0.10	93.9	65.4	133.0	8.3	-	-	-	-	
SF-03	Bulk	-	CL	11.1	25	15	10	-0.39	96.2	74.9	128.2	9.8	-	-	-	-	
SF-04	Bulk	-	CL	11.3	24	14	10	-0.27	96.2	67.1	131.9	9.1	-	-	-	-	

ABBREVIATIONS: LIQUID LIMIT (LL)
PLASTIC LIMIT (PL)
PLASTICITY INDEX (PI)
LIQUIDITY INDEX (LI)
SPECIFIC GRAVITY (Gs)
MOISTURE (M_c)


NOTES: T = TRIAXIAL TEST
U = UNCONFINED COMPRESSION TEST
C = CONSOLIDATION TEST
DS = DIRECT SHEAR TEST
O = ORGANIC CONTENT
P = pH
NP = NON-PLASTIC
*Classified Visually



PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
SAMPLE ID: SF-01
TYPE: Bulk


DEPTH (ft) -

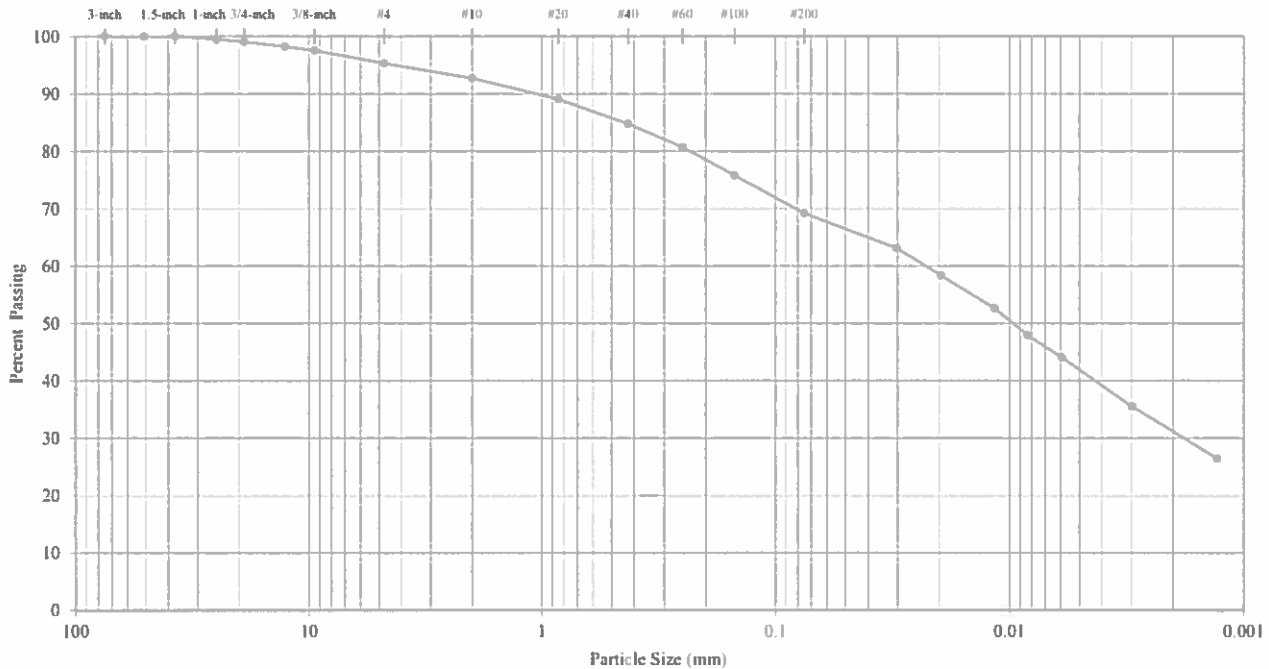

Sieve	Particle Size (mm)	% Passing	Description	Percentage
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.95
1.5-inch	37.5	100.0		
1-inch	25.0	99.5		
3/4-inch	19.0	99.1	Fine Gravel	3.73
1/2-inch	12.7	98.2		
3/8-inch	9.5	97.6		
#4	4.75	95.3	Coarse Sand	2.60
#10	2.0	92.7		
#20	0.85	89.1		
#40	0.425	84.8	Medium Sand	7.95
#60	0.25	80.7		
#100	0.15	75.8		
#200	0.075	69.2	Fine Sand	15.63
	0.030	63.1		
	0.020	58.3	Silt or Clay Fines	69.15
	0.012	52.6		
	0.008	47.9		
	0.006	44.1		
	0.003	35.5		
	0.001	26.4		

Sieve Analysis
(Initial Separation on No. 4 Sieve)

Hydrometer Analysis

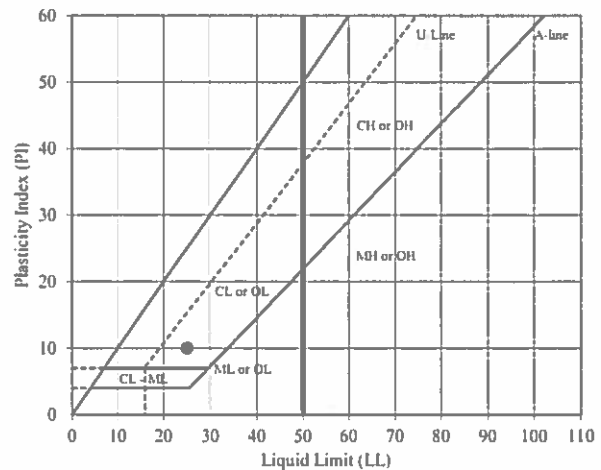

USCS Description (ASTM D 2487):

Grayish brown, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
25	15	10	-0.35

As-Received Moisture Content (%)

11.5

USCS Group Symbol

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	BB
DATE	5/30/2019
CHECK	[Signature]
REVIEW	[Signature]

May-19


1788523

**LABORATORY COMPACTION CHARACTERISTICS OF SOIL
ASTM D1557 - Method A**

Mechanical Rammer Moist Preparation

PROJECT NAME: JR Whiting Pond 1&2
 SAMPLE ID: SF-01
 TYPE: Bulk

DEPTH (ft): -

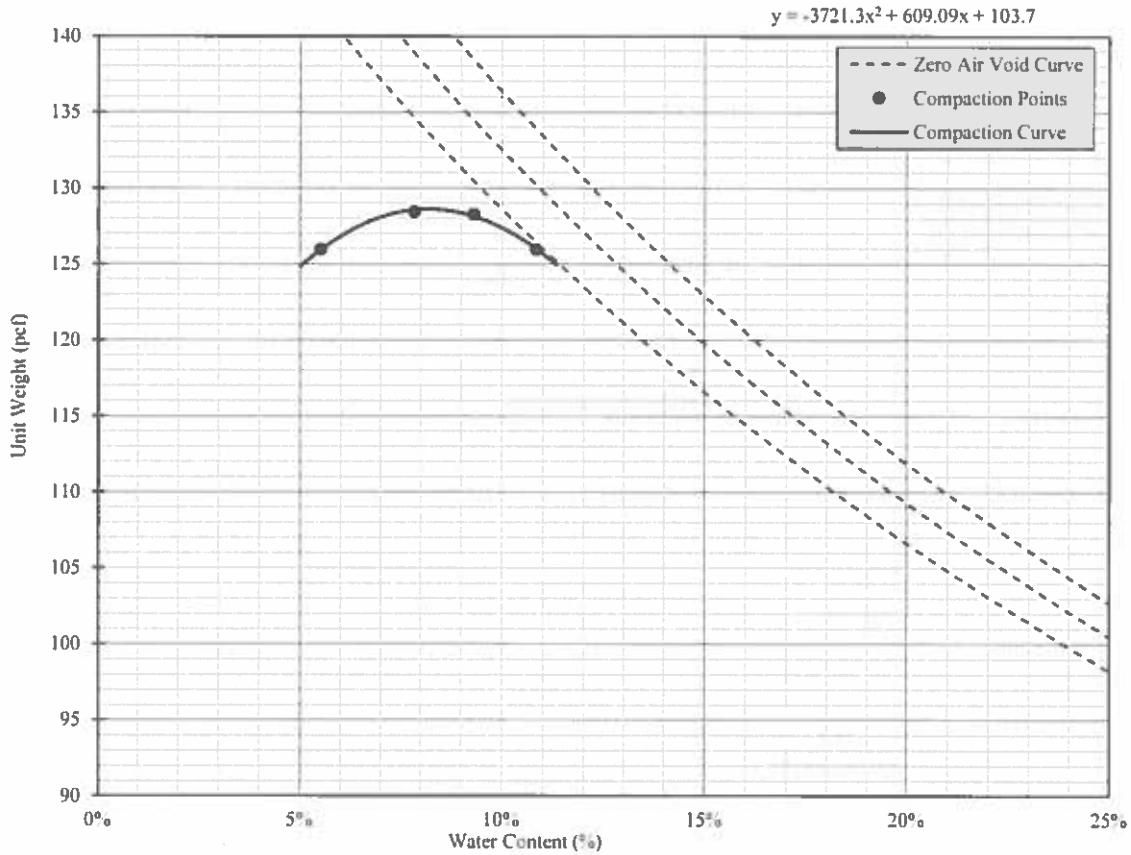

SG 2.8
 SG 2.7
 SG 2.6

% Test Fraction Passing #4 Sieve	95%
As-Received Moisture Content	11%
Specific Gravity (assumed)	2.65

Modified Maximum Dry Unit Weight (pcf)	128.6
Modified Optimum Water Content (%)	8.2%

USCS Description (ASTM D 2487): Grayish brown, SANDY LEAN CLAY, trace gravel

USCS CL

TECH	BB
DATE	5/31/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>



PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2

SAMPLE ID: SF-02

DEPTH (ft): -

TYPE: Bulk


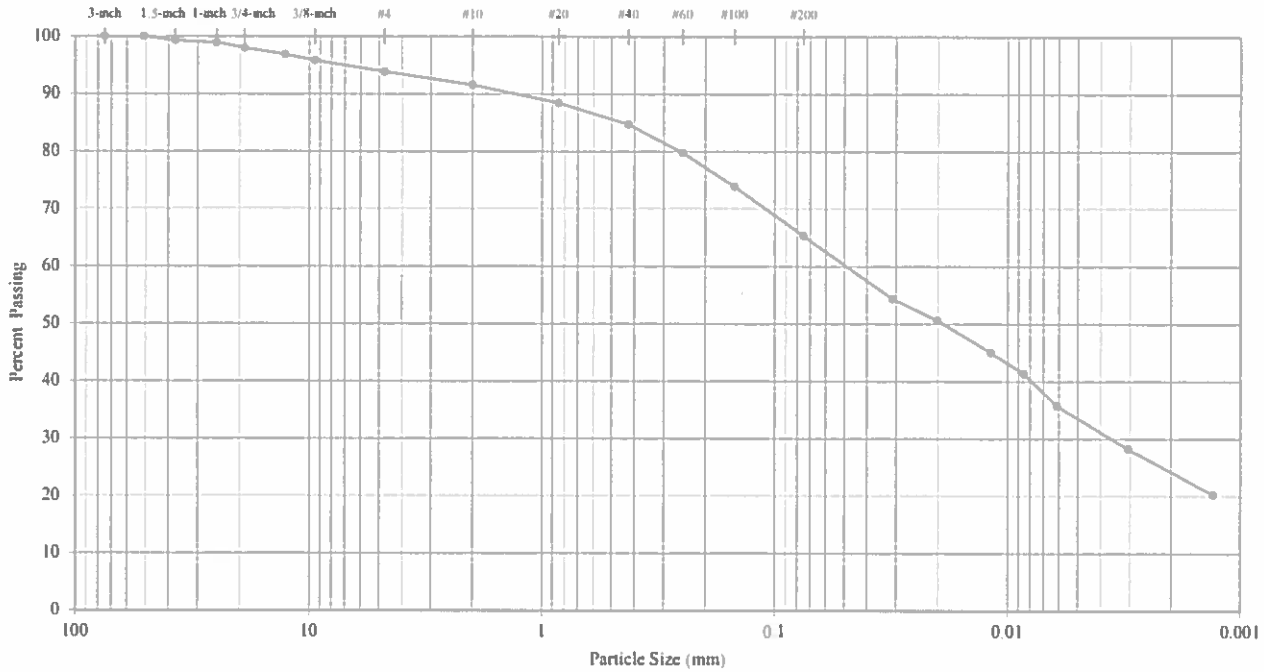


Table with 5 columns: Sieve, Particle Size (mm), % Passing, Description, Percentage. It is divided into Sieve Analysis (Initial Separation on No. 4 Sieve) and Hydrometer Analysis sections.

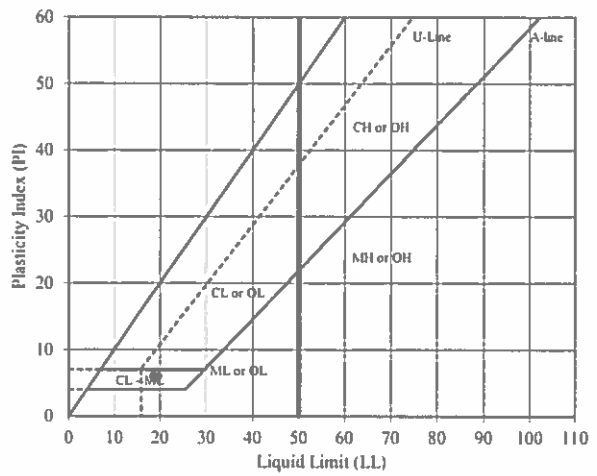

USCS Description (ASTM D 2487): Grayish brown, SANDY SILTY CLAY, little gravel

Table with 4 columns: LL, PL, PI, LI. Values: 19, 13, 6, -0.10

As-Received Moisture Content (%): 12.4

USCS Group Symbol: CL-ML

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute. (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: BB
DATE: 5/30/2019
CHECK: [Signature]
REVIEW: [Signature]

May-19


1788523

**LABORATORY COMPACTION CHARACTERISTICS OF SOIL
ASTM D1557 - Method A**

Mechanical Rammer Moist Preparation

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **SF-02**
 TYPE: **Bulk**

DEPTH (ft): -

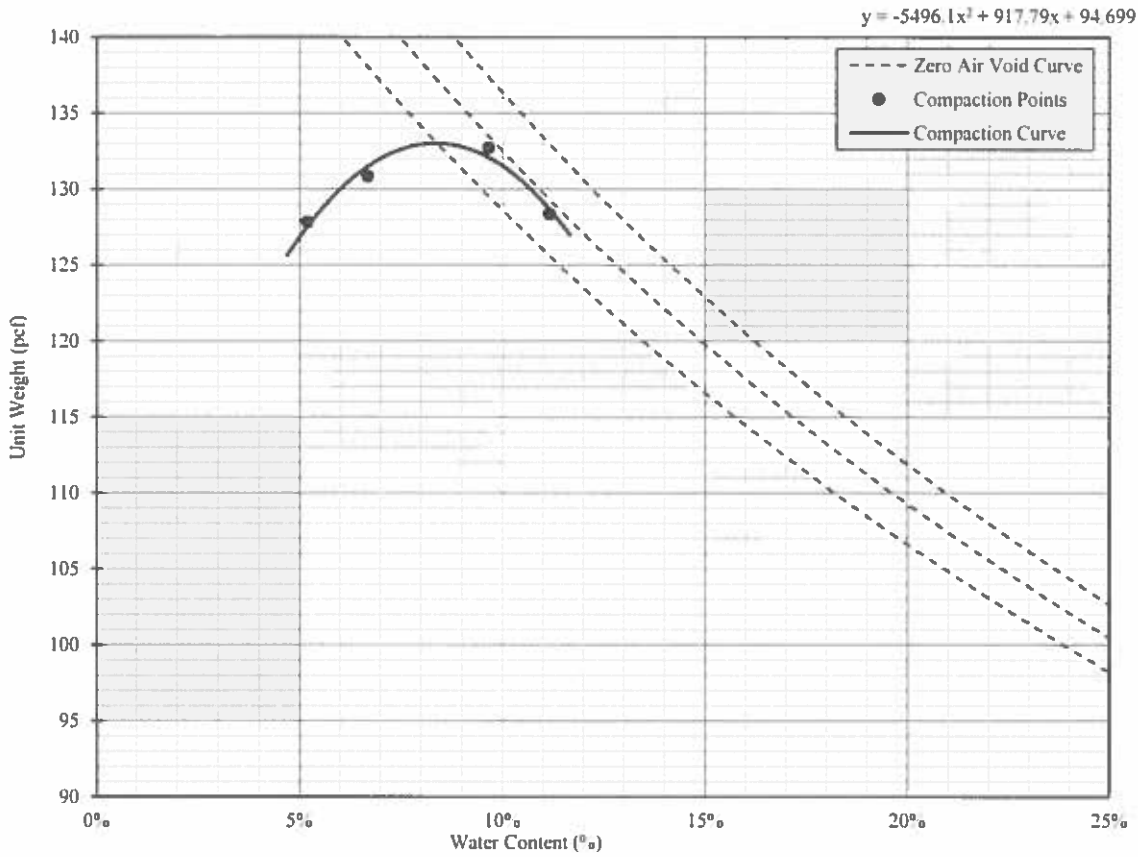

SG 2.8
 SG 2.7
 SG 2.6

% Test Fraction Passing #4 Sieve	94%
As-Received Moisture Content	12%
Specific Gravity (assumed)	2.65

Modified Maximum Dry Unit Weight (pcf)	133.0
Modified Optimum Water Content (%)	8.3%

USCS Description (ASTM D 2487): **Grayish brown, SANDY SILTY CLAY, little gravel**

USCS **CL-ML**


TECH	BB
DATE	5/31/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>




PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
SAMPLE ID: SF-03
TYPE: Bulk

DEPTH (ft): -

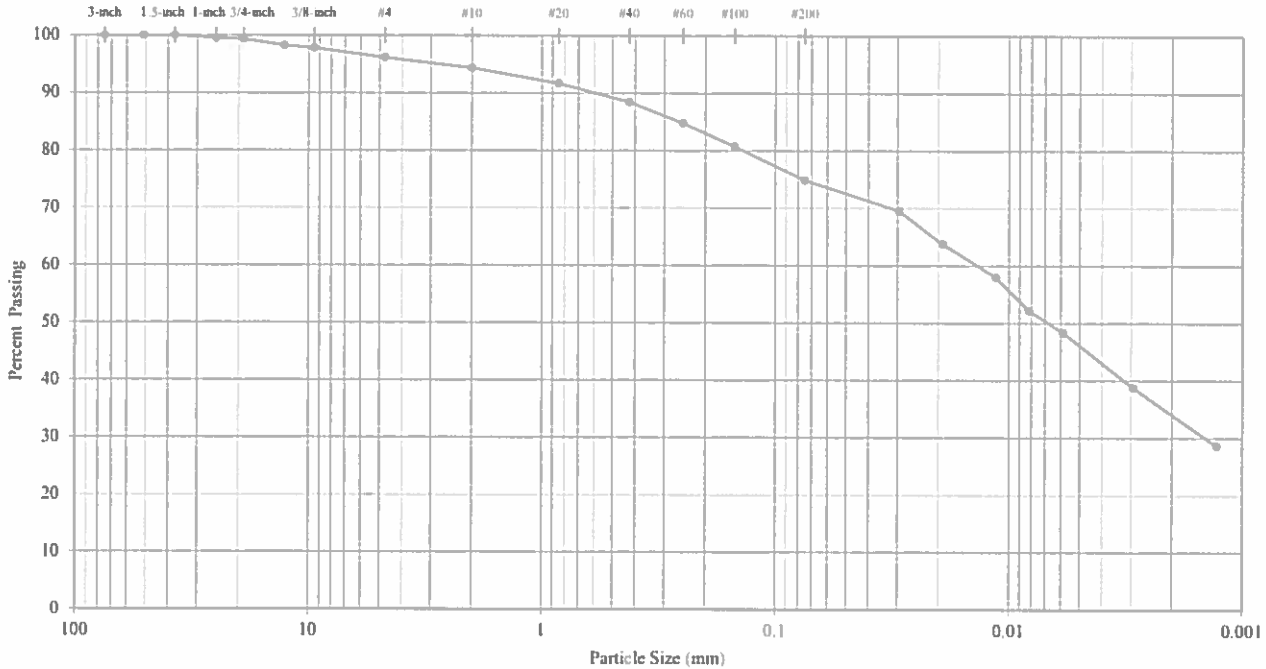

	Particle Size		Description	Percentage
	Sieve	(mm)		
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	Cobbles	0.00
	2-inch	50.8	Coarse Gravel	0.65
	1.5-inch	37.5		
	1-inch	25.0		
	3/4-inch	19.0	Fine Gravel	3.18
	1/2-inch	12.7		
	3/8-inch	9.5		
	#4	4.75	Coarse Sand	1.81
	#10	2.0		
	#20	0.85		
Hydrometer Analysis	#40	0.425	Medium Sand	5.93
	#60	0.25		
	#100	0.15	Fine Sand	13.55
	#200	0.075		
		0.030	Silt or Clay Fines	74.88
		0.019		
		0.011		
		0.008		
		0.006		
		0.003		
	0.001			

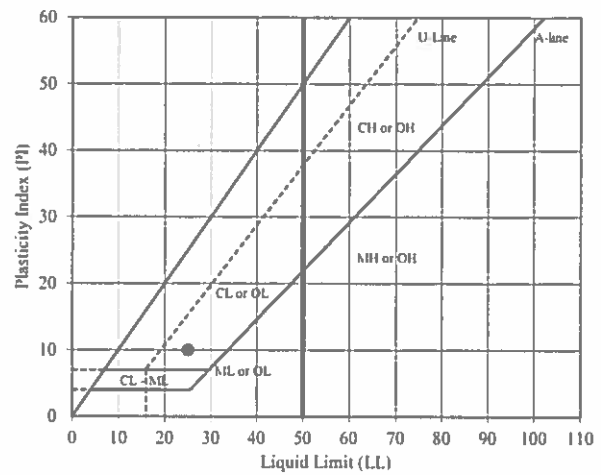

USCS Description (ASTM D 2487):

Grayish brown, LEAN CLAY WITH SAND,
trace gravel

LL	PL	PI	LI
25	15	10	-0.39

As-Received Moisture Content (%)

11.1

USCS Group Symbol

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	BB
DATE	5/30/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

May-19


1788523

**LABORATORY COMPACTION CHARACTERISTICS OF SOIL
ASTM D1557 - Method A**

Mechanical Rammer Moist Preparation

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **SF-03**
 TYPE: **Bulk**

DEPTH (ft): -

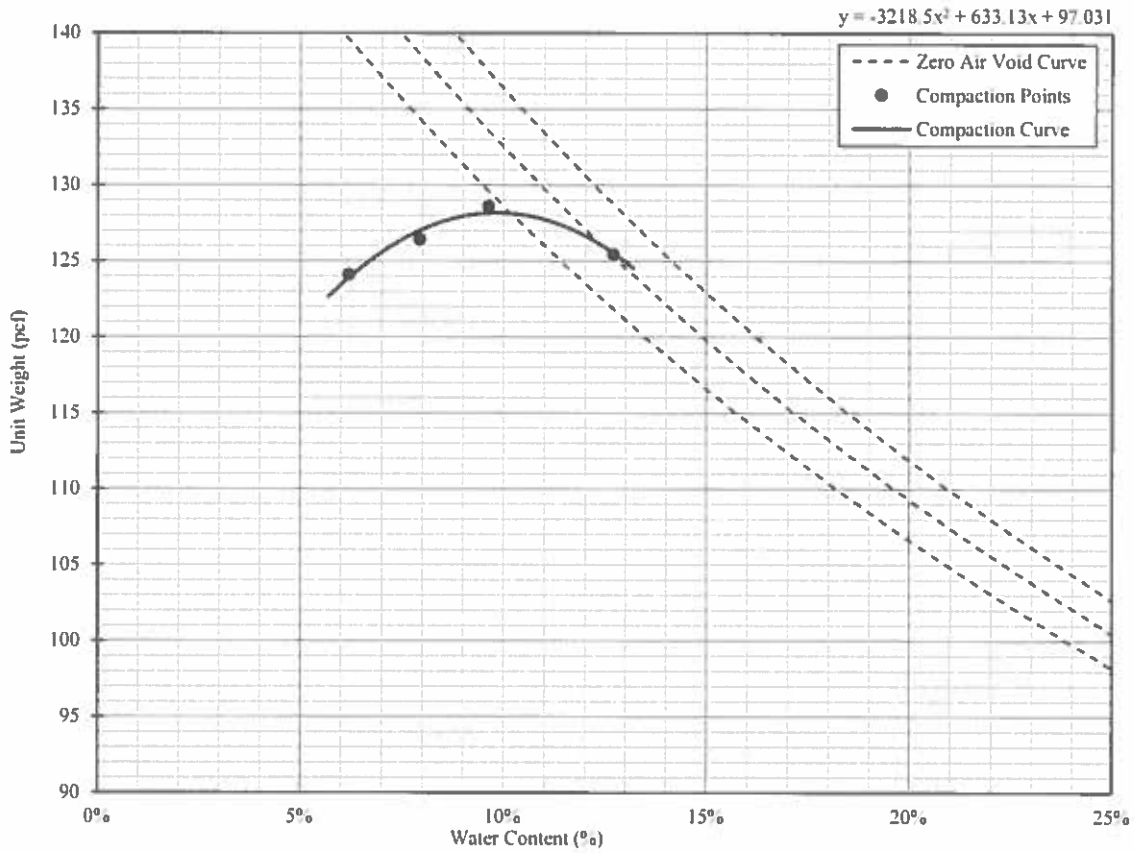

SG 2.8
 SG 2.7
 SG 2.6

% Test Fraction Passing #4 Sieve	96%
As-Received Moisture Content	11%
Specific Gravity (assumed)	2.65

Modified Maximum Dry Unit Weight (pcf)	128.2
Modified Optimum Water Content (%)	9.8%

USCS Description (ASTM D 2487): Grayish brown, LEAN CLAY WITH SAND, trace gravel

USCS **CL**


TECH	BB
DATE	5/31/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>




PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
SAMPLE ID: SF-04
TYPE: Bulk

DEPTH (ft) :-

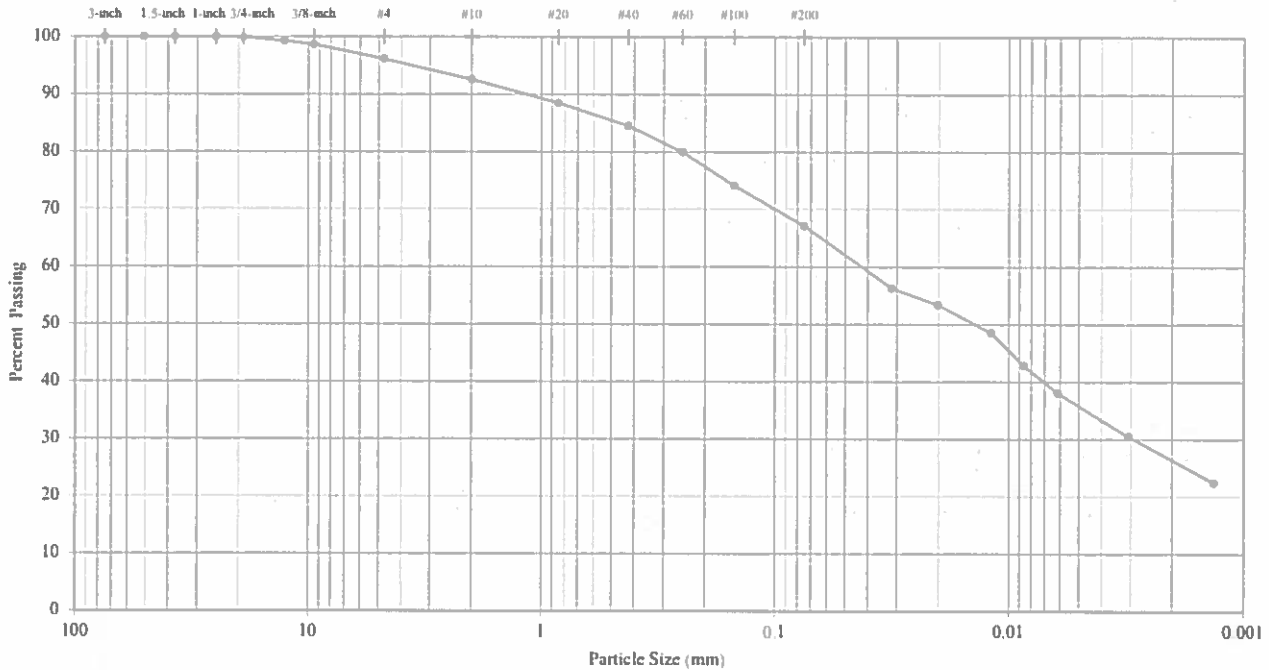

Sieve Analysis (Initial Separation on No. 4 Sieve)	Particle Size		Description	Percentage
	Sieve	(mm)		
	3-inch	75.0	Cobbles	0.00
	2-inch	50.8	Coarse Gravel	0.11
	1.5-inch	37.5		
	1-inch	25.0		
	3/4-inch	19.0		
	1/2-inch	12.7	Fine Gravel	3.69
	3/8-inch	9.5		
	#4	4.75		
	#10	2.0	Coarse Sand	3.64
	#20	0.85	Medium Sand	8.02
	#40	0.425		
	#60	0.25	Fine Sand	17.42
	#100	0.15		
	#200	0.075		
Hydrometer Analysis		0.032	Silt or Clay Fines	67.11
		0.020		
		0.012		
		0.009		
		0.006		
		0.003		
		0.001		

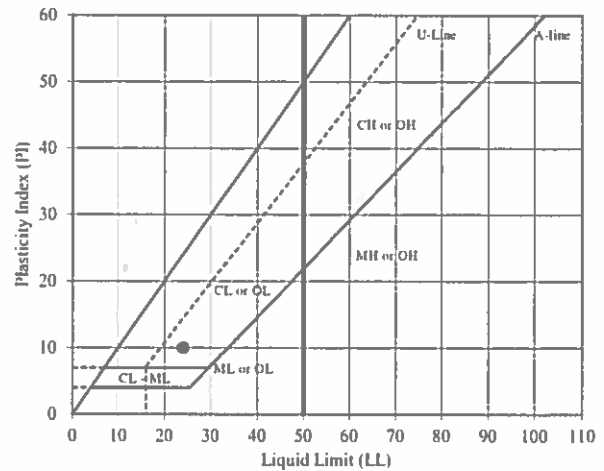

USCS Description (ASTM D 2487):

Grayish brown, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
24	14	10	-0.27

As-Received Moisture Content (%)

11.3

USCS Group Symbol

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	BB
DATE	7/28/2019
CHECK	DS
REVIEW	[Signature]

July-19

1788523


LABORATORY COMPACTION CHARACTERISTICS OF SOIL

ASTM D1557 - Method A

Mechanical Rammer
 Moist Preparation

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **SF-04**
 TYPE: **Bulk**

DEPTH (ft) -

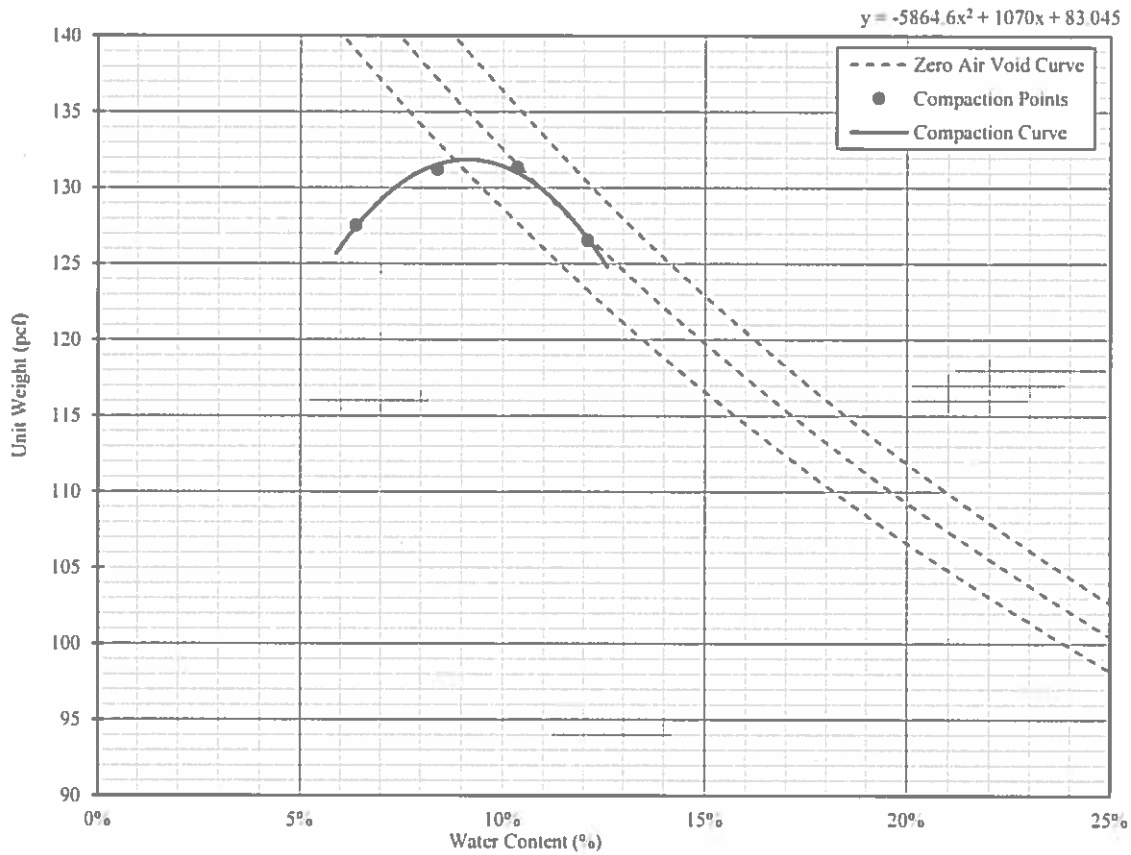

SG 2.8
 SG 2.7
 SG 2.6

% Test Fraction Passing #4 Sieve	96%
As-Received Moisture Content	11%
Specific Gravity (assumed)	2.65

Modified Maximum Dry Unit Weight (pcf)	131.9
Modified Optimum Water Content (%)	9.1%

USCS Description (ASTM D 2487): Grayish brown, SANDY LEAN CLAY, trace gravel

USCS CL

TECH	BB
DATE	7/29/2019
CHECK	<i>BB</i>
REVIEW	<i>PMC</i>

APPENDIX D.2

Protective Cover Material



822 Schuster Ave
Kalamazoo, MI. 49001
269-321-3800

5.10.2019

The following letter serves to communicate at this time that the 100% Natural bank material designated as **Clay Overburden** out of the following location is a naturally occurring, non-processed, non-synthetic material.

Dundee-Holcim Limestone Quarry
(MDOT Pit #58-006)
Aggregate Industries
15215 Day Rd
Dundee, MI 48131
734*529*5876

To the knowledge of Aggregate Industries this material is virgin, clean, free of external contamination and mirrors all similar naturally occurring clay material in the surrounding region.

Sincerely,

A handwritten signature in blue ink, appearing to read "John Crawley", is positioned above the typed name.

John Crawley
Technical Services Manager

JR Whiting
Pond 1 and 2
Geotechnical Laboratory Test Results

Sample Identification	Sample Type	Sample Depth (ft)	Soil Classification	In-situ Moisture %	Atterberg Limits				Grain Size Distribution		Modified Proctor		Specific Gravity	Unit Weight		Hydraulic Conductivity (cm/sec)	Additional Tests Conducted (See Notes)
					LL	PL	PI	LI	% Finer #4 sieve	% Finer #200 sieve	Maximum Dry Density (pcf)	Optimum Moisture %		Dry (pcf)	Moisture %		
PC-01	Bag	0.5-1.0	CL	11.5	23	13	10	-0.15	97.1	70.8	-	-	-	-	-		
PC-02	Bag	0.5-1.0	CL	11.9	23	14	9	-0.24	96.6	70.7	-	-	-	-	-		
PC-03	Bulk	0.5-1.0	CL	9.4	24	14	10	-0.46	95.3	67.8	-	-	-	-	-		
PC-04	Bulk	0.5-1.0	CL	9.1	25	14	11	-0.44	96.9	67.3	-	-	-	-	-		
PC-05	Bulk	0.5-1.0	CL	6.7	26	13	13	-0.48	96.7	73.0	-	-	-	-	-		
PC-06	Bulk	-	CL	8.3	26	13	13	-0.36	98.5	73.7	-	-	-	-	-		
PC-07	Bulk	-	CL	8.5	25	14	11	-0.50	94.5	66.8	-	-	-	-	-		
PC-08	Bulk	-	CL	10.4	24	12	12	-0.13	95.1	68.5	-	-	-	-	-		
PC-09	Bulk	0.5-1.5	CL	10.8	28	16	12	-0.44	98.9	71.5	-	-	-	-	-		
PC-10	Bulk	0.5-1.0	CL	10.1	25	15	10	-0.49	95.1	68.3	-	-	-	-	-		
PC-11	Bulk	0.5-1.0	CL	10.2	26	15	11	-0.43	97.5	69.8	-	-	-	-	-		
PC-12	Bulk	0.5-1.0	CL	18.3	25	12	13	0.48	98.3	70.4	-	-	-	-	-		
PC-13	Bulk	0.5-1.0	CL	11.7	27	13	14	-0.09	97.0	69.1	-	-	-	-	-		
PC-14	Bulk	0.5-1.0	CL	12.0	27	13	14	-0.07	97.8	71.7	-	-	-	-	-		
PC-15	Bulk	0.5-1.0	CL	13.1	25	15	10	-0.19	97.6	71.7	-	-	-	-	-		
PC-16	Bulk	0.5-1.0	CL	13.3	25	15	10	-0.17	98.7	71.2	-	-	-	-	-		
PC-17	Bulk	0.5-1.0	CL	14.1	24	14	10	0.01	98.3	71.4	-	-	-	-	-		
PC-18	Bulk	0.5-1.0	CL	11.6	24	15	9	-0.38	98.4	71.5	-	-	-	-	-		


ABBREVIATIONS: LIQUID LIMIT (LL)
PLASTIC LIMIT (PL)
PLASTICITY INDEX (PI)
LIQUIDITY INDEX (LI)
SPECIFIC GRAVITY (Gs)
MOISTURE (M c)

NOTES: T = TRIAXIAL TEST
U = UNCONFINED COMPRESSION TEST
C = CONSOLIDATION TEST
DS = DIRECT SHEAR TEST
O = ORGANIC CONTENT
P = pH
NP = NON-PLASTIC
*Classified Visually


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
 SAMPLE ID: PC-01
 TYPE: Bag

DEPTH (ft): 0.5-1.0

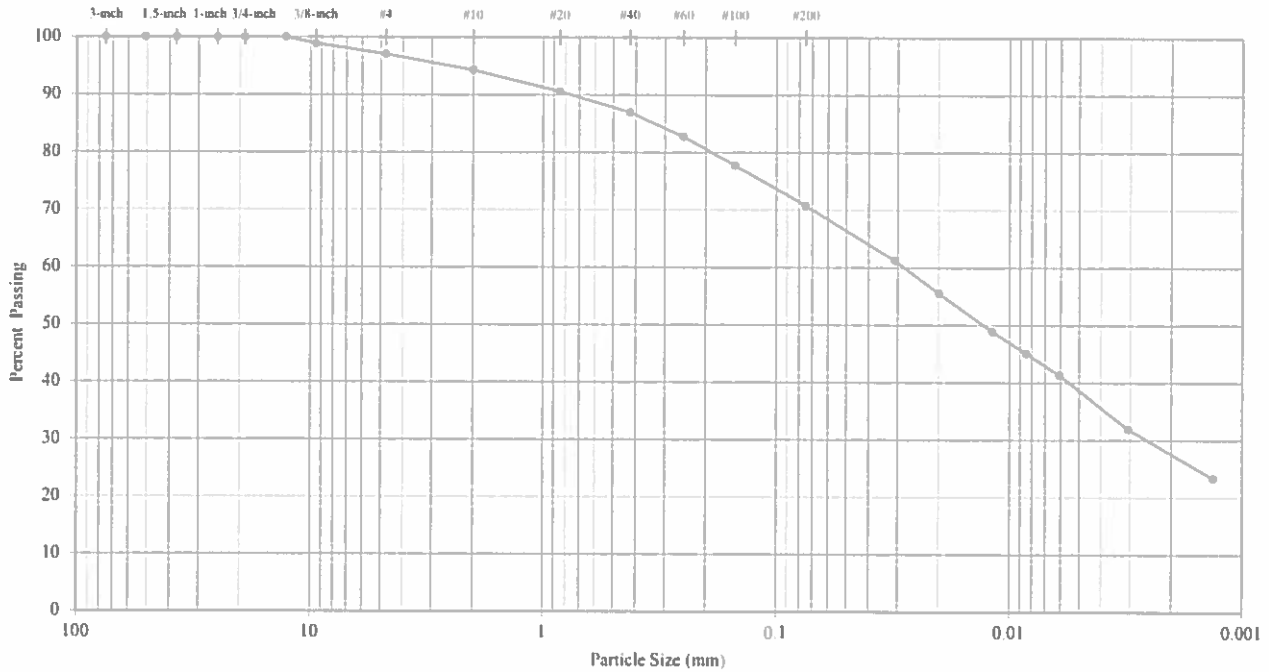

Sieve	Particle Size		Description	Percentage
	Sieve	(mm)		
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
1/2-inch	12.7	100.0	Fine Gravel	2.90
3/8-inch	9.5	98.9		
#4	4.75	97.1	Coarse Sand	2.77
#10	2.0	94.3		
#20	0.85	90.6		
#40	0.425	87.0		
#60	0.25	82.7	Medium Sand	7.35
#100	0.15	77.7		
#200	0.075	70.8	Fine Sand	16.19
	0.031	61.2		
	0.020	55.5	Silt or Clay Fines	70.79
	0.012	48.9		
	0.008	45.1		
	0.006	41.3		
	0.003	31.9		
	0.001	23.3		

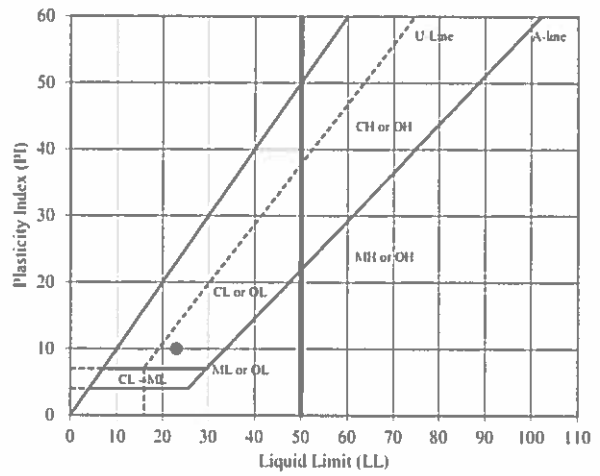

USCS Description (ASTM D 2487):
 Dark grayish brown, LEAN CLAY WITH SAND,
 trace gravel

LL	PL	PI	LI
23	13	10	-0.15

As-Received Moisture Content (%): 11.5

USCS Group Symbol: CL


Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS
DATE	9/8/2019
CHECK	BAB
REVIEW	<i>[Signature]</i>


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-02**
 TYPE: **Bag**

DEPTH (ft): 0.5-1.0

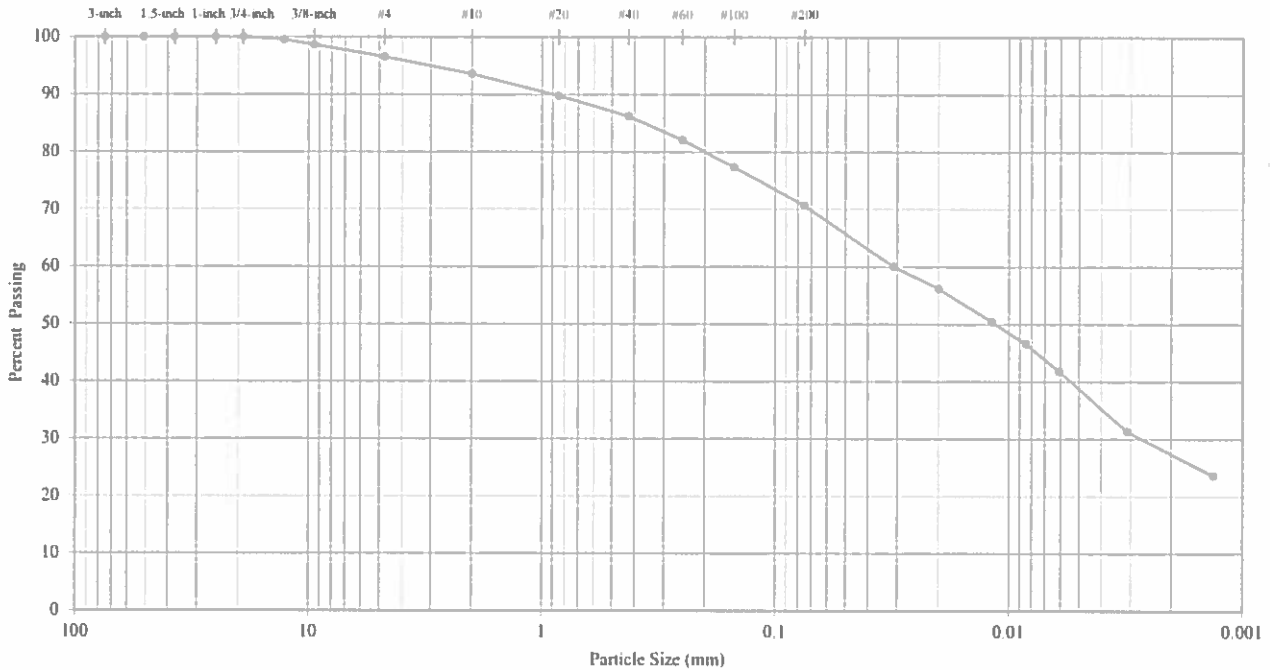

Sieve	Particle Size	% Passing	Description	Percentage
	(mm)			
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
1/2-inch	12.7	99.6	Fine Gravel	3.44
3/8-inch	9.5	98.7		
#4	4.75	96.6	Coarse Sand	2.94
#10	2.0	93.6		
#20	0.85	89.8		
#40	0.425	86.2	Medium Sand	7.42
#60	0.25	82.1		
#100	0.15	77.4	Fine Sand	15.55
#200	0.075	70.7		
	0.031	60.1		
	0.020	56.2	Silt or Clay Fines	70.66
	0.012	50.5		
	0.008	46.6		
	0.006	41.8		
	0.003	31.3		
	0.001	23.6		

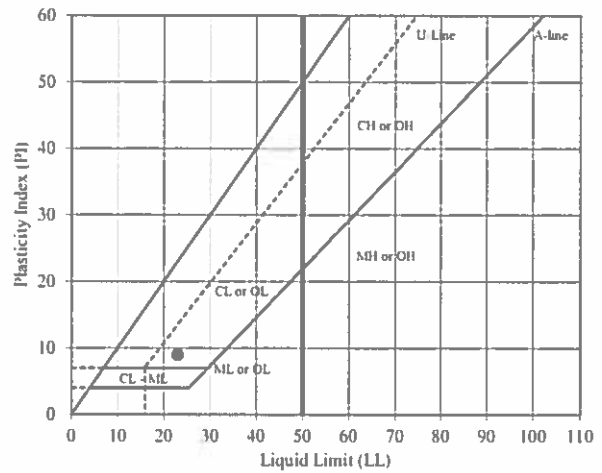

USCS Description (ASTM D 2487):
Dark grayish brown, LEAN CLAY WITH SAND, trace gravel

LL	PL	PI	LI
23	14	9	-0.24

As-Received Moisture Content (%): **11.9**

USCS Group Symbol: **CL**

Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS
DATE	9/8/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>




PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
SAMPLE ID: PC-03
TYPE: Bulk

DEPTH (ft) 0.5-1.0



Sieve	Particle Size		Description	Percentage
	(mm)	% Passing		
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
1/2-inch	12.7	98.1	Fine Gravel	4.69
3/8-inch	9.5	97.4		
#4	4.75	95.3		
#10	2.0	92.4	Coarse Sand	2.88
#20	0.85	88.5		
#40	0.425	84.5	Medium Sand	7.96
#60	0.25	80.2		
#100	0.15	74.8	Fine Sand	16.72
#200	0.075	67.8		
	0.031	59.9	Silt or Clay Fines	67.76
	0.020	55.1		
	0.012	49.4		
	0.008	43.6		
	0.006	39.8		
	0.003	32.1		
	0.001	24.3		

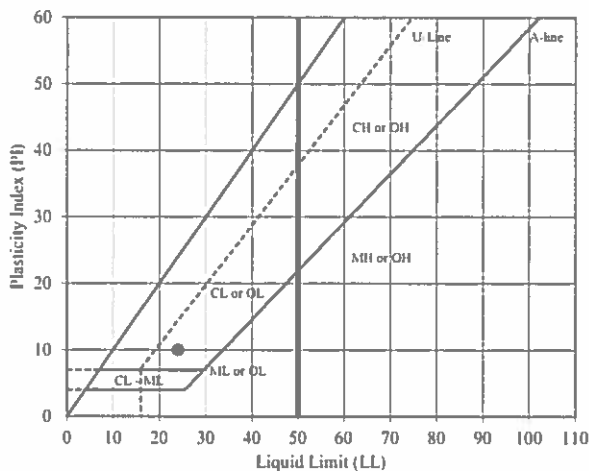

USCS Description (ASTM D 2487):
Dark gray, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
24	14	10	-0.46

As-Received Moisture Content (%)
9.4

USCS Group Symbol
CL

Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
(2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS/DW
DATE	9/13/2019
CHECK	AB
REVIEW	DMC


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**


SAMPLE ID: **PC-04**

DEPTH (ft): **0.5-1.0**

TYPE: **Bulk**

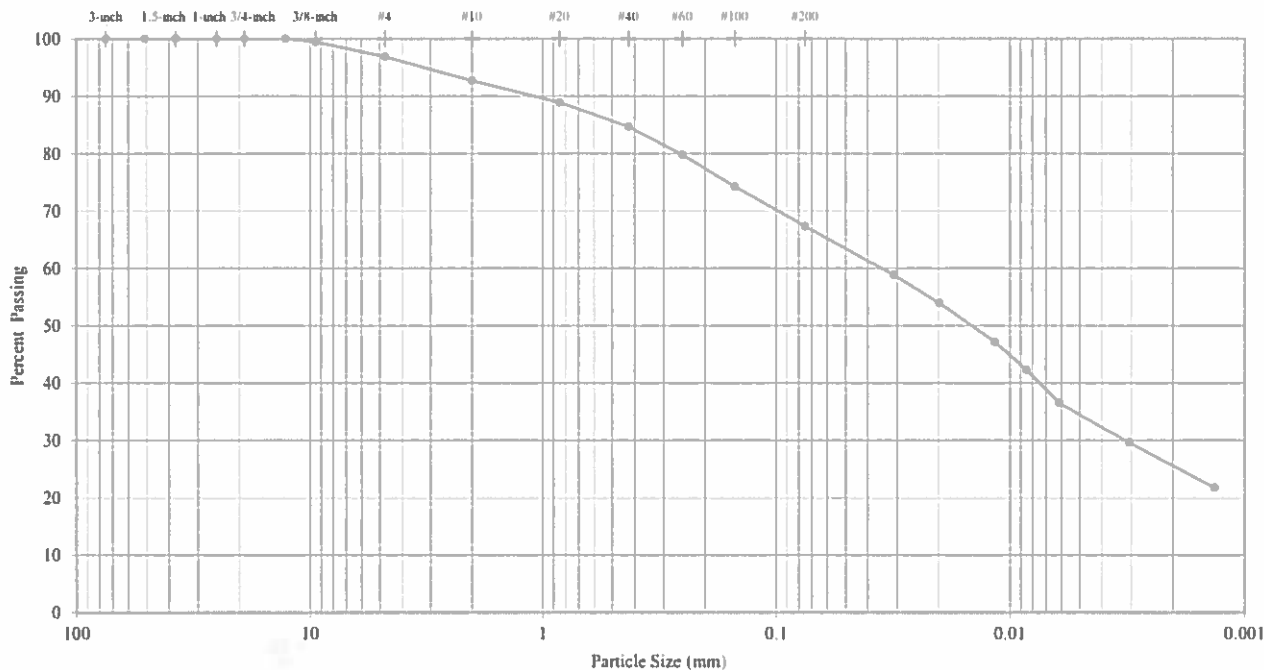

	Particle Size		Description	Percentage	
	Sieve	(mm)			
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	Cobbles	0.00	
	2-inch	50.8	Coarse Gravel	0.00	
	1.5-inch	37.5			
	1-inch	25.0			
	3/4-inch	19.0	Fine Gravel	3.12	
	1/2-inch	12.7			
	3/8-inch	9.5			
	#4	4.75	96.9	Coarse Sand	4.14
	#10	2.0	92.7		
	#20	0.85	88.9		
Hydrometer Analysis	#40	0.425	84.7	Medium Sand	8.03
	#60	0.25	79.8		
	#100	0.15	74.3		
	#200	0.075	67.3	Fine Sand	17.41
		0.031	58.9		
		0.020	54.0		
		0.012	47.2	Silt or Clay Fines	67.29
		0.008	42.3		
		0.006	36.5		
		0.003	29.7		
	0.001	21.8			

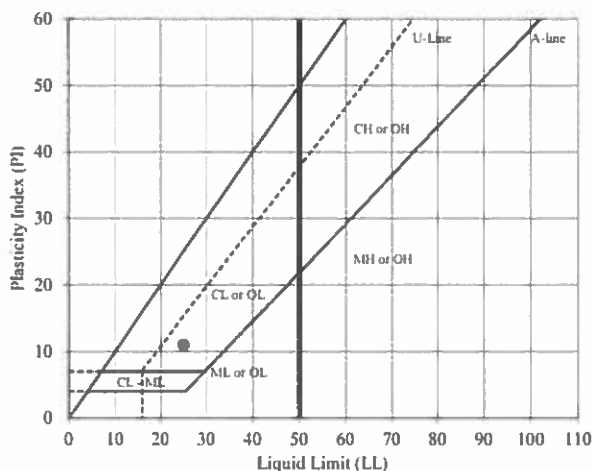

USCS Description (ASTM D 2487):

Dark gray, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
25	14	11	-0.44

As-Received Moisture Content (%):

9.1

USCS Group Symbol:

CL


- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling Method A Liquid Limit test performed using manual device.

TECH: TDS/DW
 DATE: 9/13/2019
 CHECK: AB
 REVIEW: [Signature]

PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318


PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-05**
 TYPE: **Bulk**

DEPTH (ft) **0.5-1.0**

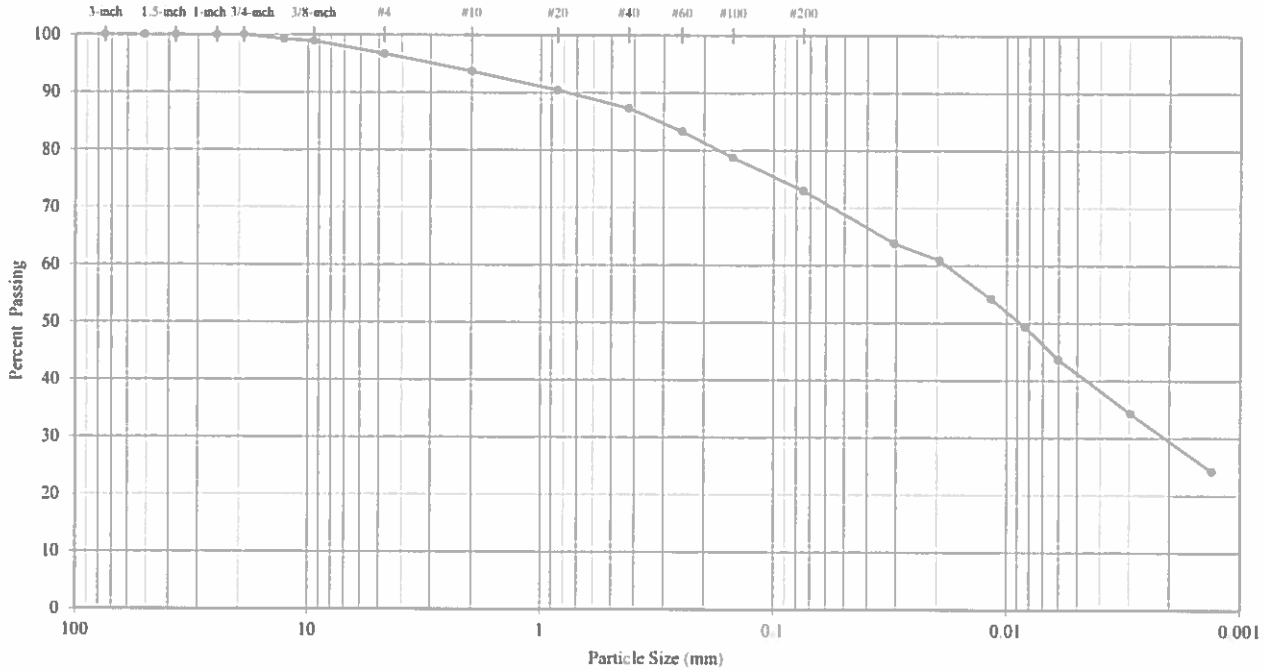

	Particle Size		Description	Percentage		
	Sieve	(mm)				
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	100.0	Cobbles	0.00	
	2-inch	50.8	100.0	Coarse Gravel	0.00	
	1.5-inch	37.5	100.0			
	1-inch	25.0	100.0			
		3/4-inch	19.0	100.0	Fine Gravel	3.33
		1/2-inch	12.7	99.3		
		3/8-inch	9.5	99.0	Coarse Sand	2.99
	#4	4.75	96.7			
	#10	2.0	93.7			
	#20	0.85	90.5			
	#40	0.425	87.3	Medium Sand	6.39	
	#60	0.25	83.3			
	#100	0.15	78.7	Fine Sand	14.30	
	#200	0.075	73.0			
		0.031	63.8			Silt or Clay Fines
Hydrometer Analysis		0.020	60.9			
		0.012	54.2			
		0.008	49.4			
		0.006	43.7			
		0.003	34.3			
		0.001	24.2			

USCS Description (ASTM D 2487):
**Dark grayish brown, LEAN CLAY WITH SAND,
 trace gravel**

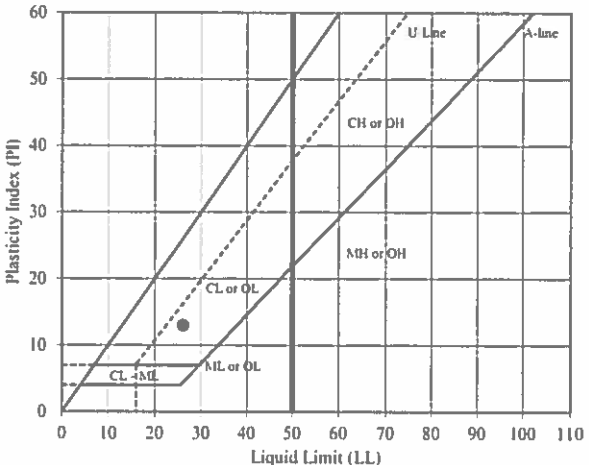

LL	PL	PI	LI
26	13	13	-0.48

As-Received Moisture Content (%):
6.7

USCS Group Symbol:
CL


Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: TDS/DW
 DATE: 9/24/2019
 CHECK: *[Signature]*
 REVIEW: *[Signature]*


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-06**
 TYPE: **Bulk**

DEPTH (ft) -

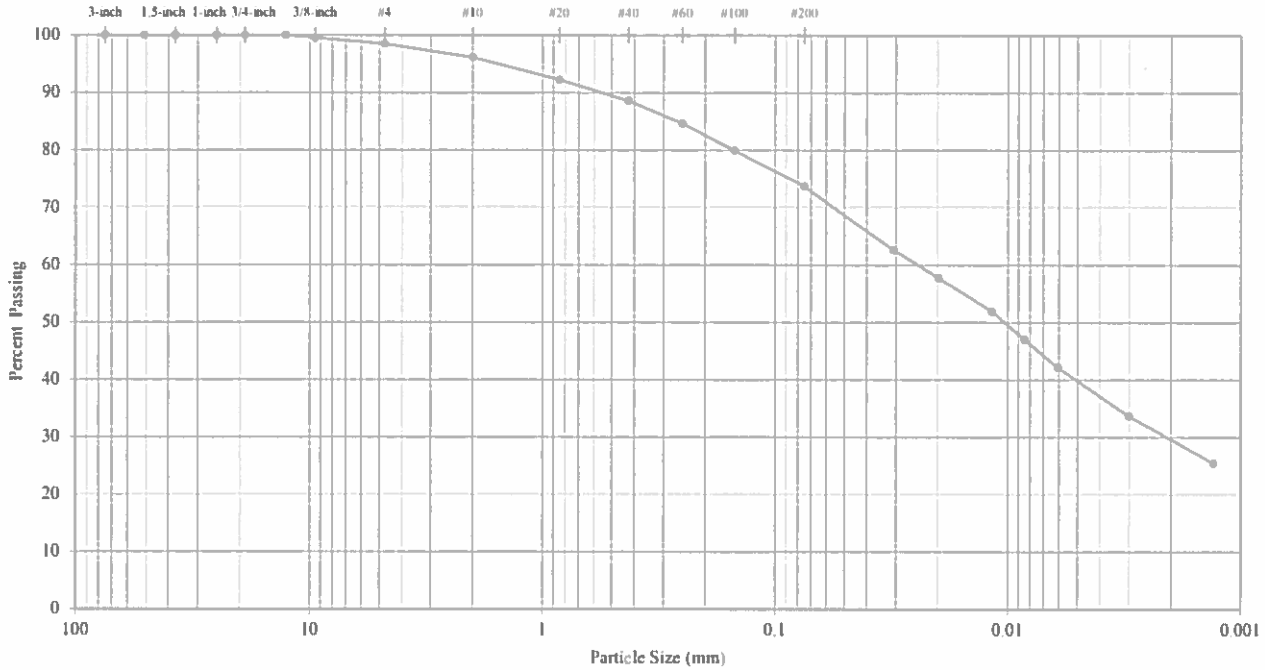

Sieve Analysis (Initial Separation on No. 4 Sieve)	Particle Size		Description	Percentage		
	Sieve	(mm)				
	3-inch	75.0	Cobbles	0.00		
	2-inch	50.8	Coarse Gravel	0.00		
	1.5-inch	37.5				
	1-inch	25.0				
	3/4-inch	19.0				
	1/2-inch	12.7	Fine Gravel	1.50		
	3/8-inch	9.5				
	#4	4.75	Coarse Sand	2.34		
	#10	2.0				
	#20	0.85				
	#40	0.425				
	#60	0.25				
	#100	0.15	Medium Sand	7.54		
	#200	0.075				
			Fine Sand	14.90		
Hydrometer Analysis		0.031			Silt or Clay Fines	73.73
		0.020				
		0.012				
		0.008				
		0.006				
		0.003				
		0.001				

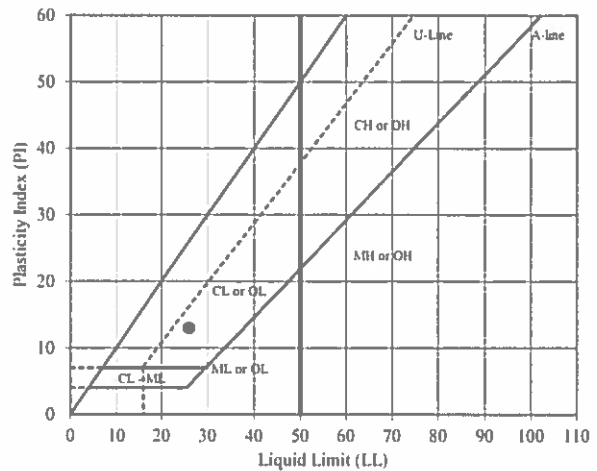

USCS Description (ASTM D 2487):
Dark grayish brown, LEAN CLAY WITH SAND, trace gravel

LL	PL	PI	LI
26	13	13	-0.36

As-Received Moisture Content (%): **8.3**

USCS Group Symbol: **CL**


Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: TDS/DW
 DATE: 9/24/2019
 CHECK: [Signature]
 REVIEW: [Signature]


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-07**
 TYPE: **Bulk**

DEPTH (ft): -

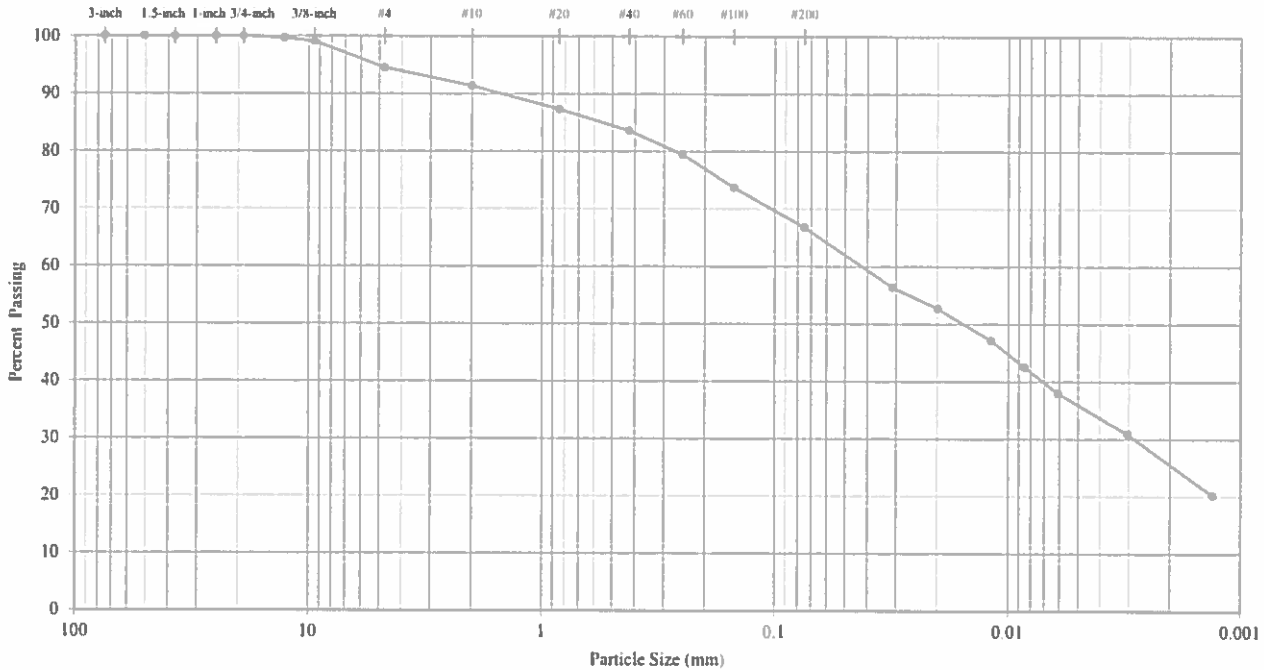

Sieve	Particle Size	% Passing	Description	Percentage
	(mm)			
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
1/2-inch	12.7	99.7	Fine Gravel	5.50
3/8-inch	9.5	99.1		
#4	4.75	94.5	Coarse Sand	3.12
#10	2.0	91.4		
#20	0.85	87.3		
#40	0.425	83.6	Medium Sand	7.79
#60	0.25	79.5		
#100	0.15	73.7	Fine Sand	16.79
#200	0.075	66.8		
Hydrometer Analysis	0.031	56.4	Silt or Clay Fines	66.81
	0.020	52.7		
	0.012	47.2		
	0.009	42.5		
	0.006	38.0		
	0.003	30.9		
	0.001	20.2		

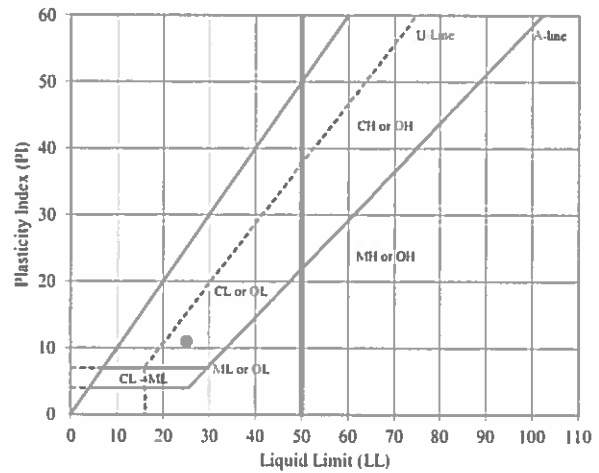

USCS Description (ASTM D 2487):

Dark grayish brown, SANDY LEAN CLAY, little gravel

LL	PL	PI	LI
25	14	11	-0.50

As-Received Moisture Content (%)

8.5

USCS Group Symbol

CL


- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS DW
DATE	9/27/2019
CHECK	<i>AS</i>
REVIEW	<i>[Signature]</i>


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-08**
 TYPE: **Bulk**

DEPTH (A) -

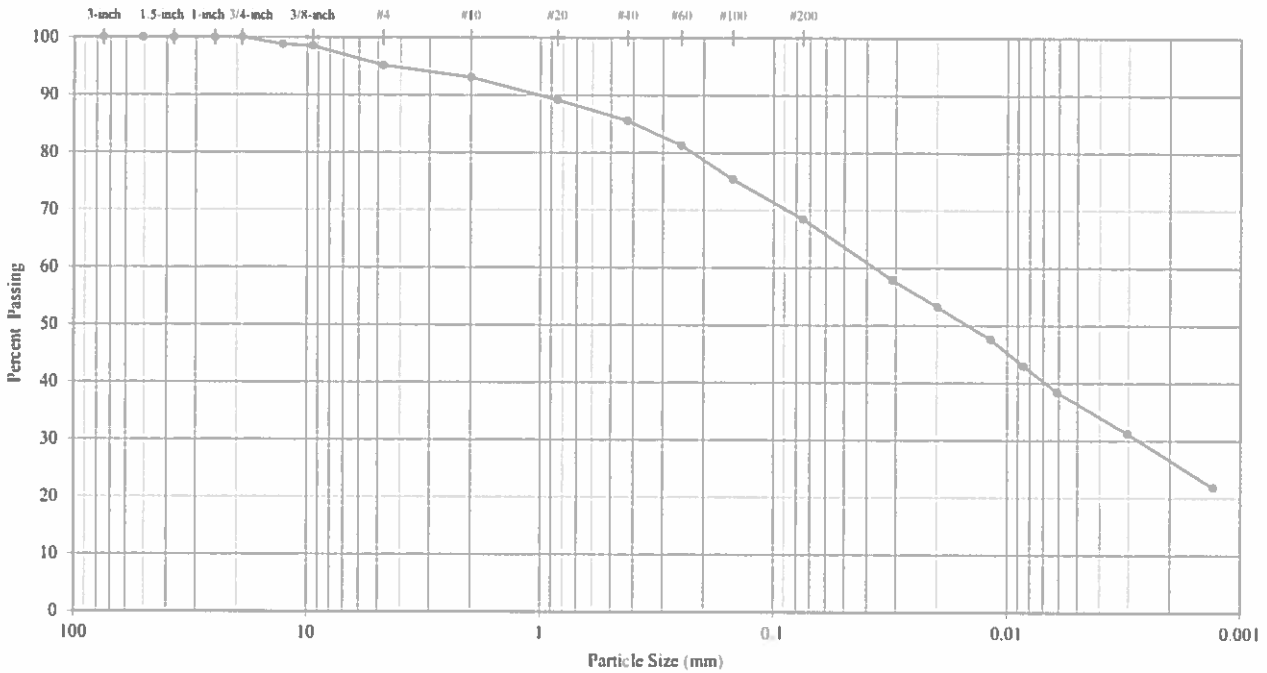

Sieve	Particle Size		Description	Percentage
	(mm)	(No. 4 Sieve)		
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
1/2-inch	12.7	98.8		
3/8-inch	9.5	98.5	Fine Gravel	4.88
#4	4.75	95.1	Coarse Sand	2.01
#10	2.0	93.1		
#20	0.85	89.2		
#40	0.425	85.5	Medium Sand	7.59
#60	0.25	81.3	Fine Sand	17.06
#100	0.15	75.4		
#200	0.075	68.5		
Hydrometer Analysis				
	0.031	57.9	Silt or Clay Fines	68.46
	0.020	53.2		
	0.012	47.6		
	0.009	43.0		
	0.006	38.4		
	0.003	31.2		
	0.001	21.9		

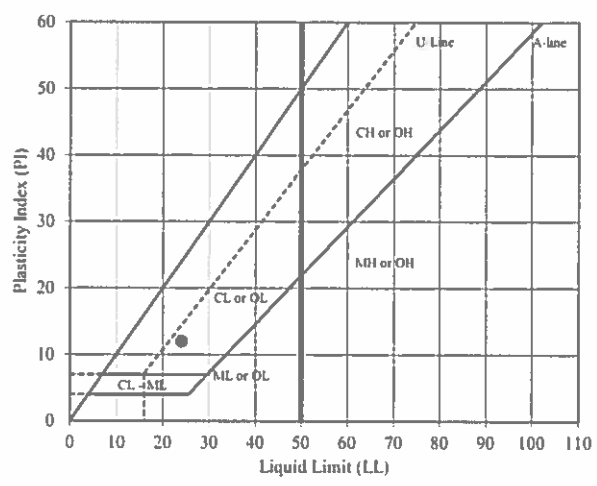

USCS Description (ASTM D 2487):
Dark grayish brown, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
24	12	12	-0.13

As-Received Moisture Content (%):
10.4

USCS Group Symbol:
CL


Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: TDS/DW
 DATE: 9/27/2019
 CHECK: [Signature]
 REVIEW: [Signature]


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond I&2**
 SAMPLE ID: **PC-09**
 TYPE: **Bulk**

DEPTH (ft): **0.5-1.5**

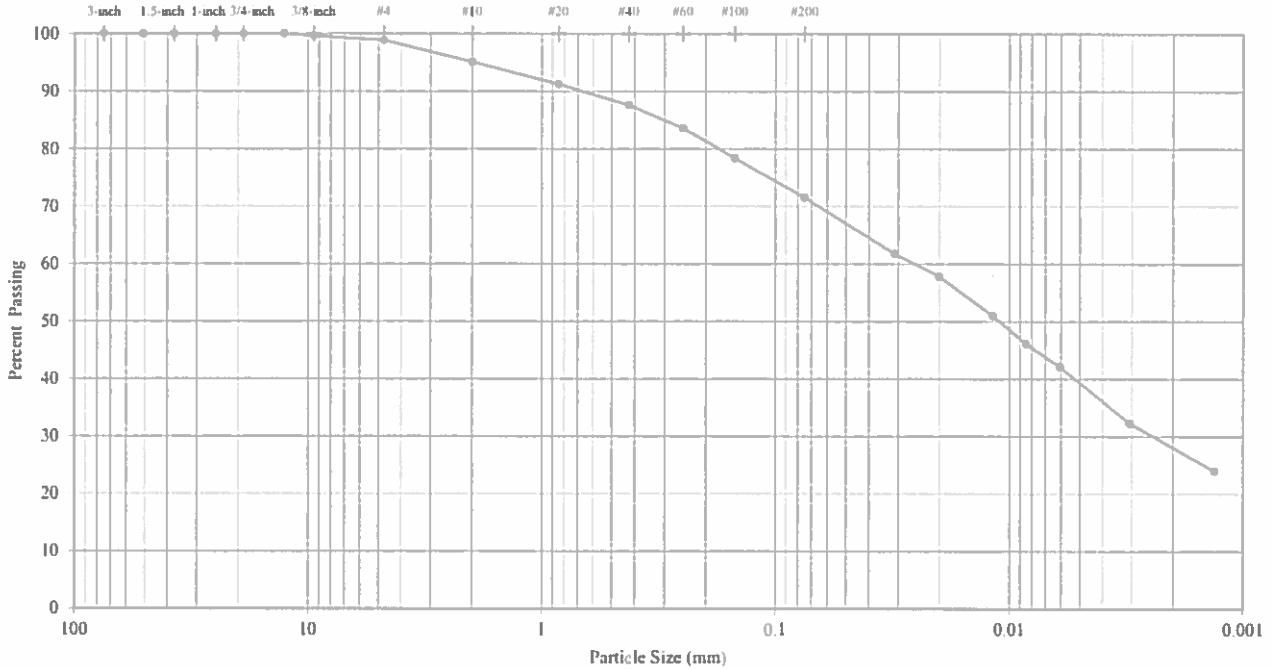

	Particle Size		Description	Percentage
	Sieve	(mm)		
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	Cobbles	0.00
	2-inch	50.8	Coarse Gravel	0.00
	1.5-inch	37.5		
	1-inch	25.0		
	3/4-inch	19.0	Fine Gravel	1.10
	1/2-inch	12.7		
	3/8-inch	9.5	99.7	Medium Sand
#4	4.75	98.9		
#10	2.0	95.1		
#20	0.85	91.3		
#40	0.425	87.7		
#60	0.25	83.6		
#100	0.15	78.4		
Hydrometer Analysis	#200	0.075	Fine Sand	16.13
		0.031	Silt or Clay Fines	71.52
		0.020		
		0.012		
		0.008		
		0.006		
	0.003			
	0.001	24.0		

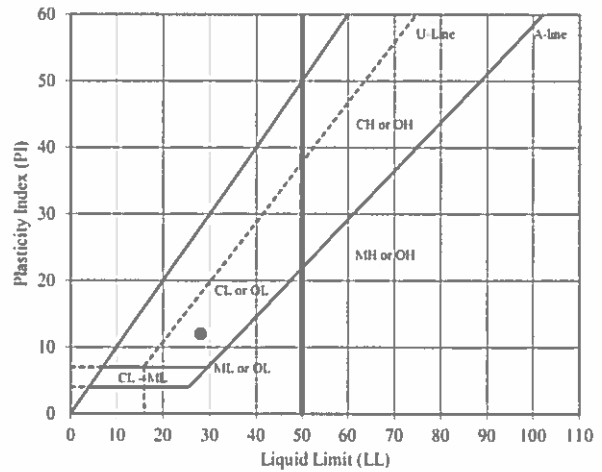

USCS Description (ASTM D 2487):

Dark grayish brown, LEAN CLAY WITH SAND,
trace gravel

LL	PL	PI	LI
28	16	12	-0.44

As-Received Moisture Content (%)

10.8

USCS Group Symbol

CL

Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.


TECH	TDS/DW
DATE	10/11/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>




PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
SAMPLE ID: PC-10
TYPE: Bulk

DEPTH (ft): 0.5-1.0

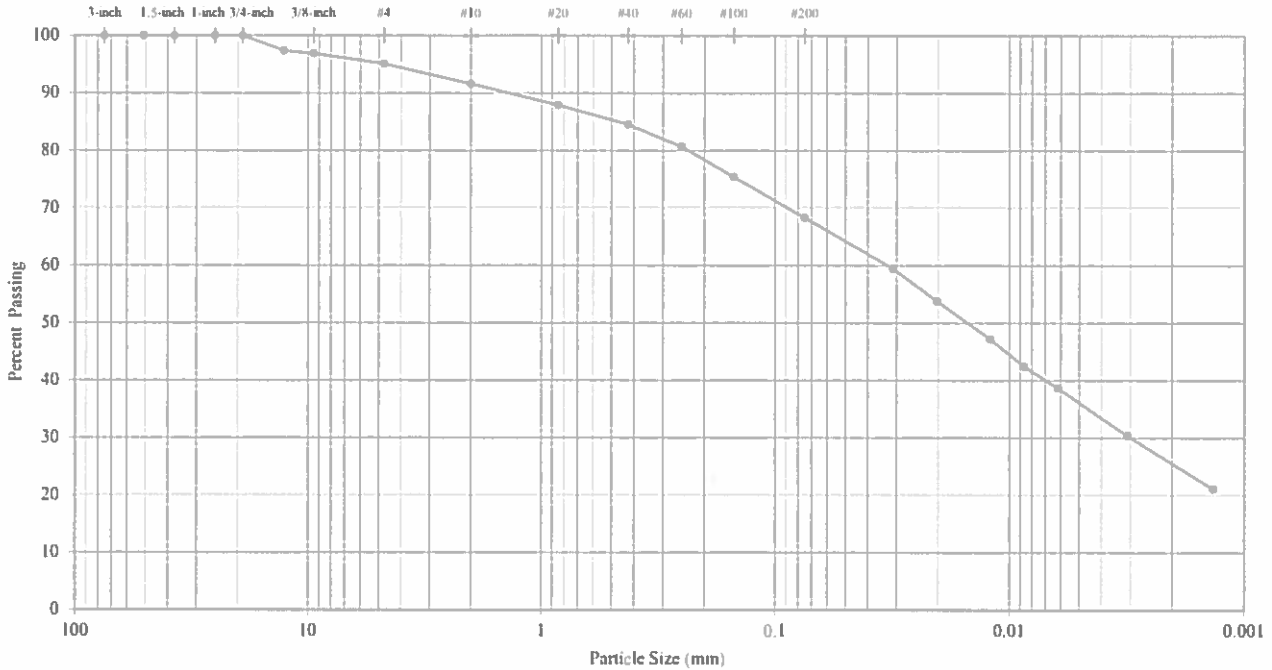

Sieve	Particle Size		Description	Percentage
	(mm)	% Passing		
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
1/2-inch	12.7	97.4	Fine Gravel	4.91
3/8-inch	9.5	96.9		
#4	4.75	95.1	Coarse Sand	3.49
#10	2.0	91.6		
#20	0.85	87.9		
#40	0.425	84.6	Medium Sand	7.04
#60	0.25	80.7		
#100	0.15	75.4	Fine Sand	16.25
#200	0.075	68.3		
	0.031	59.5		
	0.020	53.8		
	0.012	47.2		
	0.009	42.4		
	0.006	38.7		
	0.003	30.4		
	0.001	21.1		

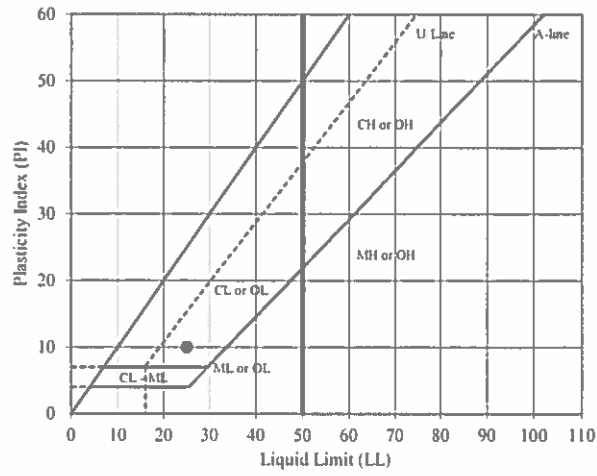

USCS Description (ASTM D 2487):
 Dark grayish brown, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
25	15	10	-0.49

As-Received Moisture Content (%): 10.1

USCS Group Symbol: CL


Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: TDS/DW
 DATE: 10/1/2019
 CHECK: [Signature]
 REVIEW: [Signature]


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-11**
 TYPE: **Bulk**

DEPTH (ft): **0.5-1.0**

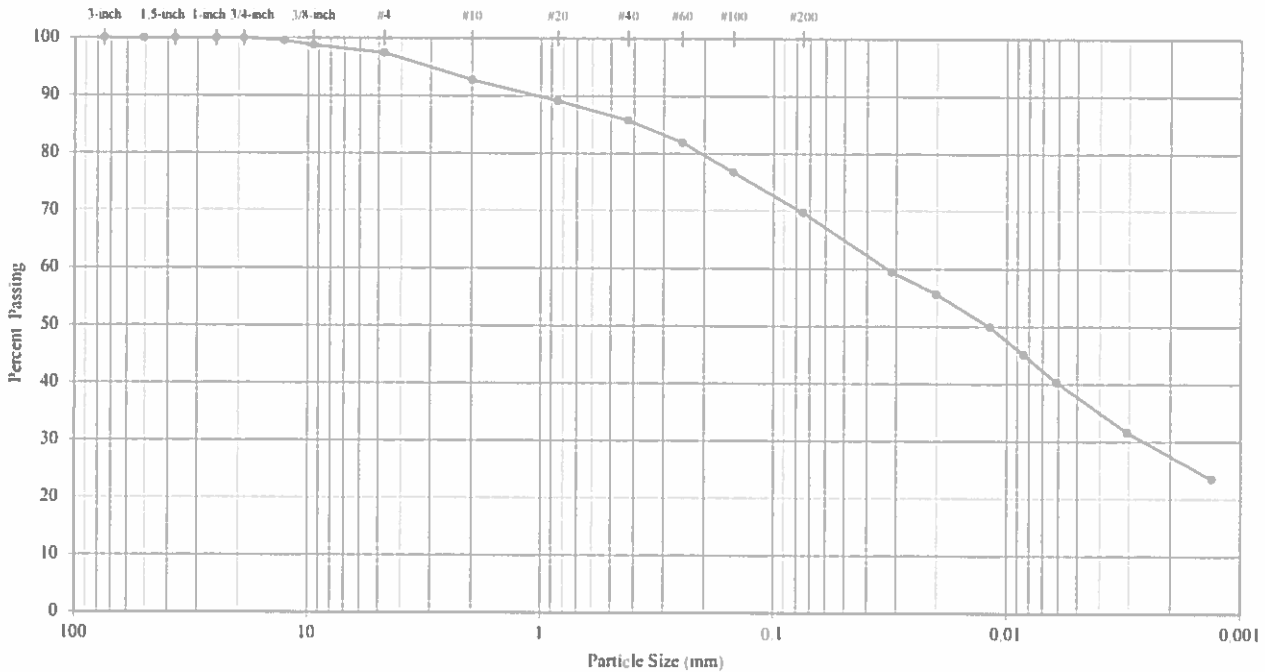

Sieve	Particle Size	% Passing	Description	Percentage	
	(mm)				
3-inch	75.0	100.0	Cobbles	0.00	2.55
2-inch	50.8	100.0	Coarse Gravel	0.00	
1.5-inch	37.5	100.0			
1-inch	25.0	100.0			
3/4-inch	19.0	100.0	Fine Gravel	2.55	
1/2-inch	12.7	99.5			
3/8-inch	9.5	98.8			
#4	4.75	97.5	Coarse Sand	4.72	27.69
#10	2.0	92.7			
#20	0.85	89.2			
#40	0.425	85.8			
#60	0.25	81.9			
#100	0.15	76.8	Fine Sand	16.02	
#200	0.075	69.8			
Hydrometer Analysis	0.032	59.5	Silt or Clay Fines	69.76	
	0.020	55.6			
	0.012	49.9			
	0.008	45.1			
	0.006	40.3			
	0.003	31.6			
	0.001	23.5			

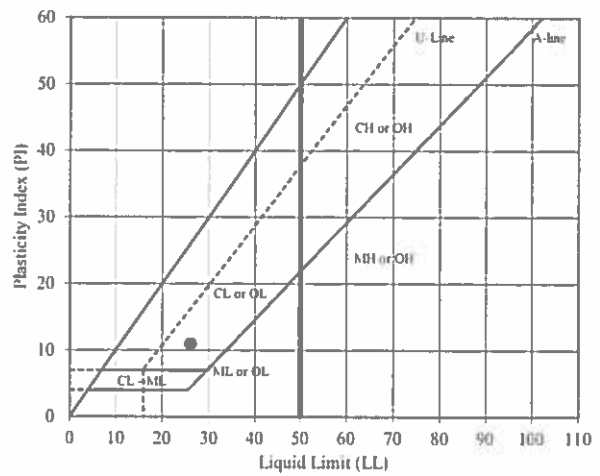

USCS Description (ASTM D 2487):
Dark grayish brown, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
26	15	11	-0.43

As-Received Moisture Content (%):
10.2

USCS Group Symbol:
CL

Notes (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: TDS/DW
 DATE: 10/11/2019
 CHECK: *[Signature]*
 REVIEW: *[Signature]*


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**


SAMPLE ID: **PC-12**

DEPTH (R): **0.5-1.0**

TYPE: **Bulk**

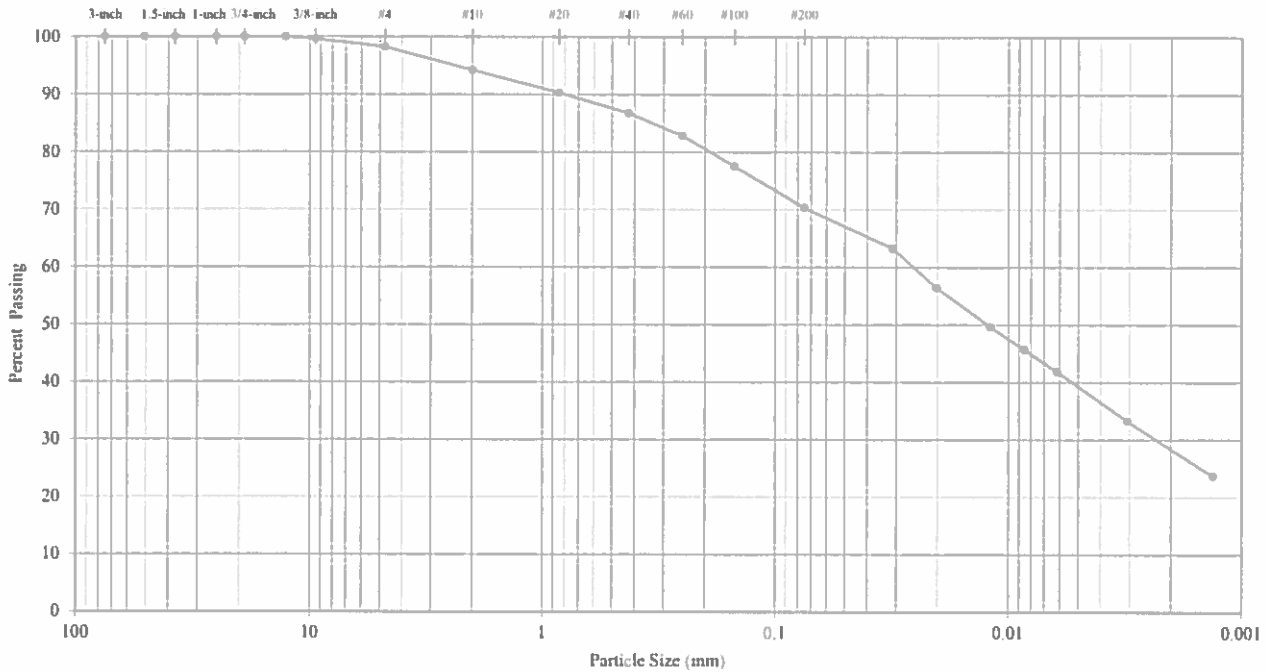

	Particle Size		Description	Percentage
	Sieve	(mm)		
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	Cobbles	0.00
	2-inch	50.8	Coarse Gravel	0.00
	1.5-inch	37.5		
	1-inch	25.0		
	3/4-inch	19.0	Fine Gravel	1.72
	1/2-inch	12.7		
	3/8-inch	9.5		
Hydrometer Analysis	#4	4.75	Coarse Sand	4.07
	#10	2.0		
	#20	0.85	Medium Sand	7.42
	#40	0.425		
	#60	0.25		
	#100	0.15	Fine Sand	16.43
	#200	0.075		
		0.031	Silt or Clay Fines	70.36
		0.020		
		0.012		
	0.009			
	0.006			
	0.003			
	0.001			

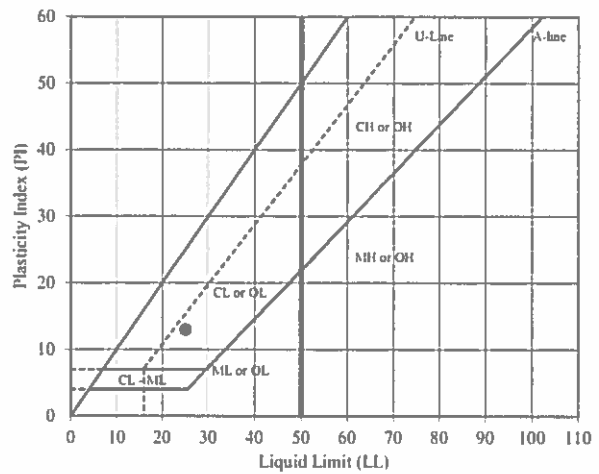

USCS Description (ASTM D 2487):

Dark grayish brown, LEAN CLAY WITH SAND,
trace gravel

LL	PL	PI	LI
25	12	13	0.48

As-Received Moisture Content (%)

18.3

USCS Group Symbol

CL


- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS/DW
DATE	10/11/2019
CHECK	
REVIEW	


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-13**
 TYPE: **Bulk**

DEPTH (ft): **0.5-1.0**

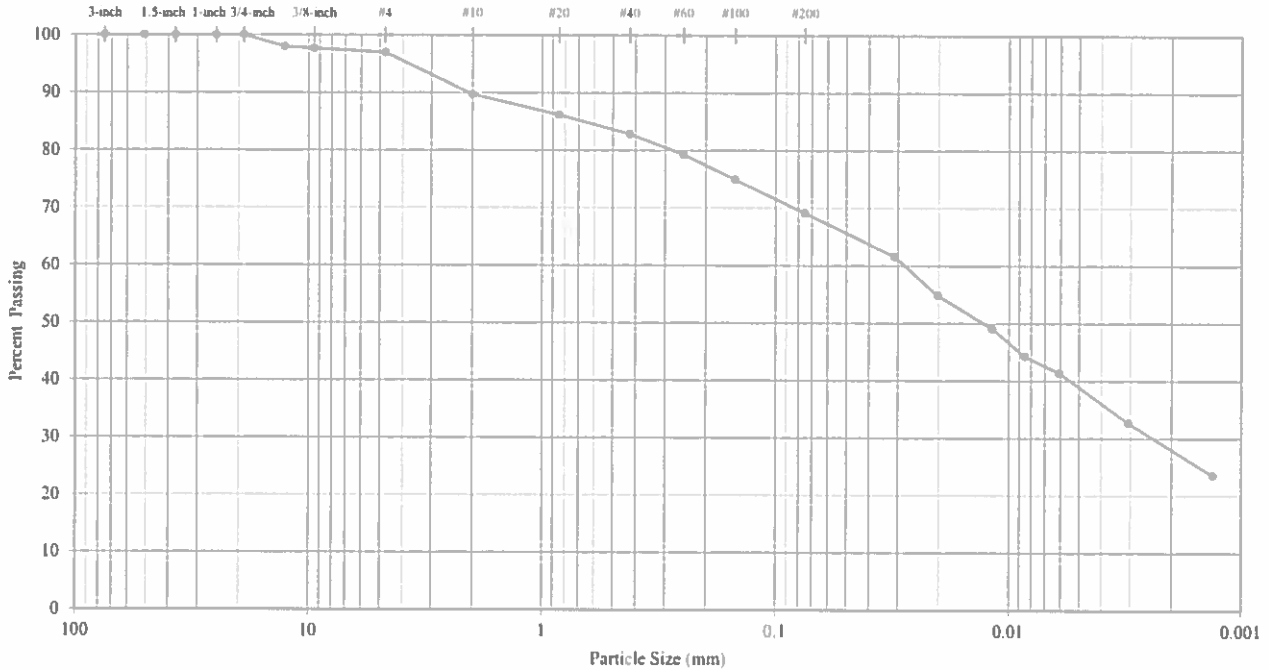

Sieve	Particle Size	% Passing	Description	Percentage
	(mm)			
3-inch	75.0	100.0	Cobbles	0.00
2-inch	50.8	100.0	Coarse Gravel	0.00
1.5-inch	37.5	100.0		
1-inch	25.0	100.0		
3/4-inch	19.0	100.0		
1/2-inch	12.7	98.0	Fine Gravel	3.04
3/8-inch	9.5	97.7		
#4	4.75	97.0	Coarse Sand	7.24
#10	2.0	89.7		
#20	0.85	86.1		
#40	0.425	82.8	Medium Sand	6.88
#60	0.25	79.3		
#100	0.15	74.9	Fine Sand	13.71
#200	0.075	69.1		
Hydrometer Analysis	0.031	61.6	Silt or Clay Fines	69.13
	0.020	54.8		
	0.012	49.1		
	0.009	44.3		
	0.006	41.4		
	0.003	32.7		
0.001	23.6			

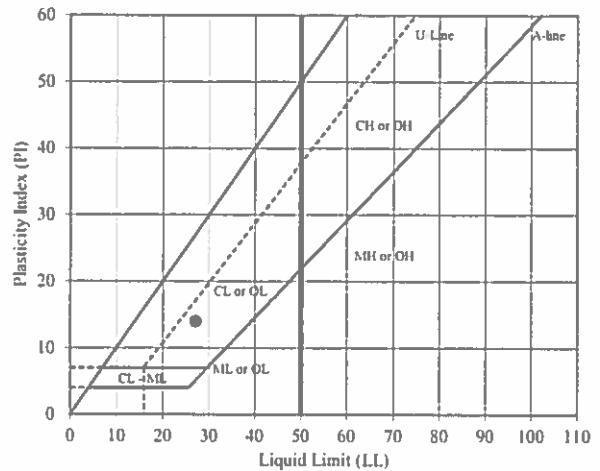

USCS Description (ASTM D 2487):
Dark grayish brown, SANDY LEAN CLAY, trace gravel

LL	PL	PI	LI
27	13	14	-0.09

As-Received Moisture Content (%):

11.7

USCS Group Symbol

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS/DW
DATE	10/11/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>




PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2


SAMPLE ID: PC-14

DEPTH (ft): 0.5-1.0

TYPE: Bulk

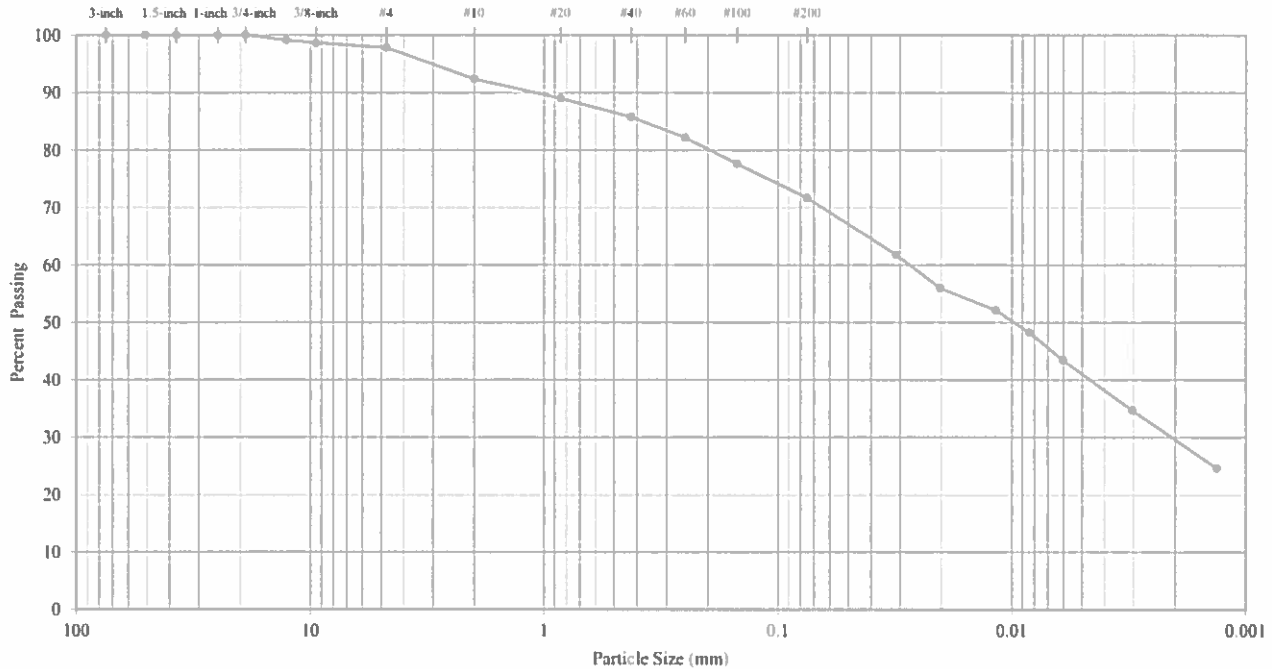

	Particle Size		Description	Percentage		
	Sieve	(mm)				
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	100.0	Cobbles	0.00	
	2-inch	50.8	100.0	Coarse Gravel	0.00	
	1.5-inch	37.5	100.0			
	1-inch	25.0	100.0			
		3/4-inch	19.0	100.0	Fine Gravel	2.16
		1/2-inch	12.7	99.1		
		3/8-inch	9.5	98.6	Coarse Sand	5.46
	#4	4.75	97.8			
	#10	2.0	92.4			
	#20	0.85	89.0	Medium Sand	6.60	
	#40	0.425	85.8			
	#60	0.25	82.1	Fine Sand	14.10	
	#100	0.15	77.6			
	#200	0.075	71.7			
Hydrometer Analysis		0.031	61.8	Silt or Clay Fines	71.67	
		0.020	55.9			
		0.012	52.1			
		0.008	48.3			
		0.006	43.4			
		0.003	34.7			
	0.001	24.6				

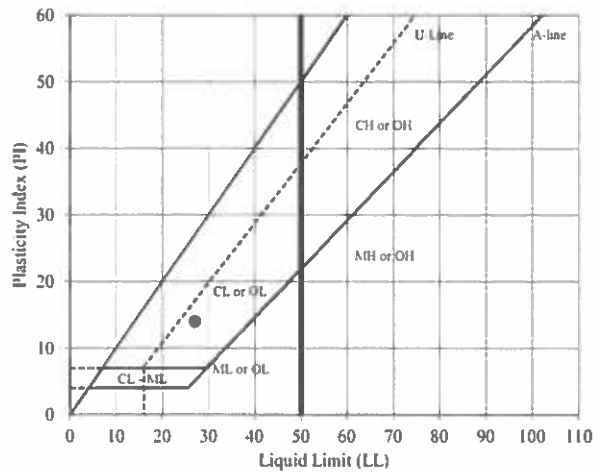

USCS Description (ASTM D 2487):

Dark grayish brown, LEAN CLAY WITH SAND, trace gravel

LL	PL	PI	LI
27	13	14	-0.07

As-Received Moisture Content (%)

12.0

USCS Group Symbol

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS/DW
DATE	10/11/2019
CHECK	[Signature]
REVIEW	[Signature]




PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2


SAMPLE ID: PC-15

DEPTH (R): 0.5-1.0

TYPE: Bulk

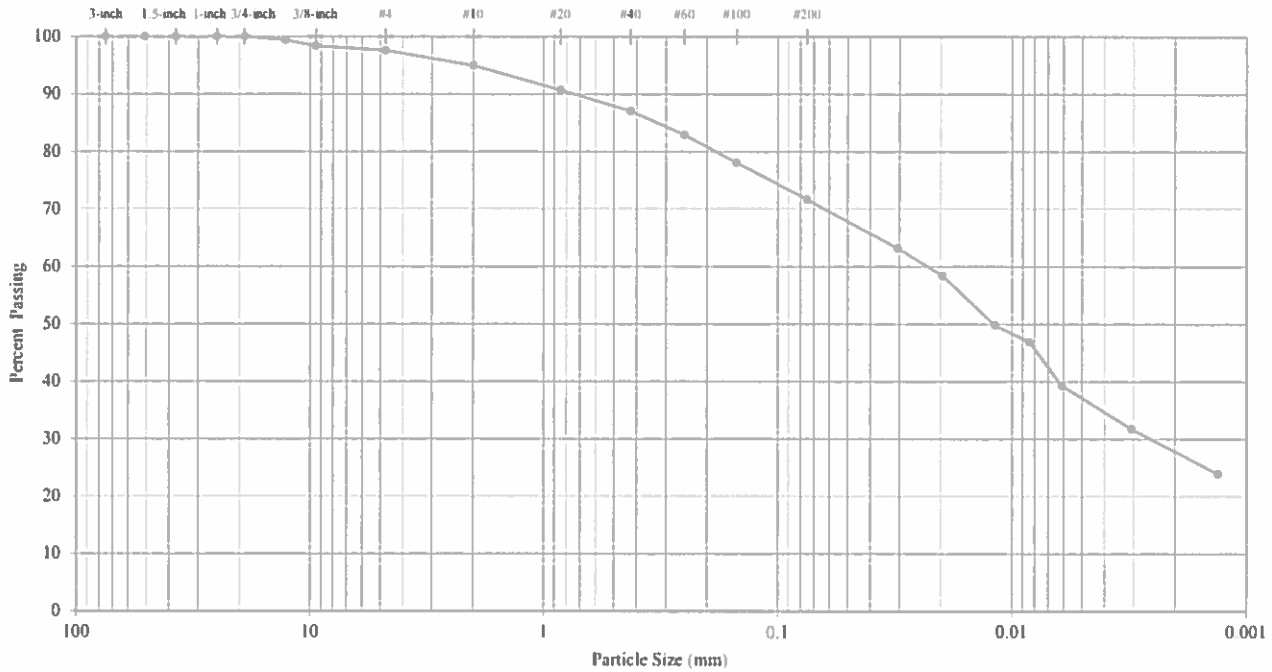

	Particle Size		Description	Percentage		
	Sieve	(mm)				
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	Cobbles	0.00	2.39	
	2-inch	50.8	Coarse Gravel	0.00		
	1.5-inch	37.5		0.00		
	1-inch	25.0		0.00		
	3/4-inch	19.0	100.0	Fine Gravel		2.39
	1/2-inch	12.7	99.4			
	3/8-inch	9.5	98.4			
	#4	4.75	97.6	Coarse Sand		2.64
	#10	2.0	95.0			
	#20	0.85	90.7			
Hydrometer Analysis	#40	0.425	87.1	Medium Sand	7.92	
	#60	0.25	82.9			
	#100	0.15	78.1			
	#200	0.075	71.7	Fine Sand	15.36	
	0.031	63.2				
	0.020	58.4				
	0.012	49.8	Silt or Clay Fines	71.69		
	0.008	46.9				
	0.006	39.3				
	0.003	31.8				
0.001	24.0					

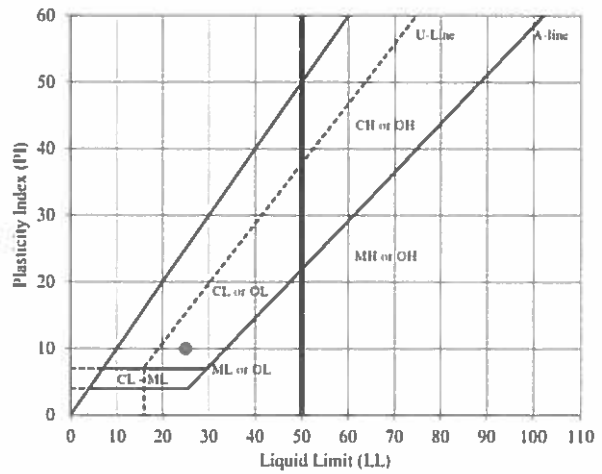

USCS Description (ASTM D 2487):

Dark gray, LEAN CLAY WITH SAND, trace gravel

LL	PL	PI	LI
25	15	10	-0.19

As-Received Moisture Content (%)

13.1

USCS Group Symbol

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH	TDS/ACB
DATE	10/31/2019
CHECK	[Signature]
REVIEW	[Signature]



PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
SAMPLE ID: PC-16
TYPE: Bulk

DEPTH (ft): 0.5-1.0


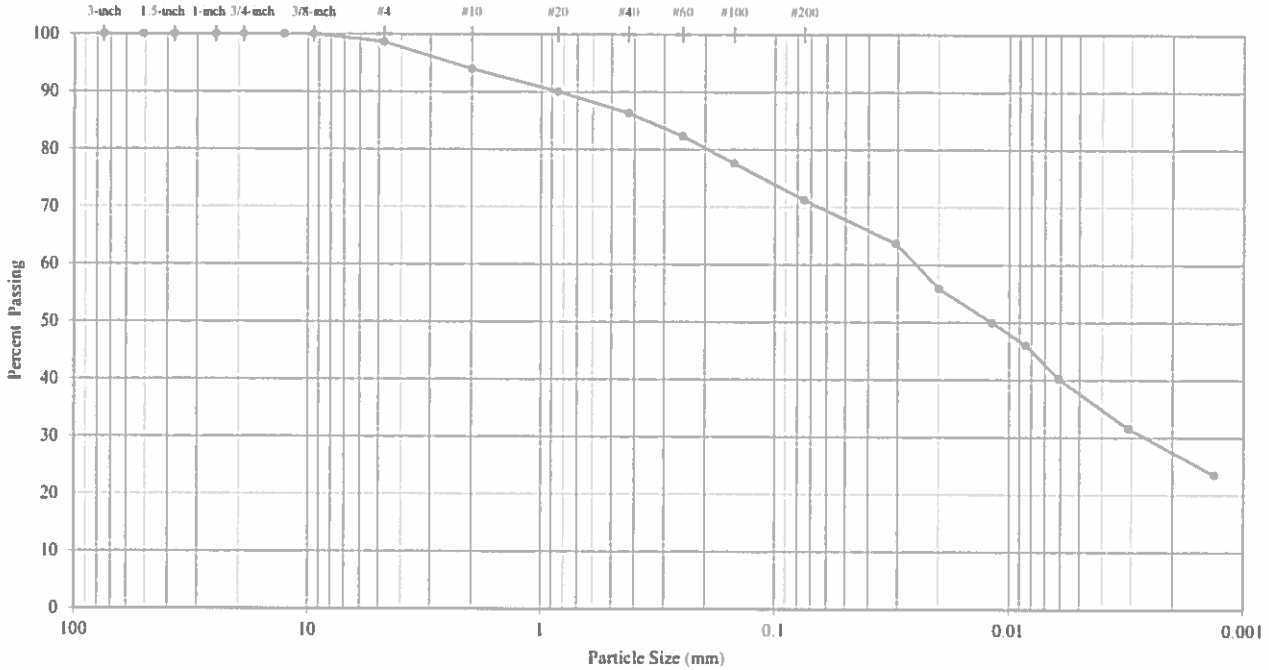


Table with 5 columns: Sieve, Particle Size (mm), % Passing, Description, Percentage. It is divided into Sieve Analysis (Initial Separation on No. 4 Sieve) and Hydrometer Analysis sections.

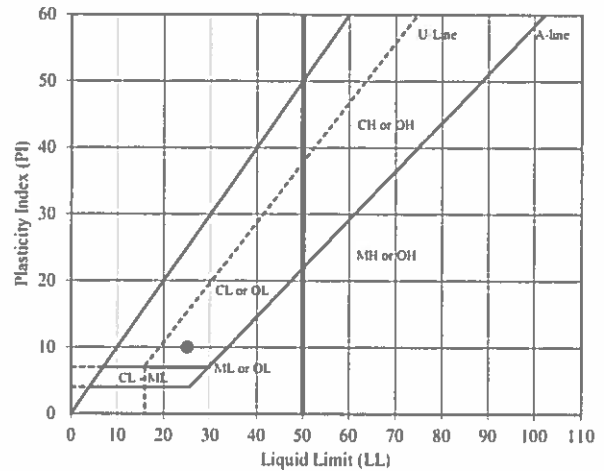

USCS Description (ASTM D 2487):

Dark gray, LEAN CLAY WITH SAND, trace gravel

Table with 4 columns: LL, PL, PI, LI. Values: 25, 15, 10, -0.17

As-Received Moisture Content (%)

13.3

USCS Group Symbol

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
(2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.


TECH: TDS/ACB
DATE: 10/31/2019
CHECK: [Signature]
REVIEW: [Signature]




PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS
ASTM D421, D422, D4318

PROJECT NAME: JR Whiting Pond 1&2
SAMPLE ID: PC-17
TYPE: Bulk

DEPTH (ft): 0.5-1.0

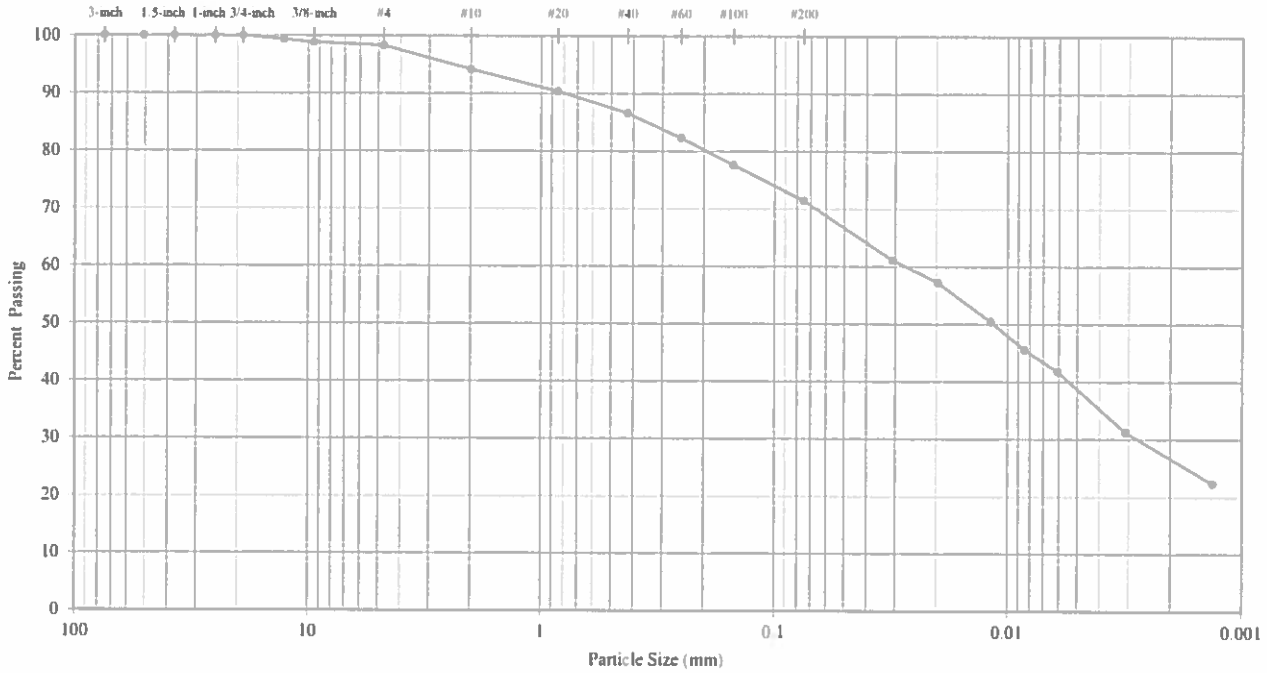

		Particle Size	% Passing	Description	Percentage		
Sieve Analysis (Initial Separation on No. 4 Sieve)		Sieve (mm)					
		3-inch	75.0	Cobbles	0.00	1.68	
		2-inch	50.8	Coarse Gravel	0.00		
		1.5-inch	37.5				
		1-inch	25.0				
		3/4-inch	19.0	Fine Gravel	1.68		
		1/2-inch	12.7				
		3/8-inch	9.5				
		#4	4.75	98.3	26.94		
		#10	2.0	94.2		Coarse Sand	4.13
		#20	0.85	90.3		Medium Sand	7.61
		#40	0.425	86.6			
		#60	0.25	82.3	Fine Sand	15.20	
		#100	0.15	77.6			
		#200	0.075	71.4			
Hydrometer Analysis		0.031	61.1	Silt or Clay Fines	71.38		
		0.020	57.2				
		0.012	50.5				
		0.008	45.6				
		0.006	41.7				
		0.003	31.2				
		0.001	22.3				

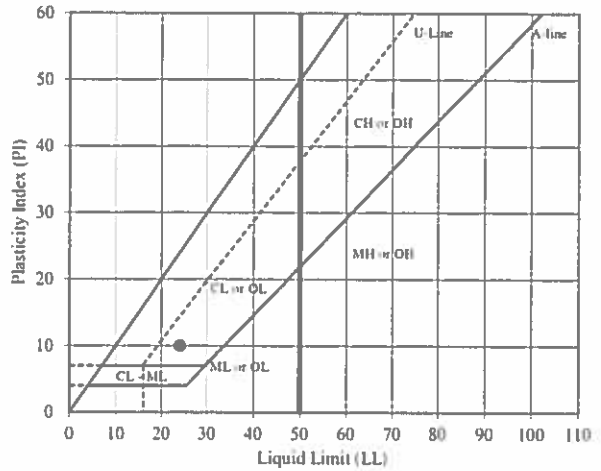

USCS Description (ASTM D 2487):
 Dark gray, LEAN CLAY WITH SAND, trace gravel

LL	PL	PI	LI
24	14	10	0.01

As-Received Moisture Content (%)
 14.1

USCS Group Symbol
 CL


- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
- (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. 40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: TDS/ACB
 DATE: 10/31/2019
 CHECK: [Signature]
 REVIEW: [Signature]


PARTICLE SIZE DISTRIBUTION & ATTERBERG LIMITS ASTM D421, D422, D4318

PROJECT NAME: **JR Whiting Pond 1&2**
 SAMPLE ID: **PC-18**
 TYPE: **Bulk**

DEPTH (ft): **0.5-1.0**

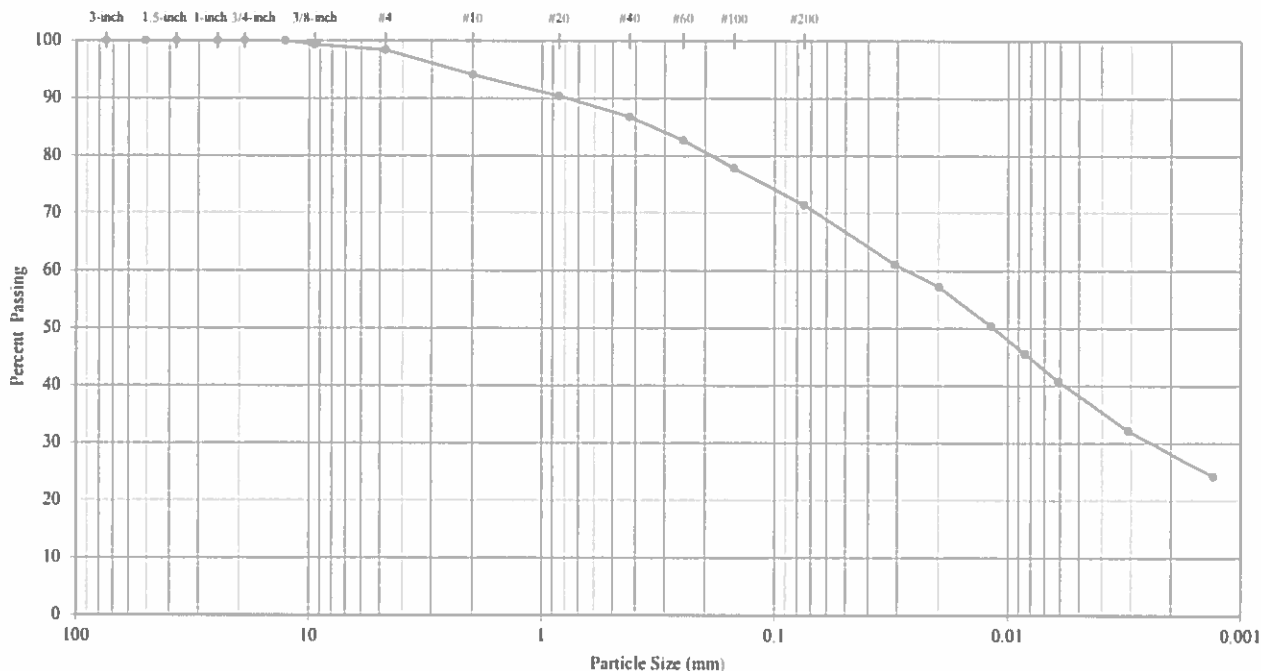

	Particle Size		Description	Percentage		
	Sieve	(mm)				
Sieve Analysis (Initial Separation on No. 4 Sieve)	3-inch	75.0	Cobbles	0.00	1.61	
	2-inch	50.8	Coarse Gravel	0.00		
	1.5-inch	37.5		0.00		
	1-inch	25.0		100.0		
	3/4-inch	19.0	100.0	Fine Gravel		1.61
	1/2-inch	12.7	100.0			
	3/8-inch	9.5	99.3	Coarse Sand		26.92
#4	4.75	98.4				
#10	2.0	94.1				
#20	0.85	90.4				
#40	0.425	86.8				
Hydrometer Analysis	#60	0.25	Medium Sand	7.28	71.47	
	#100	0.15				Fine Sand
	#200	0.075	71.5			
		0.031	61.1	Silt or Clay Fines		
		0.020	57.2			
		0.012	50.5			
		0.008	45.5			
		0.006	40.8			
	0.003	32.2				
	0.001	24.2				

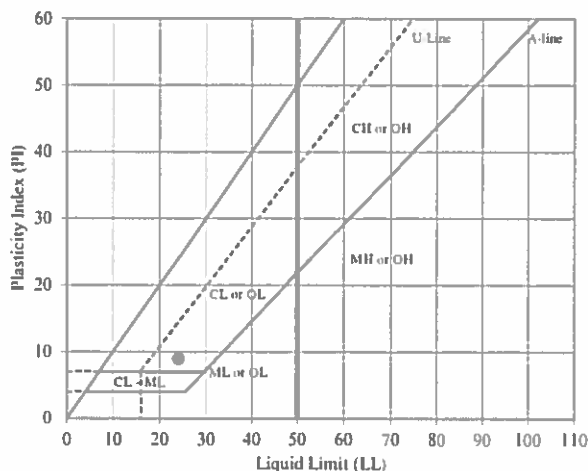

USCS Description (ASTM D 2487):

Dark gray, LEAN CLAY WITH SAND, trace gravel

LL	PL	PI	LI
24	15	9	-0.38

As-Received Moisture Content (%):

11.6

USCS Group Symbol:

CL

- Notes: (1) Particle size analysis sample Mechanically dispersed using Stirring Apparatus A for about 1 Minute.
 (2) Sample prepared for Atterberg Limits testing by the dry method. Material retained on No. #40 sieve removed from Atterberg Limits sample by dry sieving. Plastic Limit test performed by hand rolling. Method A Liquid Limit test performed using manual device.

TECH: **TDS/ACB**
 DATE: **10/31/2019**
 CHECK: *[Signature]*
 REVIEW: *[Signature]*

APPENDIX D.3

Culvert Sand

JR Whiting
Pond 1 and 2
Geotechnical Laboratory Test Results

Sample Identification	Sample Type	Sample Depth (ft)	Soil Classification	In-situ Moisture %	Atterberg Limits				Grain Size Distribution		Modified Proctor		Specific Gravity	Unit Weight		Hydraulic Conductivity (cm/sec)	Additional Tests Conducted (See Notes)
					LL	PL	PI	LI	% Finer #4 sieve	% Finer #200 sieve	Maximum Dry Density (pcf)	Optimum Moisture %		Dry (pcf)	Moisture %		
CS-1	Bulk	-	SP-SM	8.1	-	-	-	-	100.0	6.4	112.4	8.9	-	-	-	-	
CS-2	Bulk	-	SP-SM	16.2	-	-	-	-	99.9	7.9	-	-	-	-	-	-	
CS-3	Bulk	-	SP-SM	16.5	-	-	-	-	99.8	7.4	-	-	-	-	-	-	

ABBREVIATIONS: LIQUID LIMIT (LL)
PLASTIC LIMIT (PL)
PLASTICITY INDEX (PI)
LIQUIDITY INDEX (LI)
SPECIFIC GRAVITY (G_s)
MOISTURE (M_c)

NOTES: T = TRIAXIAL TEST
U = UNCONFINED COMPRESSION TEST
C = CONSOLIDATION TEST
DS = DIRECT SHEAR TEST
O = ORGANIC CONTENT
P = pH
NP = NON-PLASTIC
*Classified Visually

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE PROJECT NO. REMARKS	JR Whiting Ponds 1 & 2	SAMPLE ID SAMPLE TYPE SAMPLE DEPTH (ft)	CS-1
	1788523		Bulk
	Class IIA & Class IIIA		-

WATER CONTENT (Delivered Moisture)			Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1)	171.59	Wet Soil & Tare (gm)	1.00
Wt Dry Soil & Tare (gm)	(w2)	162.57	Dry Soil & Tare (gm)	1.00
Weight of Tare (gm)	(w3)	51.26	Tare Weight (gm)	0.00
Weight of Water (gm)	(w4=w1-w2)	9.02	Moisture Content (%)	0.00%
Weight of Dry Soil (gm)	(w5=w2-w3)	111.31	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture	
Moisture Content (%)	(w4/w5)*100	8.10	Weight Of Sample (gm)	1129.04
			Tare Weight (gm)	369.75
			(W6) Total Dry Weight (gm)	759.29

SIEVE ANALYSIS	Tare Weight	Wt Ret	Cum. Ret.	Cumulative	% PASS	SIEVE
	369.75	+Tare	(Wt-Tare) (dry)	(%Retained) ((wt ret/w6)*100)	(100-%ret)	
3.0"	369.75	0.00	0.00	100.00	3.0"	coarse gravel
2.5"	369.75	0.00	0.00	100.00	2.5"	coarse gravel
2.0"	369.75	0.00	0.00	100.00	2.0"	coarse gravel
1.5"	369.75	0.00	0.00	100.00	1.5"	coarse gravel
1.0"	369.75	0.00	0.00	100.00	1.0"	coarse gravel
0.75"	369.75	0.00	0.00	100.00	0.75"	fine gravel
0.50"	369.75	0.00	0.00	100.00	0.50"	fine gravel
0.375"	369.75	0.00	0.00	100.00	0.375"	fine gravel
#4	369.93	0.18	0.02	99.98	#4	coarse sand
#10	373.20	3.45	0.45	99.55	#10	medium sand
#20	382.68	12.93	1.70	98.30	#20	medium sand
#40	432.25	62.50	8.23	91.77	#40	fine sand
#60	631.94	262.19	34.53	65.47	#60	fine sand
#100	960.17	590.42	77.76	22.24	#100	fine sand
#200	1080.50	710.75	93.61	6.39	#200	finer

% C GRAVEL	0.00	Descriptive Terms > 10% mostly coarse (c) > 10% mostly medium (m) < 10% fine (c-m) < 10% coarse (m-f) < 10% coarse and fine (m) < 10% coarse and medium (f) > 10% equal amounts each (c-f)	LL	-
% F GRAVEL	0.02		PL	-
% C SAND	0.43		PI	-
% M SAND	7.78		Gs	-
% F SAND	85.38			
% FINES	6.39			
% TOTAL	100.00			


VISUAL DESCRIPTION Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS SP-SM

TECH BB
DATE 6/17/2019
CHECK
REVIEW

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

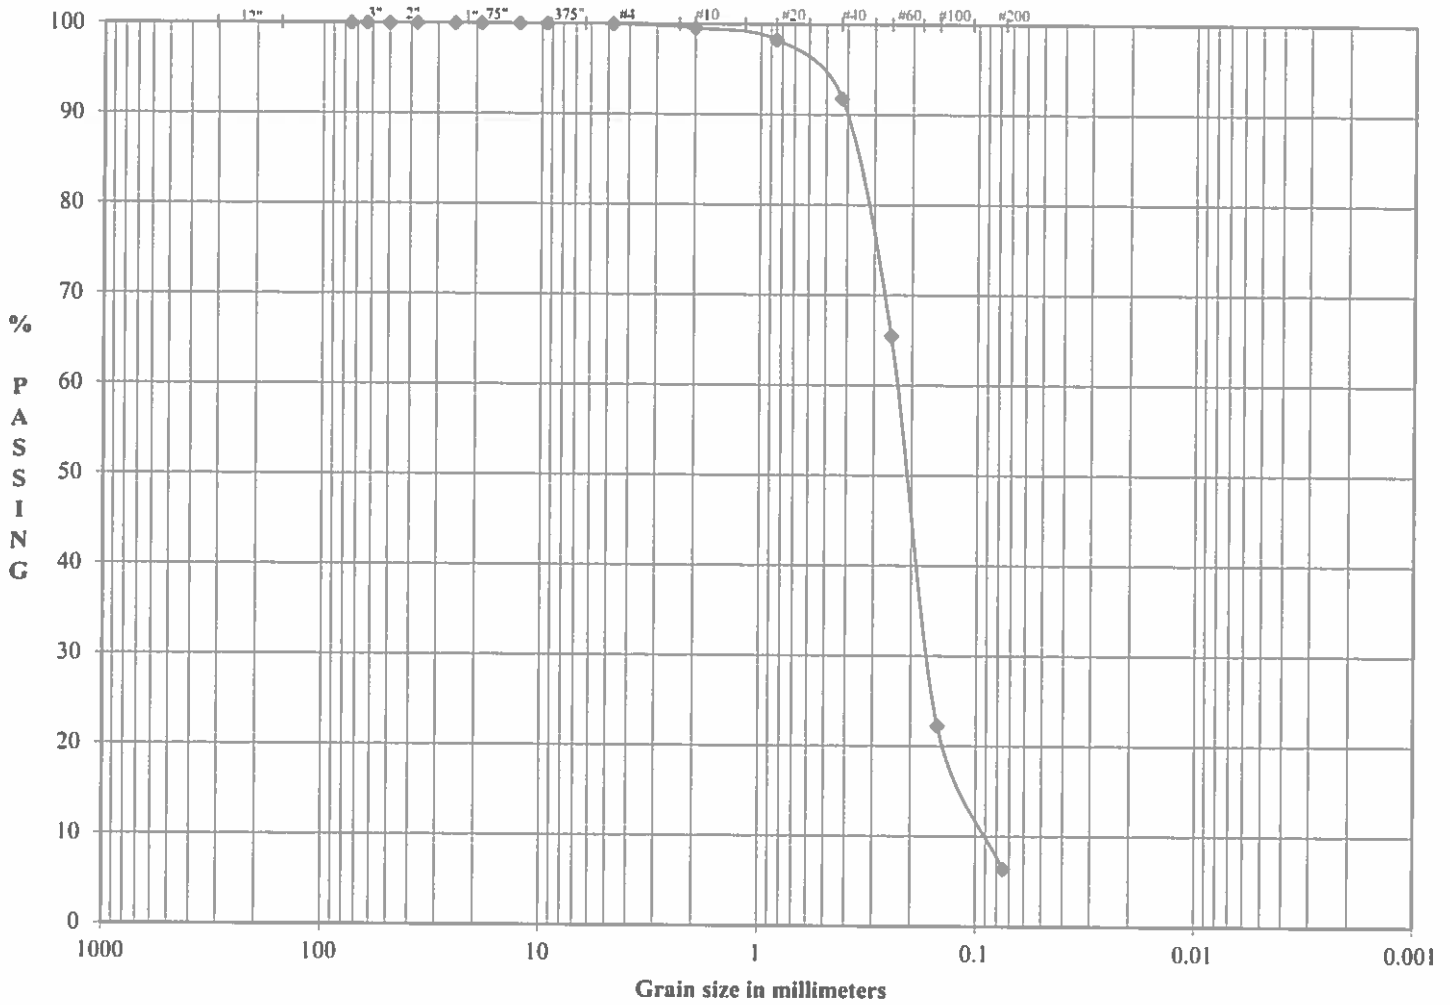

Boulders	Cobbles	Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
		GRAVEL		SAND			FINES
	0.00	0.00	0.02	0.43	7.78	85.38	6.39
		0.02		93.58			

SAMPLE ID	CS-1
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	-

LL	-
PL	-
PI	-

VISUAL DESCRIPTION: Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS: SP-SM


TECH	BB
DATE	6/17/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

LABORATORY COMPACTION CHARACTERISTICS OF SOIL ASTM D1557 - Method A

Mechanical Rammer Moist Preparation

PROJECT NAME: JR Whiting Ponds 1 & 2
 SAMPLE ID: CS-1
 TYPE: Bulk

DEPTH (ft) -

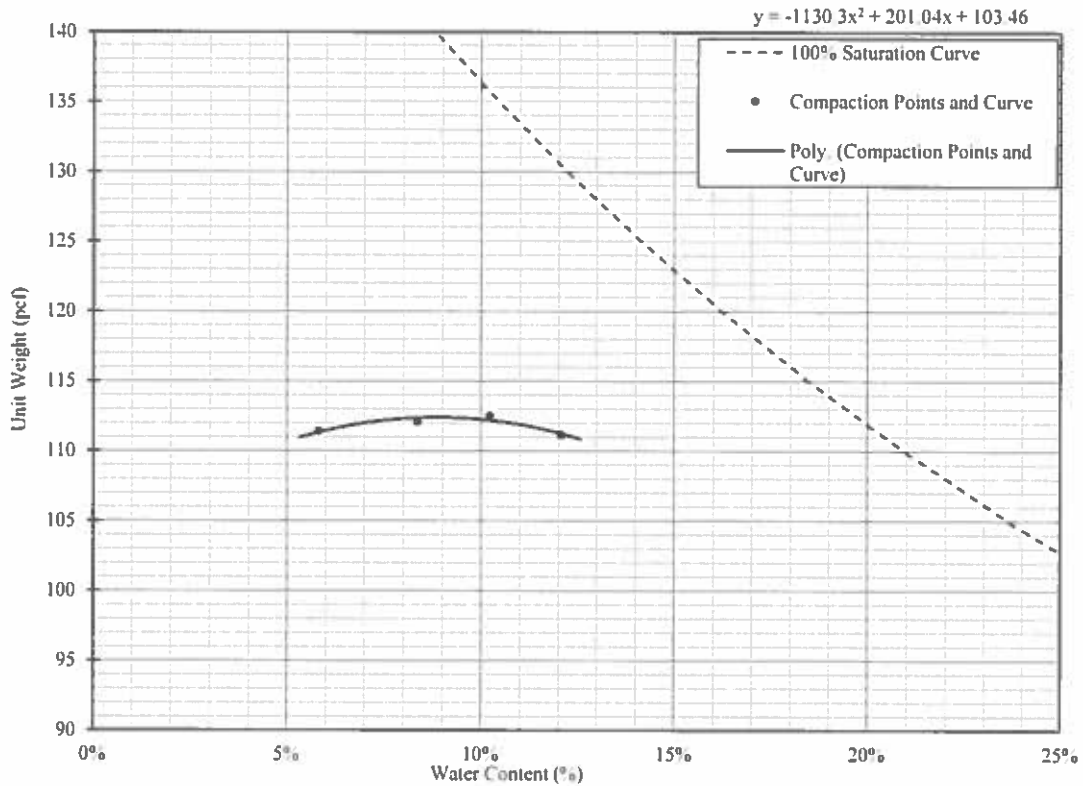

% Test Fraction Passing #4 Sieve	99.98%
As-Received Moisture Content	8.1%
Specific Gravity (assumed)	2.80

Modified Maximum Dry Unit Weight (pcf)	112.4
Modified Optimum Water Content (%)	8.9%

Description: Brown, POORLY GRADED SAND WITH SILT, trace gravel
 USCS: SP-SM

TECH	BB
DATE	6/17/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE	JR Whiting Ponds 1 & 2	SAMPLE ID	CS-2
PROJECT NO.	1788523	SAMPLE TYPE	Bulk
REMARKS	Class IIA & Class IIIA	SAMPLE DEPTH (ft)	0.5-1.0

WATER CONTENT (Delivered Moisture)		Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1) 1237.09	Wet Soil & Tare (gm)	1.00
Wt Dry Soil & Tare (gm)	(w2) 1105.52	Dry Soil & Tare (gm)	1.00
Weight of Tare (gm)	(w3) 295.11	Tare Weight (gm)	0.00
Weight of Water (gm)	(w4=w1-w2) 131.57	Moisture Content (%)	0.00%
Weight of Dry Soil (gm)	(w5=w2-w3) 810.41	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture	
Moisture Content (%)	(w4/w5)*100 16.23	Weight Of Sample (gm)	1105.52
		Tare Weight (gm)	295.11
		(W6) Total Dry Weight (gm)	810.41

SIEVE ANALYSIS		Cum. Ret.	Cumulative	% PASS	SIEVE	
Tare Weight	Wt Ret	(Wt-Tare)	(%Retained)	(100-%ret)		
295.11	+Tare	(dry)	((wt ret.w6)*100)			
3.0"	295.11	0.00	0.00	100.00	3.0"	coarse gravel
2.5"	295.11	0.00	0.00	100.00	2.5"	coarse gravel
2.0"	295.11	0.00	0.00	100.00	2.0"	coarse gravel
1.5"	295.11	0.00	0.00	100.00	1.5"	coarse gravel
1.0"	295.11	0.00	0.00	100.00	1.0"	coarse gravel
0.75"	295.11	0.00	0.00	100.00	0.75"	fine gravel
0.50"	295.11	0.00	0.00	100.00	0.50"	fine gravel
0.375"	295.11	0.00	0.00	100.00	0.375"	fine gravel
#4	296.00	0.89	0.11	99.89	#4	coarse sand
#10	297.05	1.94	0.24	99.76	#10	medium sand
#20	302.97	7.86	0.97	99.03	#20	medium sand
#40	336.70	41.59	5.13	94.87	#40	fine sand
#60	493.40	198.29	24.47	75.53	#60	fine sand
#100	780.05	484.94	59.84	40.16	#100	fine sand
#200	1041.42	746.31	92.09	7.91	#200	finer

% C GRAVEL	0.00	Descriptive Terms > 10% mostly coarse (c) > 10% mostly medium (m) < 10% fine (c-m) < 10% coarse (m-f) < 10% coarse and fine (m) < 10% coarse and medium (f) > 10% equal amounts each (c-f)	LL	-
% F GRAVEL	0.11		PL	-
% C SAND	0.13		PI	-
% M SAND	4.89		Gs	-
% F SAND	86.96			
% FINES	7.91			
% TOTAL	100.00			


VISUAL DESCRIPTION Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS SP-SM

TECH	TDS
DATE	10/22/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

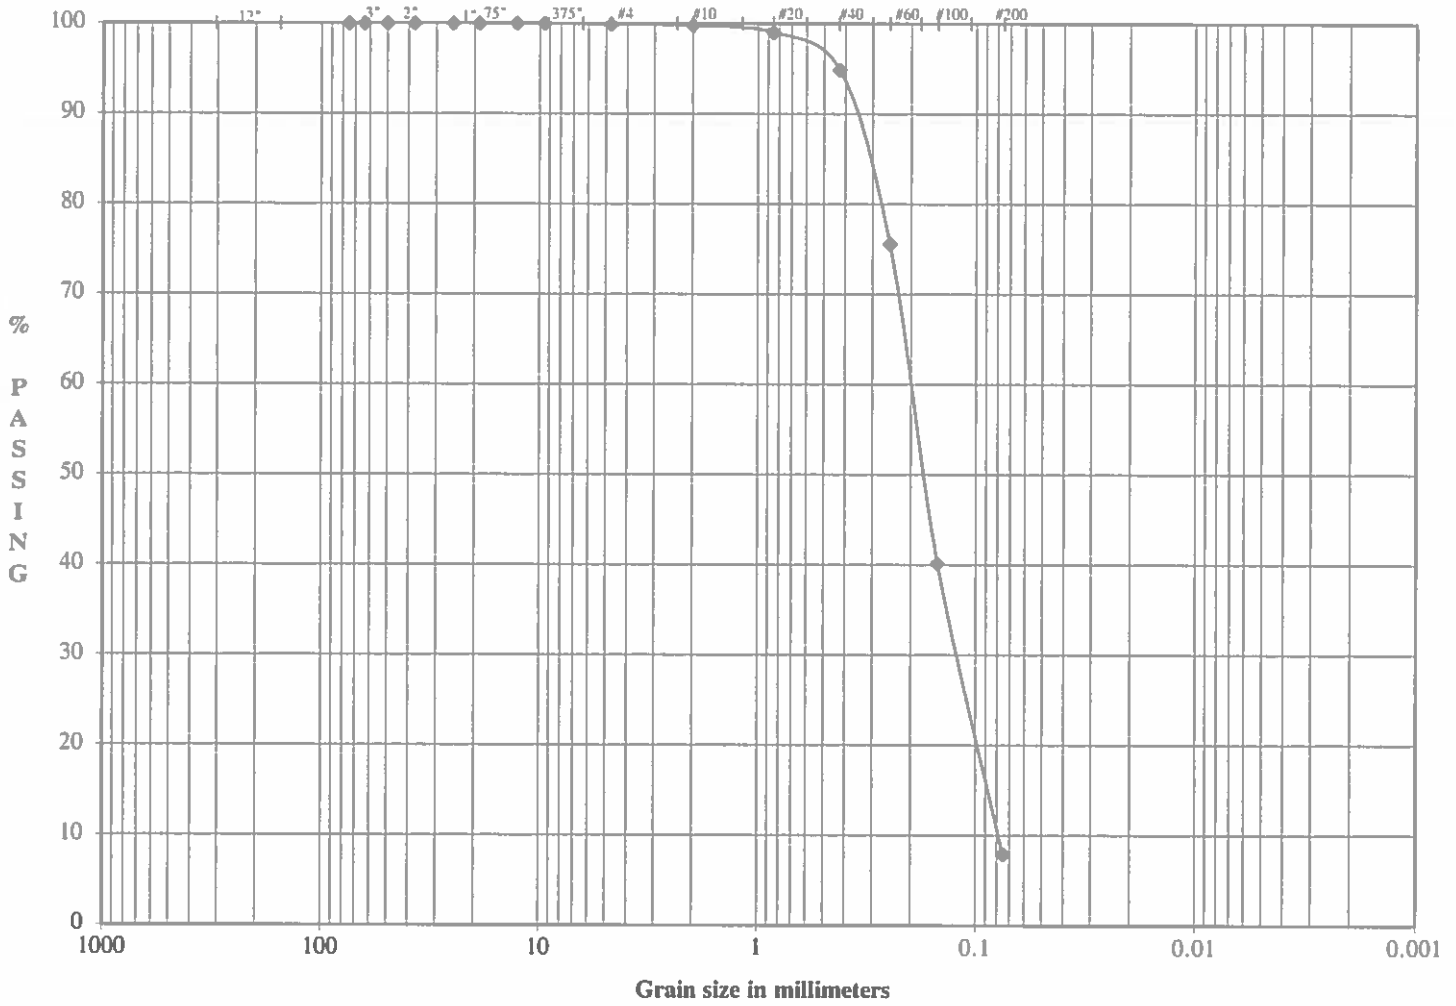

		Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
Boulders	Cobbles	GRAVEL		SAND			FINES
	0.00	0.00	0.11	0.13	4.89	86.96	7.91
		0.11		91.98			

SAMPLE ID	CS-2
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	0.5-1.0

LL	-
PL	-
PI	-

VISUAL DESCRIPTION: Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS: SP-SM

TECH	TDS
DATE	10/22/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE	JR Whiting Ponds 1 & 2	SAMPLE ID	CS-3	
	1788523		SAMPLE TYPE	Bulk
	REMARKS		Class IIA & Class IIIA	SAMPLE DEPTH (ft)

WATER CONTENT (Delivered Moisture)				Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1)	1402.99	Wet Soil & Tare (gm)		1.00
Wt Dry Soil & Tare (gm)	(w2)	1256.86	Dry Soil & Tare (gm)		1.00
Weight of Tare (gm)	(w3)	373.15	Tare Weight (gm)		0.00
Weight of Water (gm)	(w4=w1-w2)	146.13	Moisture Content (%)		0.00%
Weight of Dry Soil (gm)	(w5=w2-w3)	883.71	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture		
Moisture Content (%)	(w4/w5)*100	16.54	Weight Of Sample (gm)		1256.86
			Tare Weight (gm)		373.15
			(W6) Total Dry Weight (gm)		883.71

SIEVE ANALYSIS		Cum. Ret.	Cumulative	% PASS	SIEVE
Tare Weight	Wt Ret	(Wt-Tare)	(%Retained)	% PASS	
373.15	+Tare	(dry)	((wt ret/w6)*100)	(100-%ret)	
3.0"	373.15	0.00	0.00	100.00	3.0" coarse gravel
2.5"	373.15	0.00	0.00	100.00	2.5" coarse gravel
2.0"	373.15	0.00	0.00	100.00	2.0" coarse gravel
1.5"	373.15	0.00	0.00	100.00	1.5" coarse gravel
1.0"	373.15	0.00	0.00	100.00	1.0" coarse gravel
0.75"	373.15	0.00	0.00	100.00	0.75" fine gravel
0.50"	373.15	0.00	0.00	100.00	0.50" fine gravel
0.375"	373.15	0.00	0.00	100.00	0.375" fine gravel
#4	373.30	0.15	0.02	99.98	#4 coarse sand
#10	373.81	0.66	0.07	99.93	#10 medium sand
#20	377.73	4.58	0.52	99.48	#20 medium sand
#40	407.28	34.13	3.86	96.14	#40 fine sand
#60	557.43	184.28	20.85	79.15	#60 fine sand
#100	892.39	519.24	58.76	41.24	#100 fine sand
#200	1191.81	818.66	92.64	7.36	#200 fines

% C GRAVEL	0.00	Descriptive Terms > 10% mostly coarse (c) > 10% mostly medium (m) < 10% fine (c-m) < 10% coarse (m-f) < 10% coarse and fine (m) < 10% coarse and medium (f) > 10% equal amounts each (c-f)	LL	-
% F GRAVEL	0.02		PL	-
% C SAND	0.06		PI	-
% M SAND	3.79		Gs	-
% F SAND	88.78			
% FINES	7.36			
% TOTAL	100.00			


VISUAL DESCRIPTION Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS SP-SM

TECH TDS
DATE 10/22/2019
CHECK
REVIEW

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

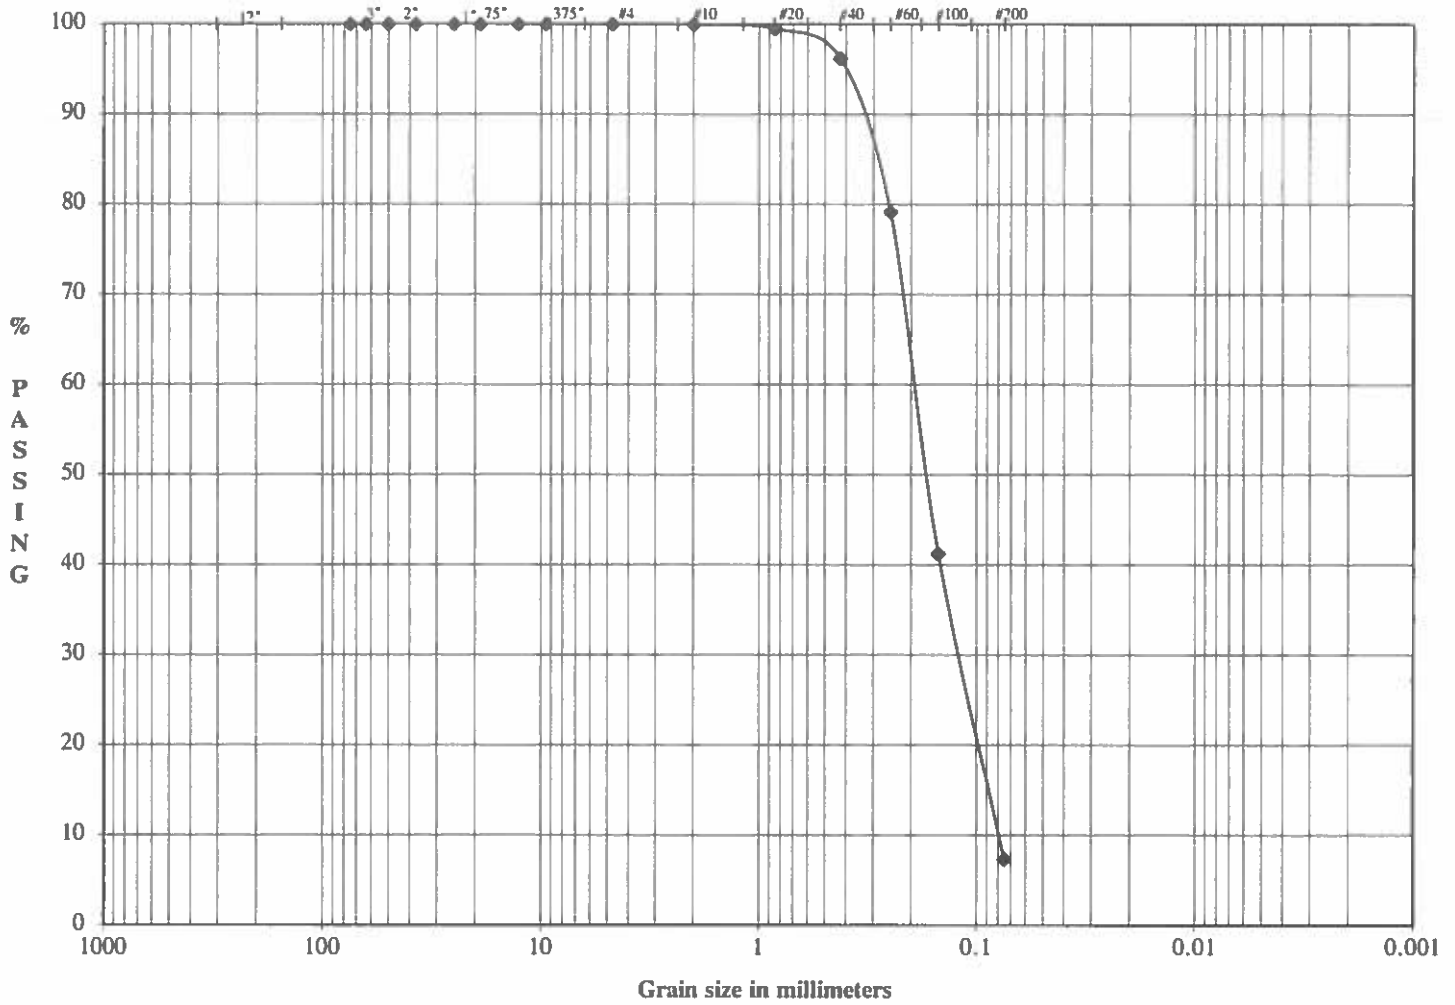

		Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
Boulders	Cobbles	GRAVEL		SAND			FINES
	0.00	0.00	0.02	0.06	3.79	88.78	7.36
		0.02		92.62			

SAMPLE ID	CS-3
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	0.5-1.0

LL	-
PL	-
PI	-

VISUAL DESCRIPTION Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS SP-SM

TECH	TDS
DATE	10/22/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

APPENDIX D.4

Sub-Base for Road

Sample Identification	Sample Type	Sample Depth (ft)	Soil Classification	In-situ Moisture %	Atterberg Limits				Grain Size Distribution		Modified Proctor		Specific Gravity	Unit Weight		Hydraulic Conductivity (cm/sec)	Additional Tests Conducted (See Notes)
					LL	PL	PI	LI	% Finer #4 sieve	% Finer #200 sieve	Maximum Dry Density (pcf)	Optimum Moisture %		Dry (pcf)	Moisture %		
Sample No.																	
CS-1	Bulk	-	SP-SM	8.1	-	-	-	-	100.0	6.4	112.4	8.9	-	-	-	-	

ABBREVIATIONS: LIQUID LIMIT (LL)
 PLASTIC LIMIT (PL)
 PLASTICITY INDEX (PI)
 LIQUIDITY INDEX (LI)
 SPECIFIC GRAVITY (Gs)
 MOISTURE (Mc)

NOTES: T = TRIAXIAL TEST
 U = UNCONFINED COMPRESSION TEST
 C = CONSOLIDATION TEST
 DS = DIRECT SHEAR TEST
 O = ORGANIC CONTENT
 P = pH
 NP = NON-PLASTIC
 * Classified Visually

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE	JR Whiting Ponds 1 & 2	SAMPLE ID	CS-1
PROJECT NO.	1788523	SAMPLE TYPE	Bulk
REMARKS	Class IIA & Class IIIA	SAMPLE DEPTH (ft)	-


WATER CONTENT (Delivered Moisture)		Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1) 171.59	Wet Soil & Tare (gm)	1.00
Wt Dry Soil & Tare (gm)	(w2) 162.57	Dry Soil & Tare (gm)	1.00
Weight of Tare (gm)	(w3) 51.26	Tare Weight (gm)	0.00
Weight of Water (gm)	(w4=w1-w2) 9.02	Moisture Content (%)	0.00%
Weight of Dry Soil (gm)	(w5=w2-w3) 111.31	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture	
Moisture Content (%)	(w4/w5)*100 8.10	Weight Of Sample (gm)	1129.04
		Tare Weight (gm)	369.75
		(W6) Total Dry Weight (gm)	759.29

SIEVE ANALYSIS	Tare Weight	Wt Ret	Cum. Ret.	Cumulative	% PASS	SIEVE
	369.75	+Tare	(Wt-Tare)	(%Retained)	(100-%ret)	
			(dry)	((wt ret/w6)*100)		
3.0"	369.75	0.00	0.00	100.00	3.0"	coarse gravel
2.5"	369.75	0.00	0.00	100.00	2.5"	coarse gravel
2.0"	369.75	0.00	0.00	100.00	2.0"	coarse gravel
1.5"	369.75	0.00	0.00	100.00	1.5"	coarse gravel
1.0"	369.75	0.00	0.00	100.00	1.0"	coarse gravel
0.75"	369.75	0.00	0.00	100.00	0.75"	fine gravel
0.50"	369.75	0.00	0.00	100.00	0.50"	fine gravel
0.375"	369.75	0.00	0.00	100.00	0.375"	fine gravel
#4	369.93	0.18	0.02	99.98	#4	coarse sand
#10	373.20	3.45	0.45	99.55	#10	medium sand
#20	382.68	12.93	1.70	98.30	#20	medium sand
#40	432.25	62.50	8.23	91.77	#40	fine sand
#60	631.94	262.19	34.53	65.47	#60	fine sand
#100	960.17	590.42	77.76	22.24	#100	fine sand
#200	1080.50	710.75	93.61	6.39	#200	finer

% C GRAVEL	0.00	Descriptive Terms > 10% mostly coarse (c) > 10% mostly medium (m) < 10% fine (c-m) < 10% coarse (m-f) < 10% coarse and fine (m) < 10% coarse and medium (f) > 10% equal amounts each (c-f)	LL	-
% F GRAVEL	0.02		PL	-
% C SAND	0.43		PI	-
% M SAND	7.78		Gs	-
% F SAND	85.38			
% FINES	6.39			
% TOTAL	100.00			


VISUAL DESCRIPTION Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS SP-SM

TECH BB
DATE 6/17/2019
CHECK
REVIEW 

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

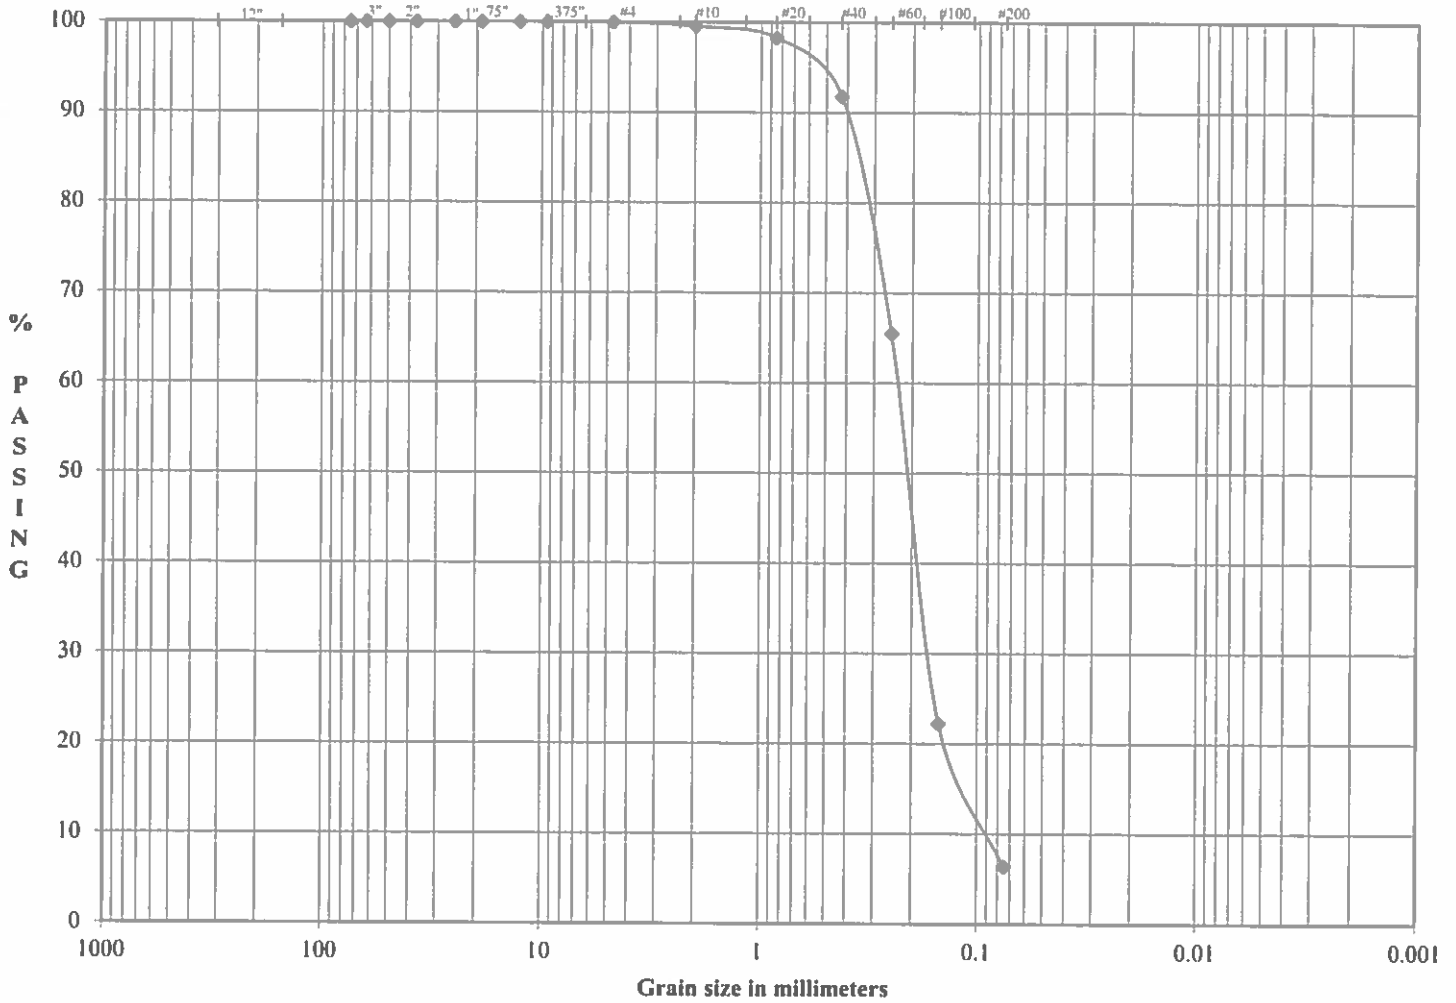

Boulders	Cobbles	Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
		GRAVEL		SAND			FINES
	0.00	0.00	0.02	0.43	7.78	85.38	6.39
		0.02		93.58			

SAMPLE ID	CS-1
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	-

LL	-
PL	-
PI	-

VISUAL DESCRIPTION: Brown, POORLY GRADED SAND WITH SILT, trace gravel

USCS: SP-SM


TECH	BB
DATE	6/17/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

LABORATORY COMPACTION CHARACTERISTICS OF SOIL ASTM D1557 - Method A

Mechanical Rammer Moist Preparation

PROJECT NAME: **JR Whiting Ponds 1 & 2**
 SAMPLE ID: **CS-1**
 TYPE: **Bulk**

DEPTH (ft): -

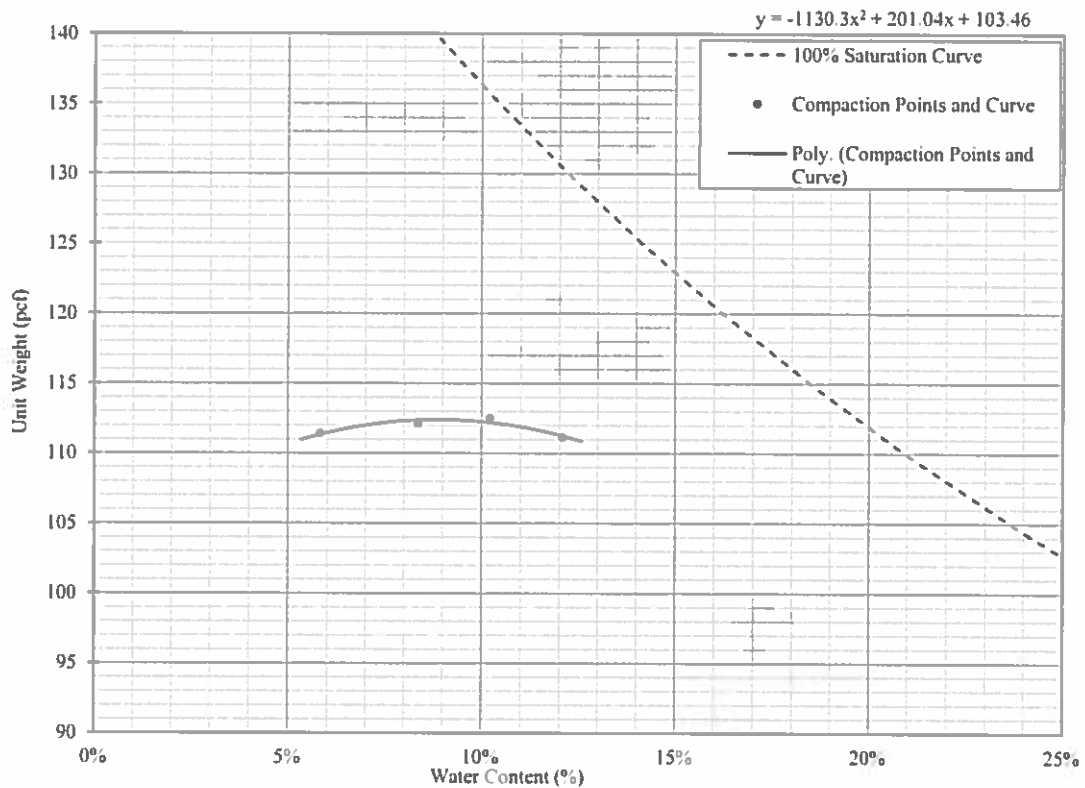

% Test Fraction Passing #4 Sieve	99.98%
As-Received Moisture Content	8.1%
Specific Gravity (assumed)	2.80

Modified Maximum Dry Unit Weight (pcf)	112.4
Modified Optimum Water Content (%)	8.9%

Description: **Brown, POORLY GRADED SAND WITH SILT, trace gravel**
 USCS: **SP-SM**

TECH	BB
DATE	6/17/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

APPENDIX D.5

Road Base Material

JR Whiting
 Pond 1 and 2
 Geotechnical Laboratory Test Results

Sample Identification	Sample Type	Sample Depth (ft)	Soil Classification	In-situ Moisture %	Atterberg Limits				Grain Size Distribution		Modified Proctor		Specific Gravity	Unit Weight		Hydraulic Conductivity (cm/sec)	Additional Tests Conducted (See Notes)
					LL	PL	PI	LI	% Finer #4 sieve	% Finer #200 sieve	Maximum Dry Density (pcf)	Optimum Moisture %		Dry (pcf)	Moisture %		
RB-1	Bulk	-	GW-GM	3.4	-	-	-	-	46.7	5.6	139.0	8.4	-	-	-	-	
RB-2	Bulk	2.0"-6.0"	GW-GM	2.6	-	-	-	-	49.7	8.9	134.4	2.5	-	-	-	-	

ABBREVIATIONS: LIQUID LIMIT (LL)
 PLASTIC LIMIT (PL)
 PLASTICITY INDEX (PI)
 LIQUIDITY INDEX (LI)
 SPECIFIC GRAVITY (G_s)
 MOISTURE (M_c)

NOTES: T = TRIAXIAL TEST
 U = UNCONFINED COMPRESSION TEST
 C = CONSOLIDATION TEST
 DS = DIRECT SHEAR TEST
 O = ORGANIC CONTENT
 P = pH
 NP = NON-PLASTIC
 *Classified Visually

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE	JR Whiting Ponds 1&2	SAMPLE ID	RB-1
PROJECT NO.	1788523	SAMPLE TYPE	Bulk
REMARKS	23A	SAMPLE DEPTH (ft)	-

WATER CONTENT (Delivered Moisture)		Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1) 3298.20	Wet Soil & Tare (gm)	1.00
Wt Dry Soil & Tare (gm)	(w2) 3203.75	Dry Soil & Tare (gm)	1.00
Weight of Tare (gm)	(w3) 426.60	Tare Weight (gm)	0.00
Weight of Water (gm)	(w4=w1-w2) 94.45	Moisture Content (%)	0.00%
Weight of Dry Soil (gm)	(w5=w2-w3) 2777.15	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture	
Moisture Content (%)	(w4/w5)*100 3.40	Weight Of Sample (gm)	3203.75
		Tare Weight (gm)	426.60
		(W6) Total Dry Weight (gm)	2777.15

SIEVE ANALYSIS		Cum. Ret.	Cumulative	% PASS	SIEVE
Tare Weight	Wt Ret	(Wt-Tare)	(%Retained)	(100-%ret)	
426.60	+Tare	(dry)	[(wt ret/w6)*100]		
3.0"	426.60	0.00	0.00	100.00	3.0" coarse gravel
2.5"	426.60	0.00	0.00	100.00	2.5" coarse gravel
2.0"	426.60	0.00	0.00	100.00	2.0" coarse gravel
1.5"	426.60	0.00	0.00	100.00	1.5" coarse gravel
1.0"	426.60	0.00	0.00	100.00	1.0" coarse gravel
0.75"	641.60	215.00	7.74	92.26	0.75" fine gravel
0.50"	1188.23	761.63	27.42	72.58	0.50" fine gravel
0.375"	1432.08	1005.48	36.21	63.79	0.375" fine gravel
#4	1905.58	1478.98	53.26	46.74	#4 coarse sand
#8	2256.66	1830.06	65.90	34.10	#8 coarse sand
#20	2578.94	2152.34	77.50	22.50	#20 medium sand
#40	2723.18	2296.58	82.70	17.30	#40 fine sand
#60	2804.73	2378.13	85.63	14.37	#60 fine sand
#100	2917.18	2490.58	89.68	10.32	#100 fine sand
#200	3048.49	2621.89	94.41	5.59	#200 fines

% C GRAVEL	7.74	Descriptive Terms > 10% mostly coarse (c) > 10% mostly medium (m) < 10% fine (c-m) < 10% coarse (m-f) < 10% coarse and fine (m) < 10% coarse and medium (f) > 10% equal amounts each (c-f)	LL	-
% F GRAVEL	45.51		PL	-
% C SAND	12.64		PI	-
% M SAND	16.80		Gs	-
% F SAND	11.71			
% FINES	5.59			
% TOTAL	100.00			


VISUAL DESCRIPTION Gray, WELL GRADED GRAVEL WITH SILT AND SAND

USCS GW-GM

TECH BB
DATE 6/21/2019
CHECK [Signature]
REVIEW [Signature]

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

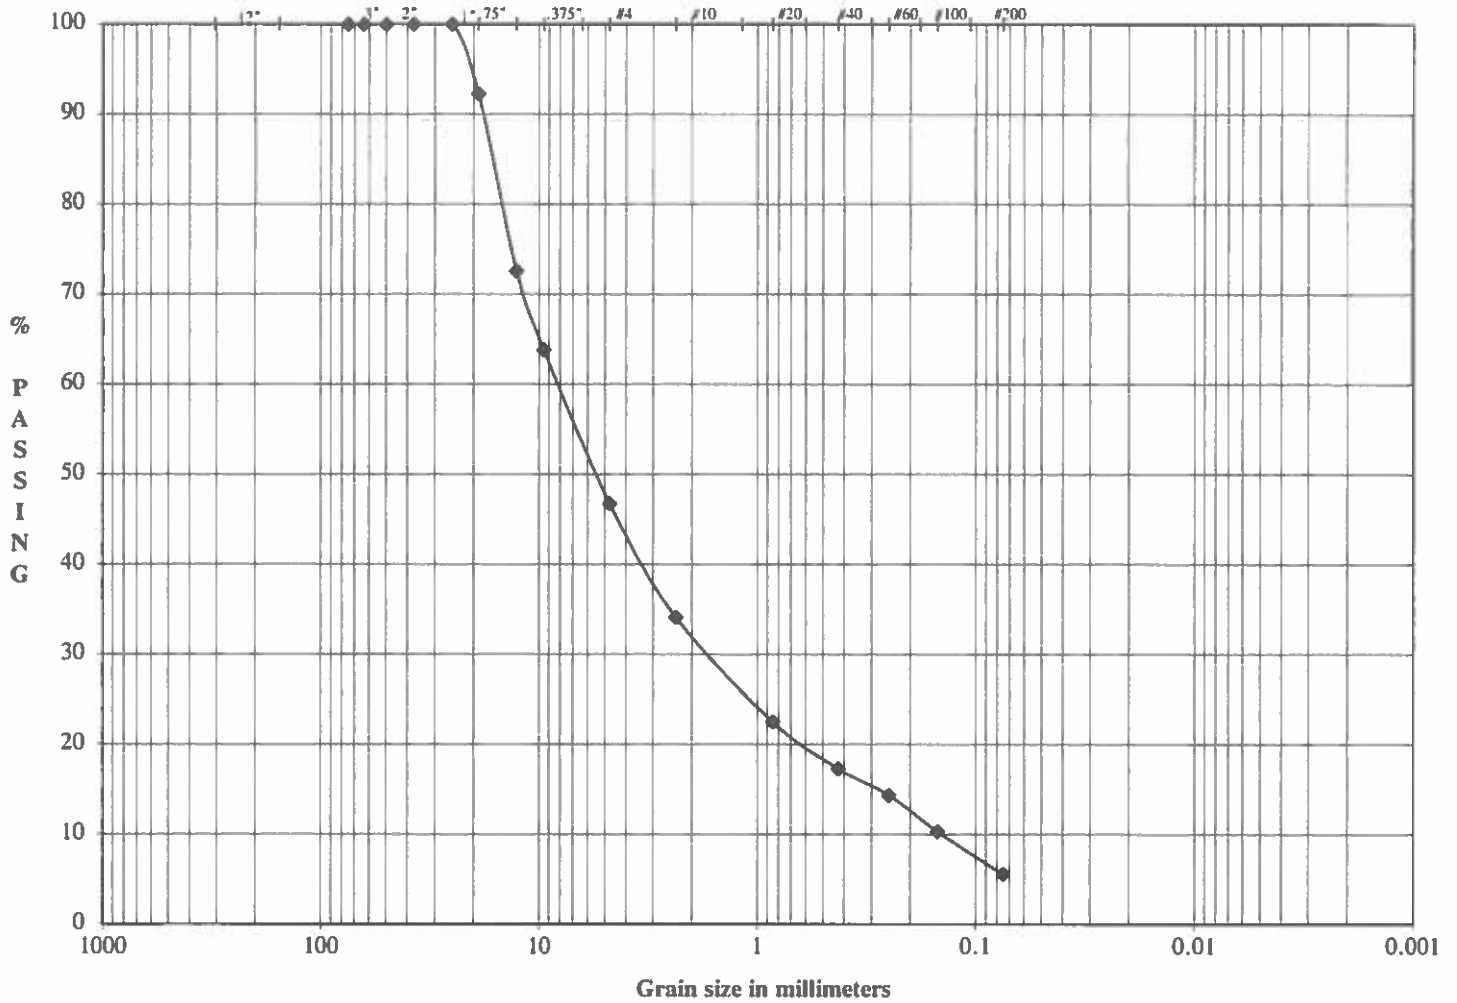

		Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
Boulders	Cobbles	GRAVEL		SAND			FINES
	0.00	7.74	45.51	12.64	16.80	11.71	5.59
		53.26		41.15			

SAMPLE ID	RB-1
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	-

LL	-
PL	-
PI	-

VISUAL DESCRIPTION: Gray, WELL GRADED GRAVEL WITH SILT AND SAND


USCS: GW-GM

TECH	BB
DATE	6/21/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

LABORATORY COMPACTION CHARACTERISTICS OF SOIL ASTM D1557 - Method C

Manual Rammer Preparation

PROJECT NAME: **JR Whiting Ponds 1&2**
 SAMPLE ID: **RB-1** DEPTH (ft) : -
 TYPE: **Bulk**

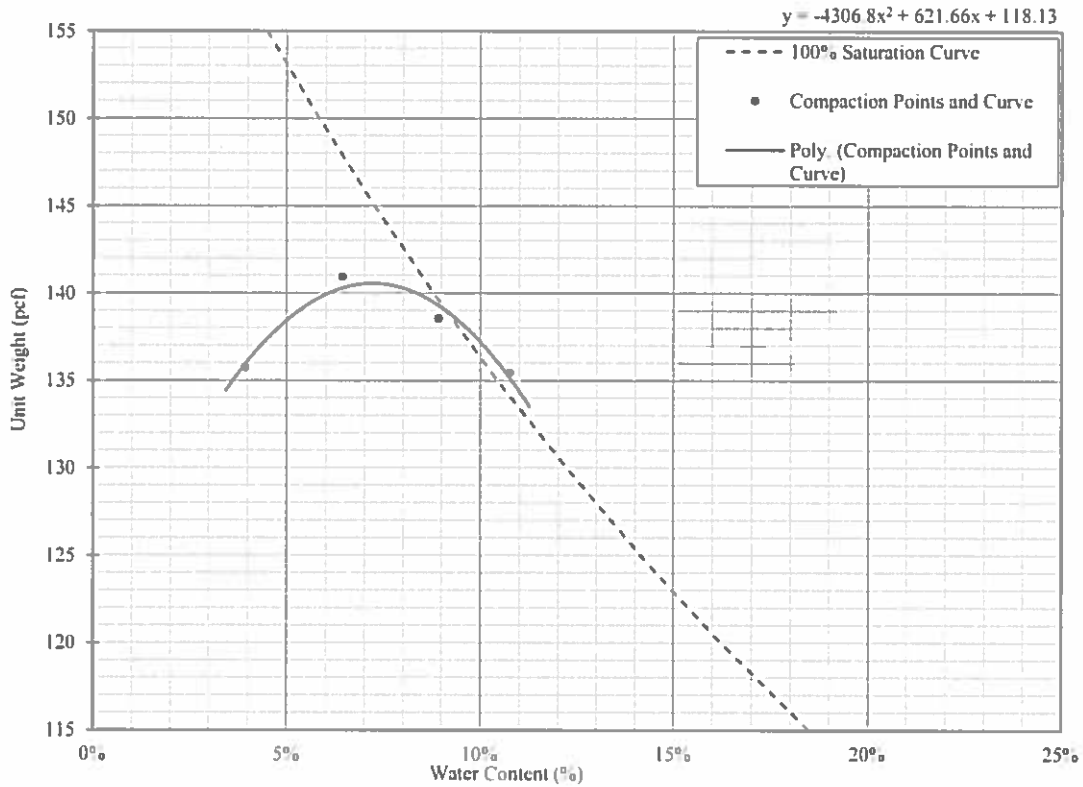

% Test Fraction Passing 3/4-inch Sieve	37%
As-Received Moisture Content	3%
Specific Gravity (assumed)	2.80

Modified Maximum Dry Unit Weight (pcf)	139.0
Modified Optimum Water Content (%)	8.4%

Visual Description: Gray, WELL GRADED GRAVEL WITH SILT AND SAND
 USCS: GW-GM

TECH	BB
DATE	6/20/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE	JR Whiting Ponds 1&2	SAMPLE ID	RB-2
PROJECT NO.	1788523	SAMPLE TYPE	Bulk
REMARKS	23A	SAMPLE DEPTH (ft)	2.0"-6.0"

WATER CONTENT (Delivered Moisture)		Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1) 3574.78	Wet Soil & Tare (gm)	1.00
Wt Dry Soil & Tare (gm)	(w2) 3494.06	Dry Soil & Tare (gm)	1.00
Weight of Tare (gm)	(w3) 358.68	Tare Weight (gm)	0.00
Weight of Water (gm)	(w4=w1-w2) 80.72	Moisture Content (%)	0.00%
Weight of Dry Soil (gm)	(w5=w2-w3) 3135.38	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture	
Moisture Content (%)	(w4/w5)*100 2.57	Weight Of Sample (gm)	3494.06
		Tare Weight (gm)	358.68
		(W6) Total Dry Weight (gm)	3135.38

SIEVE ANALYSIS	Tare Weight	Wt Ret	Cum. Ret.	Cumulative	% PASS	SIEVE
	358.68	+Tare	(Wt-Tare) (dry)	(%Retained) (wt ret/w6)*100	(100-%ret)	
3.0"	358.68	0.00	0.00	100.00	3.0"	coarse gravel
2.5"	358.68	0.00	0.00	100.00	2.5"	coarse gravel
2.0"	358.68	0.00	0.00	100.00	2.0"	coarse gravel
1.5"	358.68	0.00	0.00	100.00	1.5"	coarse gravel
1.0"	358.68	0.00	0.00	100.00	1.0"	coarse gravel
0.75"	498.63	139.95	4.46	95.54	0.75"	fine gravel
0.50"	1006.82	648.14	20.67	79.33	0.50"	fine gravel
0.375"	1321.92	963.24	30.72	69.28	0.375"	fine gravel
#4	1937.06	1578.38	50.34	49.66	#4	coarse sand
#8	2338.75	1980.07	63.15	36.85	#8	coarse sand
#20	2710.43	2351.75	75.01	24.99	#20	medium sand
#40	2882.43	2523.75	80.49	19.51	#40	fine sand
#60	2973.53	2614.85	83.40	16.60	#60	fine sand
#100	3054.66	2695.98	85.99	14.01	#100	fine sand
#200	3215.59	2856.91	91.12	8.88	#200	finer

% C GRAVEL	4.46	Descriptive Terms	> 10% mostly coarse (c)	LL	-
% F GRAVEL	45.88	trace	0 to 5%	PL	-
% C SAND	12.81	little	5 to 12%	PI	-
% M SAND	17.34	some	12 to 30%	Gs	-
% F SAND	10.63	and	30 to 50%		
% FINES	8.88		< 10% coarse and fine (m)		
% TOTAL	100.00		< 10% coarse and medium (f)		
			> 10% equal amounts each (c-f)		


VISUAL DESCRIPTION Gray, WELL GRADED GRAVEL WITH SILT AND SAND

USCS GW-GM

TECH TDS
DATE 10/31/2019
CHECK
REVIEW

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

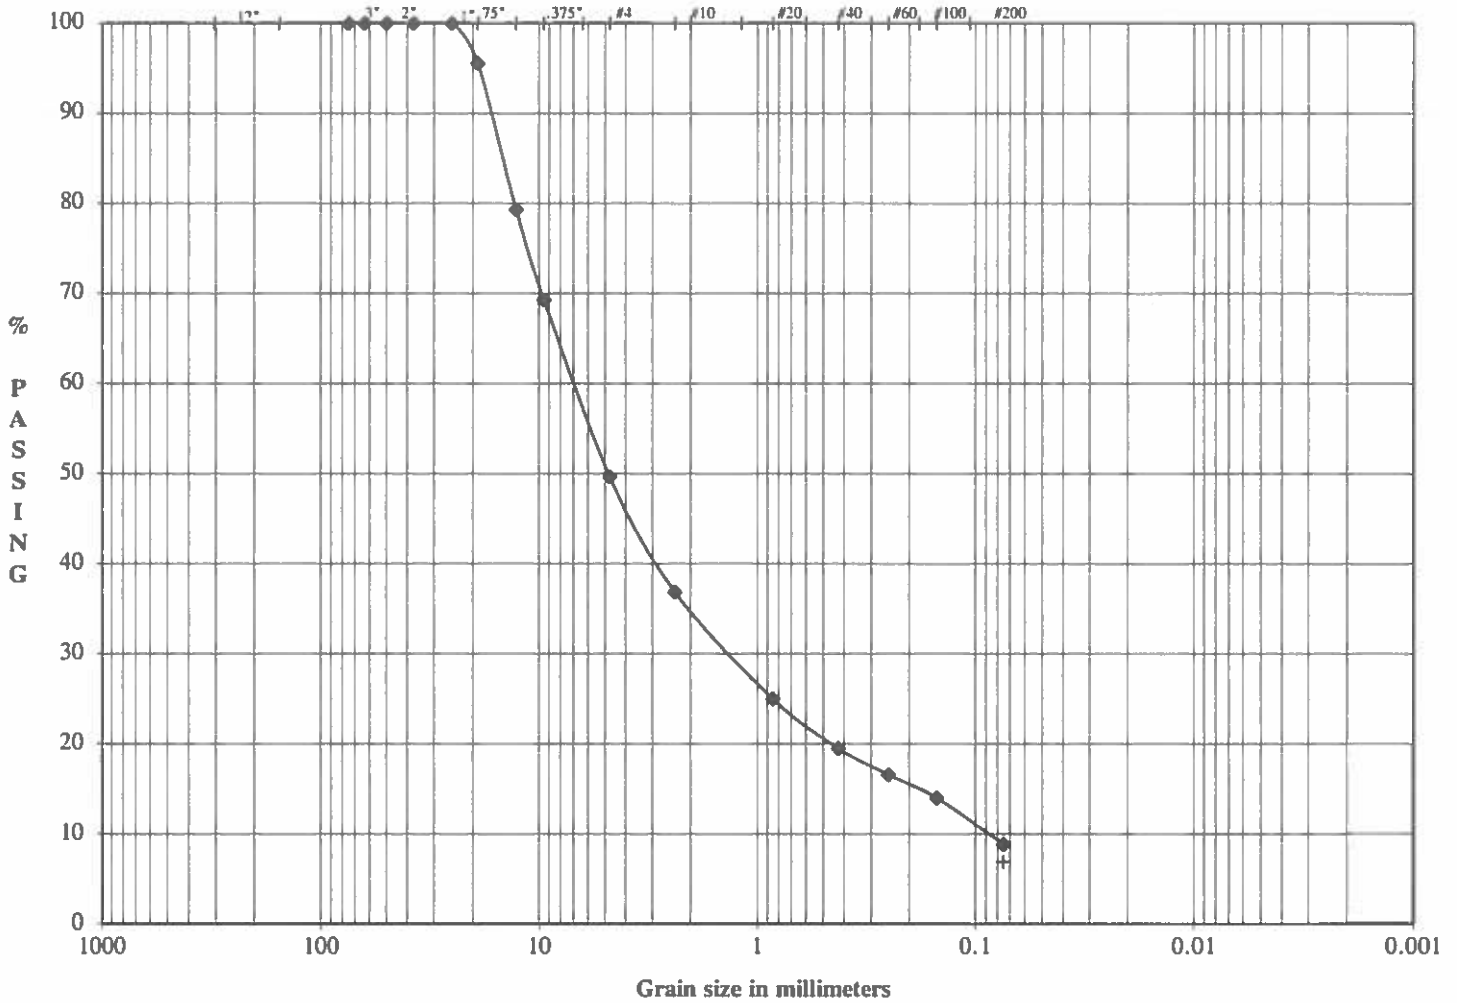

		Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
Boulders	Cobbles	GRAVEL		SAND			FINES
	0.00	4.46	45.88	12.81	17.34	10.63	8.88
		50.34		40.78			

SAMPLE ID	RB-2
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	2.0"-6.0"

LL	-
PL	-
PI	-

VISUAL DESCRIPTION: Gray, WELL GRADED GRAVEL WITH SILT AND SAND

USCS: GW-GM


TECH	TDS
DATE	10/31/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

LABORATORY COMPACTION CHARACTERISTICS OF SOIL ASTM D1557 - Method C

Manual Rammer Preparation

PROJECT NAME: JR Whiting Ponds 1&2
 SAMPLE ID: RB-2
 TYPE: Bulk

DEPTH (R): 2.0"-6.0"

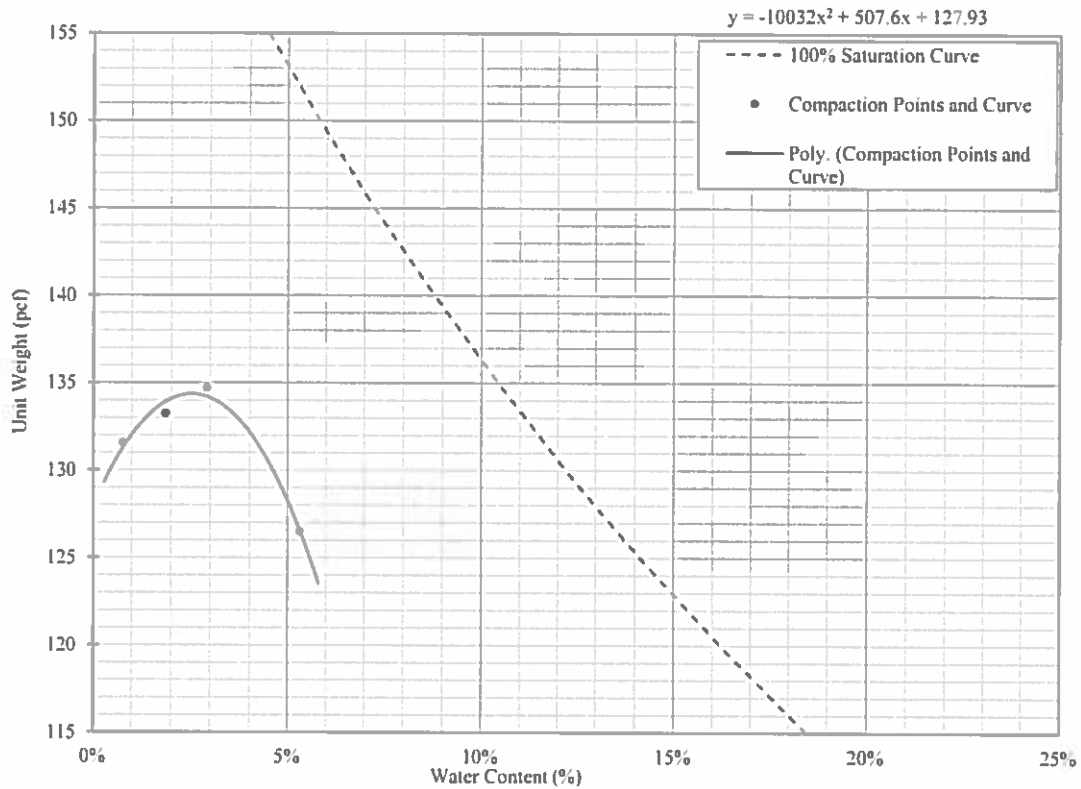

% Test Fraction Passing 3/4-inch Sieve	96%
As-Received Moisture Content	3%
Specific Gravity (assumed)	2.80

Modified Maximum Dry Unit Weight (pcf)	134.4
Modified Optimum Water Content (%)	2.5%

Visual Description: Gray, WELL GRADED GRAVEL WITH SILT AND SAND
 USCS: GW-GM

TECH: RH
 DATE: 10/31/2019
 CHECK: [Signature]
 REVIEW: [Signature]

APPENDIX D.6

MDOT 6AA Aggregate

JR Whiting
 Pond 1 and 2
 Geotechnical Laboratory Test Results

Sample Identification	Sample Type	Sample Depth (ft)	Soil Classification	In-situ Moisture %	Atterberg Limits				Grain Size Distribution		Modified Proctor		Specific Gravity	Unit Weight		Hydraulic Conductivity (cm/sec)	Additional Tests Conducted (See Notes)
					LL	PL	PI	LI	% Finer #4 sieve	% Finer #200 sieve	Maximum Dry Density (pcf)	Optimum Moisture %		Dry (pcf)	Moisture %		
6AA-1	Bulk	-	GP	0.4	-	-	-	-	0.6	0.2	-	-	-	-	-	-	-
6AA-2	Bulk	-	GP	0.4	-	-	-	-	2.2	0.7	-	-	-	-	-	-	-

ABBREVIATIONS: LIQUID LIMIT (LL)
 PLASTIC LIMIT (PL)
 PLASTICITY INDEX (PI)
 LIQUIDITY INDEX (LI)
 SPECIFIC GRAVITY (G_s)
 MOISTURE (M_c)

NOTES: T = TRIAXIAL TEST
 U = UNCONFINED COMPRESSION TEST
 C = CONSOLIDATION TEST
 DS = DIRECT SHEAR TEST
 O = ORGANIC CONTENT
 P = pH
 NP = NON-PLASTIC
 *Classified Visually

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE	JR Whiting Ponds 1&2	SAMPLE ID	6AA-1
PROJECT NO.	17888523	SAMPLE TYPE	Bulk
REMARKS	6AA	SAMPLE DEPTH (ft)	-

WATER CONTENT (Delivered Moisture)		Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1) 2698.69	Wet Soil & Tare (gm)	1.00
Wt Dry Soil & Tare (gm)	(w2) 2689.05	Dry Soil & Tare (gm)	1.00
Weight of Tare (gm)	(w3) 458.07	Tare Weight (gm)	0.00
Weight of Water (gm)	(w4=w1-w2) 9.64	Moisture Content (%)	0.00%
Weight of Dry Soil (gm)	(w5=w2-w3) 2230.98	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture	
Moisture Content (%)	(w4/w5)*100 0.43	Weight Of Sample (gm)	2689.05
		Tare Weight (gm)	458.07
		(W6) Total Dry Weight (gm)	2230.98

SIEVE ANALYSIS		Wt Ret	Cum. Ret.	Cumulative	% PASS	SIEVE
Tare Weight		+Tare	(Wt-Tare)	(%Retained)	(100-%ret)	
458.07			(dry)	((wt ret w6)*100)		
3.0"	458.07	0.00	0.00	100.00	3.0"	coarse gravel
2.5"	458.07	0.00	0.00	100.00	2.5"	coarse gravel
2.0"	458.07	0.00	0.00	100.00	2.0"	coarse gravel
1.5"	458.07	0.00	0.00	100.00	1.5"	coarse gravel
1.0"	458.07	0.00	0.00	100.00	1.0"	coarse gravel
0.75"	1206.78	748.71	33.56	66.44	0.75"	fine gravel
0.50"	2231.76	1773.69	79.50	20.50	0.50"	fine gravel
0.375"	2475.39	2017.32	90.42	9.58	0.375"	fine gravel
#4	2675.00	2216.93	99.37	0.63	#4	coarse sand
#10	2678.62	2220.55	99.53	0.47	#10	medium sand
#20	2679.15	2221.08	99.56	0.44	#20	medium sand
#40	2680.61	2222.54	99.62	0.38	#40	fine sand
#60	2681.69	2223.62	99.67	0.33	#60	fine sand
#100	2682.72	2224.65	99.72	0.28	#100	fine sand
#200	2685.36	2227.29	99.83	0.17	#200	finer

% C GRAVEL	33.56	Descriptive Terms > 10% mostly coarse (c) > 10% mostly medium (m) < 10% fine (c-m) < 10% coarse (m-f) < 10% coarse and fine (m) < 10% coarse and medium (f) > 10% equal amounts each (c-f)	LL	-
% F GRAVEL	65.81		PL	-
% C SAND	0.16		PI	-
% M SAND	0.09		Gs	-
% F SAND	0.21			
% FINES	0.17			
% TOTAL	100.00			


DESCRIPTION Gray, POORLY GRADED GRAVEL, trace sand, trace fines

USCS GP

TECH TDS
DATE 9/12/2019
CHECK RAB
REVIEW JD

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

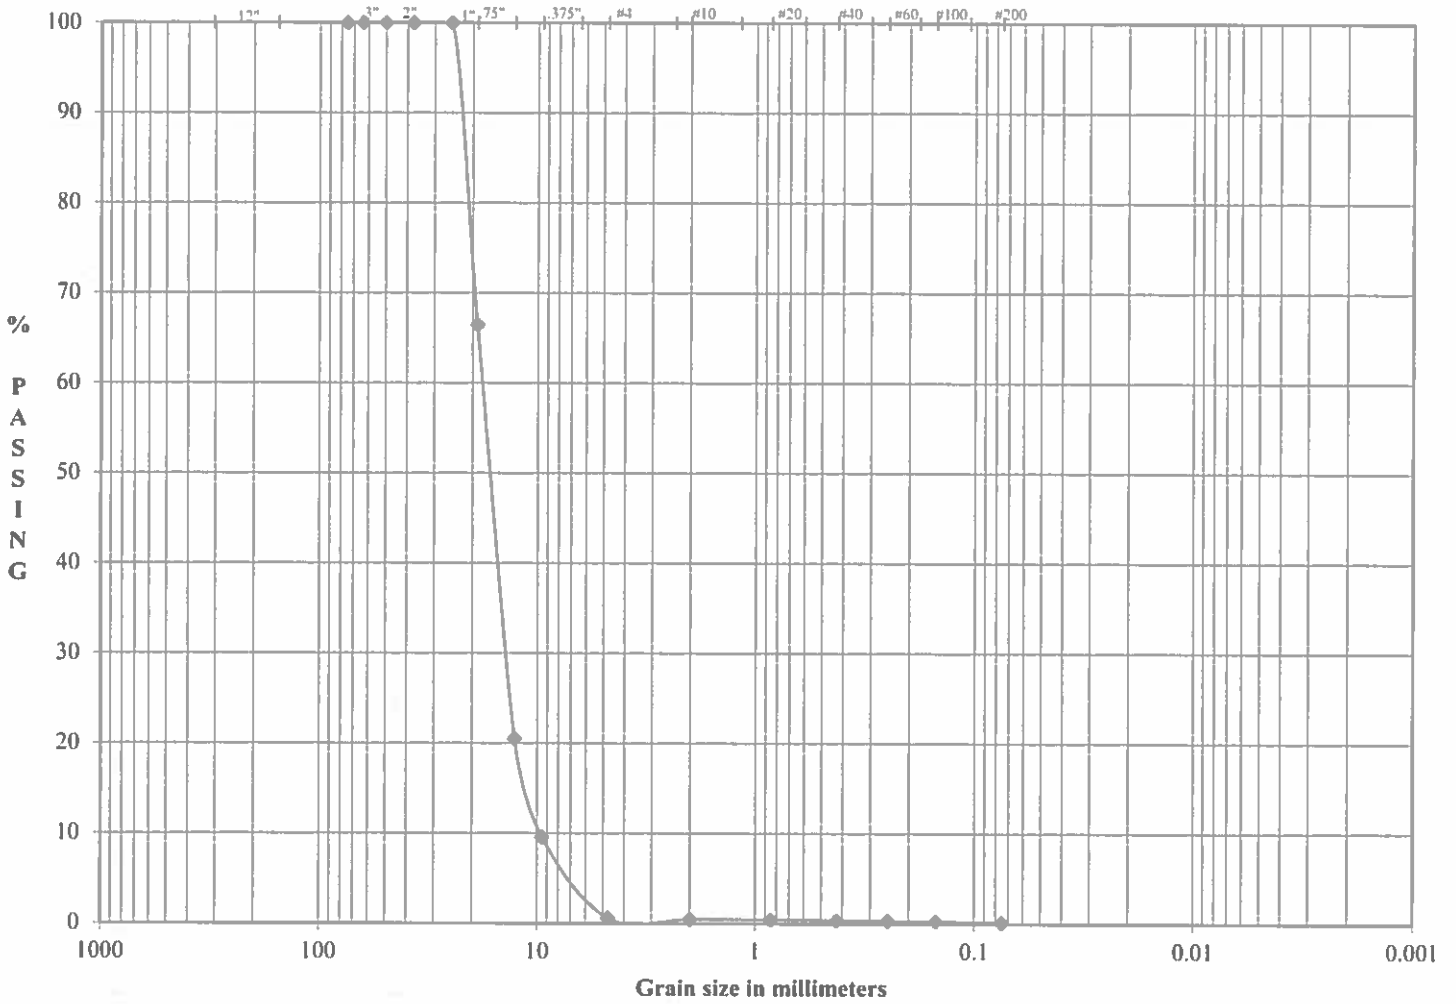

Boulders	Cobbles	Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
		GRAVEL		SAND			FINES
	0.00	33.56	65.81	0.16	0.09	0.21	0.17
		99.37		0.46			

SAMPLE ID	6AA-1
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	-

LL	-
PL	-
PI	-

DESCRIPTION Gray, POORLY GRADED GRAVEL, trace sand, trace fines

USCS GP

TECH	TDS
DATE	9/12/2019
CHECK	<i>[Signature]</i>
REVIEW	<i>[Signature]</i>

ASTM GRAIN SIZE ANALYSIS
ASTM D 421, D 2217, D 1140, C 117, D 422, C 136, C 142

PROJECT TITLE	JR Whiting Ponds 1&2	SAMPLE ID	6AA-2
PROJECT NO.	17888523	SAMPLE TYPE	Bulk
REMARKS	6AA	SAMPLE DEPTH (ft)	-

WATER CONTENT (Delivered Moisture)		Hygroscopic Moisture For Sieve Sample	
Wt Wet Soil & Tare (gm)	(w1) 3551.99	Wet Soil & Tare (gm)	1.00
Wt Dry Soil & Tare (gm)	(w2) 3539.48	Dry Soil & Tare (gm)	1.00
Weight of Tare (gm)	(w3) 443.82	Tare Weight (gm)	0.00
Weight of Water (gm)	(w4=w1-w2) 12.51	Moisture Content (%)	0.00%
Weight of Dry Soil (gm)	(w5=w2-w3) 3095.66	Total Weight Of Sample Used For Sieve Corrected For Hygroscopic Moisture	
Moisture Content (%)	(w4/w5)*100 0.40	Weight Of Sample (gm)	3539.48
		Tare Weight (gm)	443.82
		(W6) Total Dry Weight (gm)	3095.66

SIEVE ANALYSIS	Tare Weight	Wt Ret +Tare	Cum. Ret. (Wt-Tare) (dry)	Cumulative (%Retained) {(wt ret/w6)*100}	% PASS (100-%ret)	SIEVE		
	443.82							
		3.0"	443.82	0.00	0.00	100.00	3.0"	coarse gravel
		2.5"	443.82	0.00	0.00	100.00	2.5"	coarse gravel
		2.0"	443.82	0.00	0.00	100.00	2.0"	coarse gravel
		1.5"	443.82	0.00	0.00	100.00	1.5"	coarse gravel
		1.0"	443.82	0.00	0.00	100.00	1.0"	coarse gravel
		0.75"	775.78	331.96	10.72	89.28	0.75"	fine gravel
		0.50"	2003.97	1560.15	50.40	49.60	0.50"	fine gravel
		0.375"	2643.93	2200.11	71.07	28.93	0.375"	fine gravel
		#4	3472.72	3028.90	97.84	2.16	#4	coarse sand
		#10	3509.39	3065.57	99.03	0.97	#10	medium sand
		#20	3511.88	3068.06	99.11	0.89	#20	medium sand
		#40	3512.89	3069.07	99.14	0.86	#40	fine sand
		#60	3514.04	3070.22	99.18	0.82	#60	fine sand
		#100	3515.15	3071.33	99.21	0.79	#100	fine sand
		#200	3519.22	3075.40	99.35	0.65	#200	finer

% C GRAVEL	10.72	Descriptive Terms	> 10% mostly coarse (c)	LL	-
% F GRAVEL	87.12	trace	0 to 5%	PL	-
% C SAND	1.18	little	5 to 12%	PI	-
% M SAND	0.11	some	12 to 30%	Gs	-
% F SAND	0.20	and	30 to 50%		
% FINES	0.65		< 10% fine (c-m)		
% TOTAL	100.00		< 10% coarse (m-f)		
			< 10% coarse and fine (m)		
			< 10% coarse and medium (f)		
			> 10% equal amounts each (c-f)		


DESCRIPTION Gray, POORLY GRADED GRAVEL, trace sand, trace fines

USCS GP

TECH TDS
DATE 9/19/2019
CHECK AB
REVIEW DM

* material finer than #4 sieve corrected for hygroscopic moisture.

**PARTICLE SIZE DISTRIBUTION ASTM D 421 AND D 422
US STANDARD SIEVE OPENING SIZES**

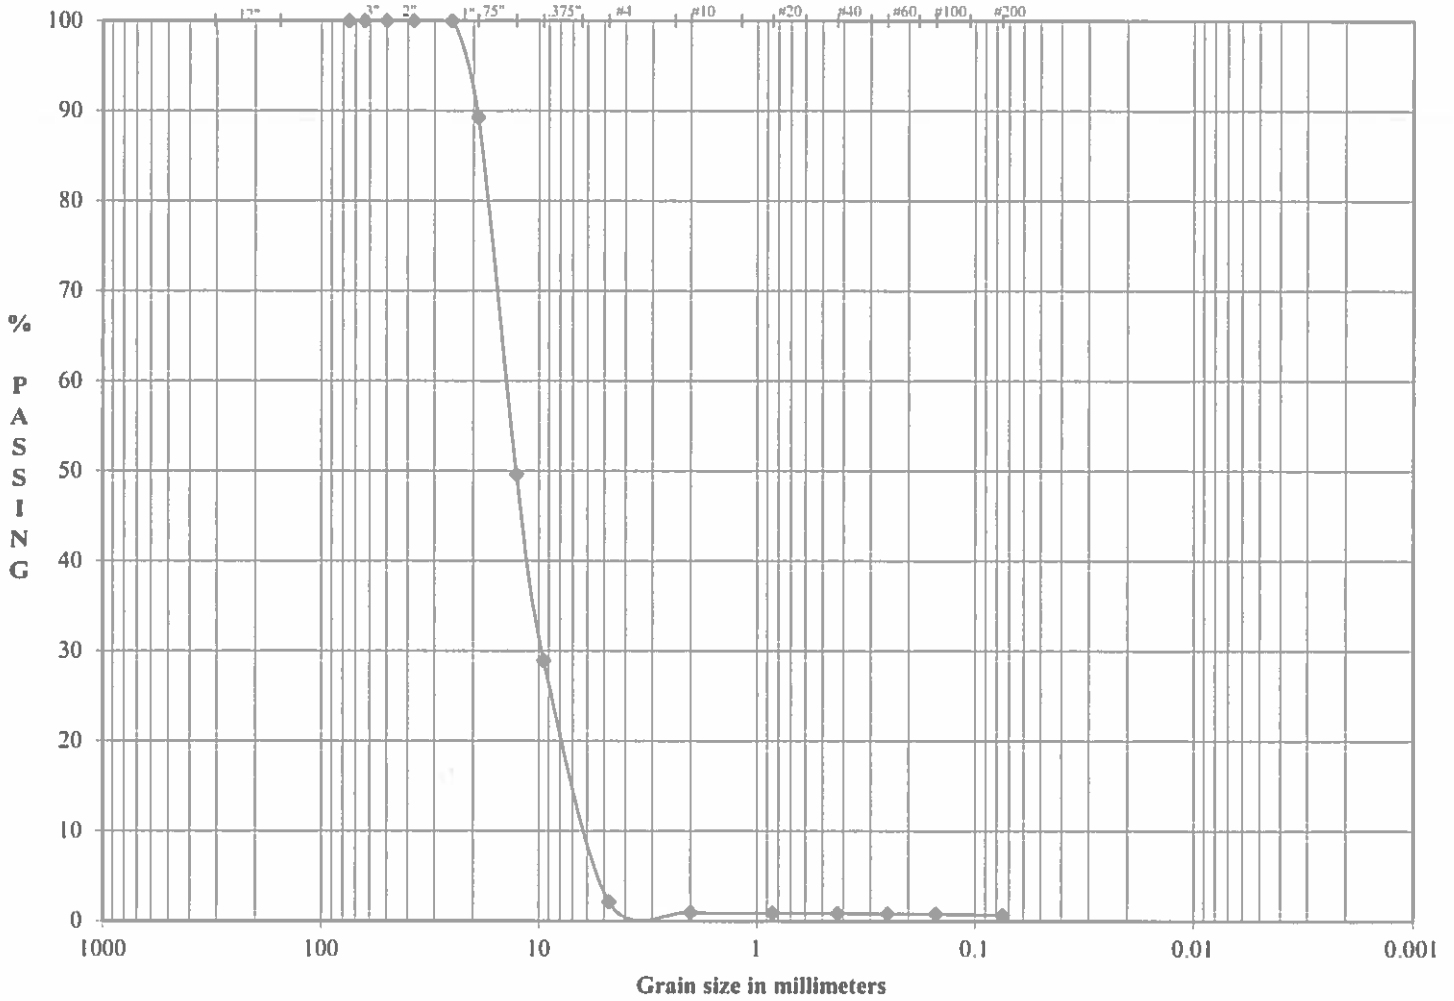

Boulders	Cobbles	Coarse	Fine	Cor	Med	Fine	SILT OR CLAY
		GRAVEL		SAND			FINES
	0.00	10.72	87.12	1.18	0.11	0.20	0.65
		97.84		1.50			

SAMPLE ID	6AA-2
SAMPLE TYPE	Bulk
SAMPLE DEPTH (ft)	-

LL	-
PL	-
PI	-

DESCRIPTION: Gray, POORLY GRADED GRAVEL, trace sand, trace fines

USCS: GP

TECH	TDS
DATE	9/19/2019
CHECK	AB
REVIEW	JAL

APPENDIX D.7

Topsoil Results



TYLER
TRUCKING, LLC

15070 S. Telegraph Rd. Monroe, MI 48161
Ph: 734-241-1051 Fax: 734-457-5606

Certification of Virgin Topsoil

Certification provided to: Ryan Incorporated Central

In consideration of the "fresh farming" of dirt located at the property known as

CANTON TOPSOIL

,by the address of

50530 CHERRY HILL ROAD CANTON, MI 48187

Tyler General Trucking, LLC. does hereby certify the topsoil delivered to the consumer was extracted from fresh "virgin soil" which has never before been cultivated and is free of contamination.

Signed:

Tyler General Trucking, LLC.

Print:

David L. Lorton

Phone #:

(734) 241-1051

Date:

July 24, 2019

MICHIGAN STATE UNIVERSITY

MICHIGAN STATE UNIVERSITY
 SOIL AND PLANT NUTRIENT LABORATORY
 EAST LANSING, MICHIGAN 48824-1325
 (517) 355-0218

Tyler Trucking - Intersection of Cherry Hill and Ridge Rd, Canton, MI

SOIL TEST REPORT FOR:				CONSULTANT			
CONSUMERS ENERGY 4525 E. ERIE RD. ERIE MI 48133				MONROE COUNTY MSU EXTENSION 963 S RAISINVILLE ROAD MONROE MI 48161 734-240-3170			

DATE	LAB #	COUNTY	GROWER'S EMAIL	ACRES	FIELD ID	SOIL	TEXTURE
8/23/2019	237956	Monroe	scott.rogers@ryancentral.com		Cherry Hill	Mineral	

Next to Lake or Stream?	Year Area Planted	Fertilizer Tilled in Prior to Planting?	How Deep?
			3 Inches

SOIL NUTRIENT LEVELS		Below Optimum	Optimum	Above Optimum
¹ Soil pH	7.1			
Lime Index				
² Phosphorus (P)	51 ppm	████████████████████	████████████████████	████████████████████
³ Potassium (K)	153 ppm	████████████████████	████████████████████	████████████████████
³ Magnesium (Mg)	218 ppm	████████████████████	████████████████████	████████████████████

ADDITIONAL RESULTS:					Optional Tests:						
Calcium (Ca) (ppm)	CEC (meq/100 g)	% of Exchangeable Bases			Micronutrients (ppm)					Organic Matter %	Nitrate-N ppm
		K	Mg	Ca	B	Cu	Mn	Zn	Fe		
1704	10.7	3.7	16.9	79.4						2.7	

RECOMMENDATIONS FOR: *Lawn, mixed grasses*

Limestone: NONE

NUTRIENT NEEDS:		
Nitrogen (N) 2-3 lb/1000 sq ft	Phosphate (P ₂ O ₅): NONE	Potassium (K ₂ O): NONE

FERTILIZER OPTIONS:

MESSAGES

scott.rogers@ryancentral.com

Test Methods: 1- 1:1 soil:water pH, 2- Bray P1 Extractant, 3- 1N Ammonium Acetate Extractant



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 MDNRE Certified #9404
 NELAC Accredited #176507

Sample Date: 08/08/2019
 Submit Date: 08/08/2019
 Report Date: 08/20/2019

To: Golder Associates Inc.
 27200 Haggerty Road
 Suite B-12
 Farmington Hills, MI 48331-5719

BA Report Number: **60313**
 BA Sample ID: **CK07736**

Project Name: **JRW**
 Project Number: **1788523**
 Sample ID: **TS-1**

**Tyler Trucking - Intersection of Cherry Hill
 and Ridge Rd, Canton, MI**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
Total Metal Analysis						
Total Arsenic	1600	ug/Kg	100	SW846 6020A	LT	08/12/2019
Total Barium	13000	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Total Cadmium	60	ug/Kg	50	SW846 6020A	LT	08/12/2019
Total Chromium	4300	ug/Kg	500	SW846 6020A	LT	08/12/2019
Total Copper	2400	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Total Lead	6200	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Total Mercury	Not detected	ug/Kg	50	SW846 7471A	LS	08/12/2019
Total Selenium	Not detected	ug/Kg	200	SW846 6020A	LT	08/12/2019
Total Silver	Not detected	ug/Kg	100	SW846 6020A	LT	08/12/2019
Total Zinc	9100	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Metal Soil (digestion)	Digested			3050	EB	08/12/2019
Mercury (digestion)	Digested			7470/7471	LS	08/12/2019
Pesticide Analysis						
a-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Aldrin	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
b-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
BP-6(PBB)	Not detected	ug/Kg	50	SW846 8081B	BY	08/16/2019
cis-Chlordane(a)	Not detected	ug/Kg	25	SW846 8081B	BY	08/16/2019
d-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
4,4-DDD	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
4,4-DDE	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
4,4-DDT	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Dieldrin	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endosulfan I	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endosulfan II	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endosulfan sulfate	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endrin	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endrin aldehyde	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endrin ketone	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
g-BHC(Lindane)	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Heptachlor	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Heptachlor epoxide	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Hexabromobenzene	Not detected	ug/Kg	100	SW846 8081B	BY	08/16/2019
Methoxychlor	Not detected	ug/Kg	50	SW846 8081B	BY	08/16/2019
Mirex	Not detected	ug/Kg	50	SW846 8081B	BY	08/16/2019
Toxaphene	Not detected	ug/Kg	170	SW846 8081B	BY	08/16/2019



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 MDNRE Certified #9404
 NELAC Accredited #176507

Sample Date: 08/08/2019
 Submit Date: 08/08/2019
 Report Date: 08/20/2019


To: Golder Associates Inc.
 27200 Haggerty Road
 Suite B-12
 Farmington Hills, MI 48331-5719

BA Report Number: **60313** Project Name: **JRW**
 BA Sample ID: **CK07736** Project Number: **1788523**
 Sample ID: **TS-1**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
Pesticide Analysis						
trans-Chlordanc(g)	Not detected	ug/Kg	25	SW846 8081B	BY	08/16/2019
Pesticide solid (extraction)	Extracted			3510C/3545	MB	08/13/2019
Volatile Analysis(Methanol Preserved)						
Benzene	Not detected	ug/Kg	50	SW846 8260C	RG	08/13/2019
Ethylbenzene	Not detected	ug/Kg	50	SW846 8260C	RG	08/13/2019
Toluene	Not detected	ug/Kg	50	SW846 8260C	RG	08/13/2019
Xylenes(total)	Not detected	ug/Kg	150	SW846 8260C	RG	08/13/2019
EPA Method 5035 Methanol Preserv	Extracted			EPA 5035	GAI	08/08/2019
%Solid	91	%			EB	08/12/2019

DL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve MDNR designated target detection limits (TDL).

All soil results based on dry weight.

Released by 
 Date 8/20/2019

SALENBIEN MATERIALS

Salenbien Materials - 14467 Ida West Rd,
Petersburg, MI

9217 ANN ARBOR RD

DUNDEE MI, 48131

734-529-3823 EXT 114

ANDY & BETH SALENBIEN

To whom it may concern,

The proposed topsoil to be hauled from Salenbien Materials pit located at 11467 Ida West Rd Petersburg MI, used for capping the Consumers Energy ash landfills is from a virgin pit and is non-contaminated. We look forward to working with you on this project.

Thank you,

Beth Salenbien



Salenbien Materials - 14467 Ida West Rd,
Petersburg, MI

"Lawn" Soil Test Report for John Johnson "chem pond" (Oct 16, 2019, #5J5K34)

		<u>Below Optimum</u>	<u>Optimum</u>	<u>Above Optimum</u>
<u>Phosphorus (P)</u>	67 ppm			
<u>Potassium (K)</u>	45 ppm			
<u>Magnesium (Mg)</u>	86 ppm			
<u>Calcium (Ca)</u>	771 ppm			
<u>CEC</u>	4.7 meq/100 g			
<u>Soil Type</u>	Mineral (Loamy sand)	<i>*For more information on each individual nutrient, or the bar graph, click on the underlined word.</i>		
<u>Soil pH</u>	6.4			
<u>Lime Index</u>	70			
<u>Organic Matter</u>	3 %			

Follow Your Personalized Recommendations

Important: Always apply fertilizers according to label instructions

Your soil test indicates, on a yearly basis

per 1,000 sq. feet:

- **Nitrogen** (3 to 4 lb) is needed
- **Potassium** (3 lb) is needed
- No lime required

See below for more information on each

Lawn Organic Matter

Organic matter in your soil is 3%. Your soil has an adequate level of organic matter and no further actions need to be taken. To maintain organic matter in this range make sure to return clippings to the lawn.



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 MDNRE Certified #9404
 NELAC Accredited #176507

Sample Date: 08/08/2019
 Submit Date: 08/08/2019
 Report Date: 08/20/2019

To: Golder Associates Inc.
 27200 Haggerty Road
 Suite B-12
 Farmington Hills, MI 48331-5719

BA Report Number: **60313**
 BA Sample ID: **CK07737**

Project Name: **JRW**
 Project Number: **1788523**
 Sample ID: **TS-2**

**Salenbien Materials - 14467 Ida West Rd,
 Petersburg, MI**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
Total Metal Analysis						
Total Arsenic	3200	ug/Kg	100	SW846 6020A	LT	08/12/2019
Total Barium	31000	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Total Cadmium	170	ug/Kg	50	SW846 6020A	LT	08/12/2019
Total Chromium	8000	ug/Kg	500	SW846 6020A	LT	08/12/2019
Total Copper	7100	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Total Lead	9400	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Total Mercury	Not detected	ug/Kg	50	SW846 7471A	LS	08/12/2019
Total Selenium	Not detected	ug/Kg	200	SW846 6020A	LT	08/12/2019
Total Silver	Not detected	ug/Kg	100	SW846 6020A	LT	08/12/2019
Total Zinc	27000	ug/Kg	1000	SW846 6020A	LT	08/12/2019
Metal Soil (digestion)	Digested			3050	EB	08/12/2019
Mercury (digestion)	Digested			7470/7471	LS	08/12/2019
Pesticide Analysis						
a-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Aldrin	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
b-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
BP-6(PBB)	Not detected	ug/Kg	50	SW846 8081B	BY	08/16/2019
cis-Chlordane(a)	Not detected	ug/Kg	25	SW846 8081B	BY	08/16/2019
d-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
4,4-DDD	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
4,4-DDE	26	ug/Kg	20	SW846 8081B	BY	08/16/2019
4,4-DDT	22	ug/Kg	20	SW846 8081B	BY	08/16/2019
Dieldrin	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endosulfan I	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endosulfan II	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endosulfan sulfate	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endrin	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endrin aldehyde	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Endrin ketone	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
g-BHC(Lindane)	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Heptachlor	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Heptachlor epoxide	Not detected	ug/Kg	20	SW846 8081B	BY	08/16/2019
Hexabromobenzene	Not detected	ug/Kg	100	SW846 8081B	BY	08/16/2019
Methoxychlor	Not detected	ug/Kg	50	SW846 8081B	BY	08/16/2019
Mirex	Not detected	ug/Kg	50	SW846 8081B	BY	08/16/2019
Toxaphene	Not detected	ug/Kg	170	SW846 8081B	BY	08/16/2019



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 MDNRE Certified #9404
 NELAC Accredited #176507

Sample Date: 08/08/2019
 Submit Date: 08/08/2019
 Report Date: 08/20/2019


To: Golder Associates Inc.
 27200 Haggerty Road
 Suite B-12
 Farmington Hills, MI 48331-5719

BA Report Number: **60313** Project Name: **JRW**
 BA Sample ID: **CK07737** Project Number: **1788523**
 Sample ID: **TS-2**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
Pesticide Analysis						
trans-Chlordane(g)	Not detected	ug/Kg	25	SW846 8081B	BY	08/16/2019
Pesticide solid (extraction)	Extracted			3510C/3545	MB	08/13/2019
Volatile Analysis(Methanol Preserved)						
Benzene	Not detected	ug/Kg	50	SW846 8260C	RG	08/13/2019
Ethylbenzene	Not detected	ug/Kg	50	SW846 8260C	RG	08/13/2019
Toluene	Not detected	ug/Kg	50	SW846 8260C	RG	08/13/2019
Xylenes(total)	Not detected	ug/Kg	150	SW846 8260C	RG	08/13/2019
EPA Method 5035 Methanol Preserv	Extracted			EPA 5035	GAI	08/08/2019
%Solid	86	%			EB	08/12/2019

DL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve MDNR designated target detection limits (TDL).

All soil results based on dry weight.

Released by 

 Date 8/20/2019

MICHIGAN STATE UNIVERSITY

**MICHIGAN STATE UNIVERSITY
SOIL AND PLANT NUTRIENT LABORATORY
EAST LANSING, MICHIGAN 48824-1325
(517) 355-0218**

SOIL TEST REPORT FOR:				CONSULTANT			
RYAN INC CENTRAL 2700 E. RACINE ST. JANESVILLE WI 53545							
DATE	LAB #	COUNTY	GROWER'S EMAIL	ACRES	FIELD ID	SOIL	TEXTURE
10/21/2019	239823		scott.rogers@ryancentral.com		Devos	Mineral	
Next to Lake or Stream?		Year Area Planted		Fertilizer Tilled in Prior to Planting?			How Deep?
							3 Inches

SOIL NUTRIENT LEVELS		Below Optimum	Optimum	Above Optimum
¹ Soil pH	7.7			
	Lime Index			
² Phosphorus (P)	22	ppm		
³ Potassium (K)	108	ppm		
³ Magnesium (Mg)	276	ppm		

ADDITIONAL RESULTS:					Optional Tests:						
Calcium (Ca) (ppm)	CEC (meq/100 g)	% of Exchangeable Bases			Micronutrients (ppm)					Organic Matter %	Nitrate-N ppm
		K	Mg	Ca	B	Cu	Mn	Zn	Fe		
3776	21.5	1.3	10.7	88.0						2.9	

RECOMMENDATIONS FOR: *Lawn, mixed grasses*

Limestone: NONE

NUTRIENT NEEDS:		
Nitrogen (N) 2-3 lb/1000 sq ft	Phosphate (P₂O₅): NONE	Potassium (K₂O): .5 lb/1000 square feet

FERTILIZER OPTIONS:

MESSAGES

Consumers Energy JR Whiting



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 EGLE Certified #9404
 NELAC Accredited #176507

Sample Date: 10/17/2019
 Submit Date: 10/17/2019
 Report Date: 10/22/2019

To: Ryan Inc. Central
 P.O. Box 206
 Jamesville, WI 53547

BA Report Number: **61737**

Project Name: **JR Whiting Ponds 1&2**

BA Sample ID: **CL02522**

Project Number: **3909.1**

Sample ID: **Devos**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
Total Metal Analysis						
Total Arsenic	3500	ug/Kg	100	SW846 6020A	LT	10/21/2019
Total Barium	47000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Total Cadmium	300	ug/Kg	50	SW846 6020A	LT	10/21/2019
Total Chromium	8600	ug/Kg	500	SW846 6020A	LT	10/21/2019
Total Copper	14000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Total Lead	27000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Total Mercury	Not detected	ug/Kg	50	SW846 7471A	LS	10/21/2019
Total Selenium	280	ug/Kg	200	SW846 6020A	LT	10/21/2019
Total Silver	Not detected	ug/Kg	100	SW846 6020A	LT	10/21/2019
Total Zinc	51000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Metal Soil (digestion)	Digested			3050	EB	10/18/2019
Mercury (digestion)	Digested			7470/7471	LS	10/21/2019
Herbicide Analysis						
2,4-D	Not detected	ug/Kg	200	SW846 8151A	BY	10/21/2019
Dicamba	Not detected	ug/Kg	50	SW846 8151A	BY	10/21/2019
Dinoseb	Not detected	ug/Kg	20	SW846 8151A	BY	10/21/2019
2,4,5-T	Not detected	ug/Kg	50	SW846 8151A	BY	10/21/2019
2,4,5-TP(Silvex)	Not detected	ug/Kg	50	SW846 8151A	BY	10/21/2019
Herbicide solid (extraction)	Extracted			8151/615	BY	10/18/2019
Volatile Analysis(Methanol Preserved)						
Benzene	Not detected	ug/Kg	50	SW846 8260C	CW	10/18/2019
Ethylbenzene	Not detected	ug/Kg	50	SW846 8260C	CW	10/18/2019
Toluene	Not detected	ug/Kg	50	SW846 8260C	CW	10/18/2019
Xylenes(total)	Not detected	ug/Kg	150	SW846 8260C	CW	10/18/2019
EPA Method 5035 Methanol Preserv	Extracted			EPA 5035	BAL	10/17/2019
%Solid	84	%			MH	10/18/2019



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 EGLE Certified #9404
 NELAC Accredited #176507

Sample Date: 10/17/2019
 Submit Date: 10/17/2019
 Report Date: 10/22/2019

To: Ryan Inc. Central
 P.O. Box 206
 Jamesville, WI 53547

BA Report Number: **61737**

Project Name: **JR Whiting Ponds 1&2**

BA Sample ID: **CL02522**


Project Number: **3909.1**

Sample ID: **Devos**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
------------	--------	-------	----	------------------	---------	---------------

DL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve EGLE designated target detection limits (TDL).

All soil results based on dry weight.

Released by 

 Date 10/22/2019



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 EGLE Certified #9404
 NELAC Accredited #176507

Sample Date: 10/17/2019
 Submit Date: 10/17/2019
 Report Date: 10/24/2019

To: Ryan Inc. Central
 P.O. Box 206
 Jamesville, WI 53547

BA Report Number: **61737B** Project Name: **JR Whiting Ponds 1&2**
 BA Sample ID: **CL02522** Project Number: **3909.1**

Sample ID: **Devos**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
Total Metal Analysis						
Total Arsenic	3500	ug/Kg	100	SW846 6020A	LT	10/21/2019
Total Barium	47000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Total Cadmium	300	ug/Kg	50	SW846 6020A	LT	10/21/2019
Total Chromium	8600	ug/Kg	500	SW846 6020A	LT	10/21/2019
Total Copper	14000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Total Lead	27000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Total Mercury	Not detected	ug/Kg	50	SW846 7471A	LS	10/21/2019
Total Selenium	280	ug/Kg	200	SW846 6020A	LT	10/21/2019
Total Silver	Not detected	ug/Kg	100	SW846 6020A	LT	10/21/2019
Total Zinc	51000	ug/Kg	1000	SW846 6020A	LT	10/21/2019
Metal Soil (digestion)	Digested			3050	EB	10/18/2019
Mercury (digestion)	Digested			7470/7471	LS	10/21/2019
Pesticide Analysis						
a-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Aldrin	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
b-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
BP-6(PBB)	Not detected	ug/Kg	50	SW846 8081B	BY	10/23/2019
cis-Chlordane(a)	Not detected	ug/Kg	25	SW846 8081B	BY	10/23/2019
d-BHC	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
4,4-DDD	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
4,4-DDE	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
4,4-DDT	24	ug/Kg	20	SW846 8081B	BY	10/23/2019
Dieldrin	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Endosulfan I	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Endosulfan II	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Endosulfan sulfate	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Endrin	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Endrin aldehyde	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Endrin ketone	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
g-BHC(Lindane)	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Heptachlor	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Heptachlor epoxide	Not detected	ug/Kg	20	SW846 8081B	BY	10/23/2019
Hexabromobenzene	Not detected	ug/Kg	100	SW846 8081B	BY	10/23/2019
Methoxychlor	Not detected	ug/Kg	50	SW846 8081B	BY	10/23/2019
Mirex	Not detected	ug/Kg	50	SW846 8081B	BY	10/23/2019
Toxaphene	Not detected	ug/Kg	170	SW846 8081B	BY	10/23/2019



Brighton Analytical LLC
 2105 Pless Drive
 Brighton, Michigan 48114
 Phone: (810)229-7575 (810)229-8650
 e-mail: bai-brighton@sbcglobal.net
 EGLE Certified #9404
 NELAC Accredited #176507

Sample Date: 10/17/2019
 Submit Date: 10/17/2019
 Report Date: 10/24/2019

To: Ryan Inc. Central
 P.O. Box 206
 Jamesville, WI 53547


BA Report Number: **61737B** Project Name: **JR Whiting Ponds 1&2**
 BA Sample ID: **CL02522** Project Number: **3909.1**

Sample ID: **Devos**

Parameters	Result	Units	DL	Method Reference	Analyst	Analysis Date
Pesticide Analysis						
trans-Chlordane(g)	Not detected	ug/Kg	25	SW846 8081B	BY	10/23/2019
Pesticide solid (extraction)	Extracted			3510C/3545	MB	10/22/2019
Herbicide Analysis						
2,4-D	Not detected	ug/Kg	200	SW846 8151A	BY	10/21/2019
Dicamba	Not detected	ug/Kg	50	SW846 8151A	BY	10/21/2019
Dinoseb	Not detected	ug/Kg	20	SW846 8151A	BY	10/21/2019
2,4,5-T	Not detected	ug/Kg	50	SW846 8151A	BY	10/21/2019
2,4,5-TP(Silvex)	Not detected	ug/Kg	50	SW846 8151A	BY	10/21/2019
Herbicide solid (extraction)	Extracted			8151/615	BY	10/18/2019
Volatile Analysis(Methanol Preserved)						
Benzene	Not detected	ug/Kg	50	SW846 8260C	CW	10/18/2019
Ethylbenzene	Not detected	ug/Kg	50	SW846 8260C	CW	10/18/2019
Toluene	Not detected	ug/Kg	50	SW846 8260C	CW	10/18/2019
Xylenes(total)	Not detected	ug/Kg	150	SW846 8260C	CW	10/18/2019
EPA Method 5035 Methanol Preserv	Extracted			EPA 5035	BAL	10/17/2019
%Solid	84	%			MH	10/18/2019

DL=Reported detection limit for analytical method requested. Some compounds require special analytical methods to achieve EGLE designated target detection limits (TDL).

All soil results based on dry weight.

Released by 

 Date 10/24/2019

APPENDIX E

**Material Testing for 40-mil Textured
HDPE FML**

APPENDIX E.1

Geomembrane Inventory Log

GEOSYNTHETIC INVENTORY CONTROL LOG

PROJECT NUMBER: 1788523 PROJECT TITLE: JRW Ash & Chemical Pond Clousure
 OWNER: CEC CONTRACTOR: FLSI
 LOCATION: Erie, Mi.

MATERIAL TYPE: GEOMEMBRANE GEONET GEOTEXTILE OTHER
 DATE OF ARRIVAL: 6/28/19 DATE OF INVENTORY: 6/28/19
 MATERIAL MANUFACTURER: AGRU INVENTORY MONITOR: DH
 PRODUCT IDENTIFICATION: 4φ MIL HDPE MICROSPIKE CONDITION IN TRUCK: Good
 TRUCK TYPE: Semi w/FLATBED UNLOADING METHOD: EXCAVATOR

ROLL NUMBER	BATCH OR LOT NO.	MATERIAL DIMENSIONS			QC CERT Y/N	CONF. SAMP. Y/N	OTHER	REMARKS
		LENGTH	WIDTH	THICKNESS OR WEIGHT				
1 GTD00338	-4φφ3φ	74φ'	23'	4φ MIL	Y	NA	TRUCK #1	
2	-4φφ11	↓	↓	↓	Y	↓	↓	
3	-4φφ43	↓	↓	↓	Y	↓	↓	
4	-4φφ45	↓	↓	↓	Y	↓	↓	
5	-4φφ42	↓	↓	↓	Y	↓	↓	
6	-4φφ35	↓	↓	↓	Y	↓	↓	
7	-4φφ33	↓	↓	↓	Y	↓	↓	
8	-4φφ5φ	↓	↓	↓	Y	↓	↓	
9	-4φφ52	↓	↓	↓	Y	↓	↓	
10	-4φφ37	↓	↓	↓	Y	↓	↓	
11	-4φφ38	↓	↓	↓	Y	↓	↓	
12	-4φφ34	74φ'	23'	4φ MIL	Y	NA	TRUCK #2	
13	-4φφ12	↓	↓	↓	Y	↓	↓	
14	-4φφ16	↓	↓	↓	Y	↓	↓	
15	-4φφφ8	↓	↓	↓	Y	↓	↓	
16	-4φφ18	↓	↓	↓	Y	↓	↓	
17	-4φφφ2	↓	↓	↓	Y	↓	↓	
18	-4φφ28	↓	↓	↓	Y	↓	↓	
19	-4φφ19	↓	↓	↓	Y	↓	↓	
20	-4φφ32	↓	↓	↓	Y	↓	↓	
21	-4φφφ7	↓	↓	↓	Y	↓	↓	
22	-4φφ49	↓	↓	↓	Y	↓	↓	
23	-4φφφ4	↓	↓	↓	Y	↓	↓	
24	-4φφφ9	74φ'	23'	4φ mil	Y	↓	↓	
25	GTWR2φφ3485φφφ1	-	-	-	Y	NA	1φ SPALLS WELDING ROD	

Golder Form: G2 (July 2000) REVIEWED BY: TJS DATE: 12-2-19

GOLDER ASSOCIATES INC.

GTWR1φφ345-8φφφ1 x 1φ (TRUCK #1)

GEOSYNTHETIC INVENTORY CONTROL LOG

PROJECT NUMBER: 17388523
 OWNER: CEC
 LOCATION: ERIE, MI

PROJECT TITLE: ASH AND CHEMICAL PDS CLOSURE
 CONTRACTOR: RYAN

MATERIAL TYPE: GEOMEMBRANE GEONET GEOTEXTILE OTHER

DATE OF ARRIVAL: _____

DATE OF INVENTORY: 7.1.19

MATERIAL MANUFACTURER: AGRU

INVENTORY MONITOR: DM

PRODUCT IDENTIFICATION: 40 MIL HDPE MICRO-SPIKE

CONDITION IN TRUCK: GOOD

TRUCK TYPE: SEMI-WITRAILER

UNLOADING METHOD: EXCAVATOR

	ROLL NUMBER	BATCH OR LOT NO.	MATERIAL DIMENSIONS			QC CERT Y/N	CONF. SAMP. Y/N	OTHER	REMARKS
			LENGTH	WIDTH	THICKNESS OR WEIGHT				
16	DΦΦ3384-ΦΦ01	-	74Φ'	23'	4Φ MIL	Y	NA		
2	-ΦΦ05	-				Y			
3	-ΦΦ1Φ	-				Y			
4	-ΦΦ13	-				Y			
5	-ΦΦ14	-				Y			
6	-ΦΦ15	-				Y			
7	-ΦΦ17	-				Y			
8	-ΦΦ2Φ	-				Y			
9	-ΦΦ21	-				Y			
10	-ΦΦ24	-				Y			
11	-ΦΦ25	-				Y			
12	-ΦΦ26	-				Y			
13	-ΦΦ27	-				Y			
14	-ΦΦ31	-				Y			
15	-ΦΦ36	-				Y			
16	-ΦΦ39	-				Y			
17	-ΦΦ4Φ	-				Y			
18	-ΦΦ41	-				Y			
19	-ΦΦ44	-				Y			
20	-ΦΦ46	-				Y			
21	-ΦΦ47	-				Y			
22	-ΦΦ48	-				Y			
23	-ΦΦ51	-				Y			
24	-ΦΦ29	-				Y			
25									

Golder Form: G2
 (July 2000)

REVIEWED BY: RS DATE: 12-2-19

GOLDER ASSOCIATES INC.

TRUCK #1 & #2

GEOSYNTHETIC INVENTORY CONTROL LOG

PROJECT NUMBER: 1788523
 OWNER: CEC
 LOCATION: Erie, Mi.

PROJECT TITLE: JRW Ash & Chemical Pond Clousure
 CONTRACTOR: FLSI

MATERIAL TYPE : GEOMEMBRANE GEONET GEOTEXTILE OTHER

DATE OF ARRIVAL: 7.8.19

MATERIAL MANUFACTURER: AGRU

PRODUCT IDENTIFICATION: 4mm L HDPE MICROSPICE

TRUCK TYPE: SEMI-TRAILER

DATE OF INVENTORY: 7.8.19

INVENTORY MONITOR: DH

CONDITION IN TRUCK: GOOD

UNLOADING METHOD: EXCAVATOR

ROLL NUMBER	BATCH OR LOT NO.	MATERIAL DIMENSIONS			QC CERT Y/N	CONF. SAMP. Y/N	OTHER	REMARKS
		LENGTH	WIDTH	THICKNESS OR WEIGHT				
1	CD 003384-0006	740'	23'	4mm L	Y	NA		
2	-0003				Y			
3	-0022				Y			
4	-0023	740'	23'	4mm L	Y	NA		
5								
6								
7								
8								
9								
10								
11								
12								
13								
14								
15								
16								
17								
18								
19								
20								
21								
22								
23								
24								
25								

Golder Form: G2
(July 2000)

REVIEWED BY: TPS DATE: 10-2-19

GOLDER ASSOCIATES INC.



JR Whiting - Ash Ponds 1 & 2 Closures
 Chesapeake Containment Systems, Inc.
 4525 Erie Road
 Erie, MI 48133

SO#: 00003022

4φ mil HD

FG-HDMSDS040BBBEA	52 rolls @ 740	885,040 ft²

roll #	width ft.	English		Item	Count	weight lbs.	resin lot #
		length ft.	area ft²				
GTD0033840001	23	740	17,020	FG-HDMSDS040BBBEA	1	3766	HJM810460
GTD0033840002	23	740	17,020	FG-HDMSDS040BBBEA	2	3806	HJM810460
GTD0033840003	23	740	17,020	FG-HDMSDS040BBBEA	3	3798	HJM810460
GTD0033840004	23	740	17,020	FG-HDMSDS040BBBEA	4	3810	HJM810510
GTD0033840005	23	740	17,020	FG-HDMSDS040BBBEA	5	3800	HJM810510
GTD0033840006	23	740	17,020	FG-HDMSDS040BBBEA	6	3800	HJM810510
GTD0033840007	23	740	17,020	FG-HDMSDS040BBBEA	7	3806	HJM810510
GTD0033840008	23	740	17,020	FG-HDMSDS040BBBEA	8	3810	HJM810510
GTD0033840009	23	740	17,020	FG-HDMSDS040BBBEA	9	3810	HJM810510
GTD0033840010	23	740	17,020	FG-HDMSDS040BBBEA	10	3798	HJM810510
GTD0033840011	23	740	17,020	FG-HDMSDS040BBBEA	11	3802	HJM810510
GTD0033840012	23	740	17,020	FG-HDMSDS040BBBEA	12	3800	HJM810510
GTD0033840013	23	740	17,020	FG-HDMSDS040BBBEA	13	3794	HJM810510
GTD0033840014	23	740	17,020	FG-HDMSDS040BBBEA	14	3800	HJM810510
GTD0033840015	23	740	17,020	FG-HDMSDS040BBBEA	15	3802	HJM810510
GTD0033840016	23	740	17,020	FG-HDMSDS040BBBEA	16	3806	HJM810510
GTD0033840017	23	740	17,020	FG-HDMSDS040BBBEA	17	3810	HJM810510
GTD0033840018	23	740	17,020	FG-HDMSDS040BBBEA	18	3810	HJM810510
GTD0033840019	23	740	17,020	FG-HDMSDS040BBBEA	19	3814	HJM810510
GTD0033840020	23	740	17,020	FG-HDMSDS040BBBEA	20	3812	HJM810510
GTD0033840021	23	740	17,020	FG-HDMSDS040BBBEA	21	3806	HJM810510
GTD0033840022	23	740	17,020	FG-HDMSDS040BBBEA	22	3806	HJM810510
GTD0033840023	23	740	17,020	FG-HDMSDS040BBBEA	23	3810	HJM810510
GTD0033840024	23	740	17,020	FG-HDMSDS040BBBEA	24	3810	HJM810510
GTD0033840025	23	740	17,020	FG-HDMSDS040BBBEA	25	3804	HJM810510
GTD0033840026	23	740	17,020	FG-HDMSDS040BBBEA	26	3804	HJM810510
GTD0033840027	23	740	17,020	FG-HDMSDS040BBBEA	27	3800	HJM810510
GTD0033840028	23	740	17,020	FG-HDMSDS040BBBEA	28	3796	HJM810510
GTD0033840029	23	740	17,020	FG-HDMSDS040BBBEA	29	3796	HJM810510
GTD0033840030	23	740	17,020	FG-HDMSDS040BBBEA	30	3802	HJM810510
GTD0033840031	23	740	17,020	FG-HDMSDS040BBBEA	31	3810	HJM810510
GTD0033840032	23	740	17,020	FG-HDMSDS040BBBEA	32	3800	HJM810510
GTD0033840033	23	740	17,020	FG-HDMSDS040BBBEA	33	3814	HJM810510
GTD0033840034	23	740	17,020	FG-HDMSDS040BBBEA	34	3812	HJK810050
GTD0033840035	23	740	17,020	FG-HDMSDS040BBBEA	35	3804	HJK810050
GTD0033840036	23	740	17,020	FG-HDMSDS040BBBEA	36	3780	HJK810050
GTD0033840037	23	740	17,020	FG-HDMSDS040BBBEA	37	3794	HJK810050
GTD0033840038	23	740	17,020	FG-HDMSDS040BBBEA	38	3794	HJK810050
GTD0033840039	23	740	17,020	FG-HDMSDS040BBBEA	39	3794	HJK810050
GTD0033840040	23	740	17,020	FG-HDMSDS040BBBEA	40	3796	HJK810050
GTD0033840041	23	740	17,020	FG-HDMSDS040BBBEA	41	3798	HJK810050
GTD0033840042	23	740	17,020	FG-HDMSDS040BBBEA	42	3804	HJK810050
GTD0033840043	23	740	17,020	FG-HDMSDS040BBBEA	43	3808	HJK810050
GTD0033840044	23	740	17,020	FG-HDMSDS040BBBEA	44	3820	HJK810050
GTD0033840045	23	740	17,020	FG-HDMSDS040BBBEA	45	3754	HJK810050
GTD0033840046	23	740	17,020	FG-HDMSDS040BBBEA	46	3746	HJK810050
GTD0033840047	23	740	17,020	FG-HDMSDS040BBBEA	47	3738	HJK810050
GTD0033840048	23	740	17,020	FG-HDMSDS040BBBEA	48	3744	HJK810050
GTD0033840049	23	740	17,020	FG-HDMSDS040BBBEA	49	3746	HJK810050
GTD0033840050	23	740	17,020	FG-HDMSDS040BBBEA	50	3738	HJK810050
GTD0033840051	23	740	17,020	FG-HDMSDS040BBBEA	51	3722	HJK810050
GTD0033840052	23	740	17,020	FG-HDMSDS040BBBEA	52	3718	HJK810050

885,040
total for order

10F1

APPENDIX E.2

**Geomembrane Quality Control
Certificates**



2690-D Salisbury Hwy
 Statesville, NC 28677
 P: 704.208.3440
 www.ccsliners.com

SUBMITTAL COVER SHEET

DATE: 5/23/2019

SUBMITTAL NUMBER: 05 Rev A - Geomembrane MQC Certs - Response to Golder Review Dated 5/16/19

PROJECT NUMBER:	I19-032
PROJECT NAME:	JR Whiting Ponds 1&2 Closure
ATTENTION TO:	Steve Ganong

OWNER: Consumers Energy J.R. Whiting Generating Facility 4525 E. Erie Road Erie, MI 48133	CONTRACTOR: Ryan Central Inc 2700 East Racine Street Janesville, WI 53545
---	--

MANUFACTURER: Agru America 40 mil HDPE Microspike **Revised to include Stress Crack (NCTL) certification and information regarding Oven Aging and UV test results**

SPEC. SECTION	SUBMITTAL ITEM DESCRIPTION
313800	Polyethylene Geomembrane Manufacturer Submittals
313800 1.04 A.2	Copies of dated quality control certificates issued by resin supplier.
313800 1.04 A.3	Results of tests conducted by geomembrane manufacturer to verify that resin used to manufacture geomembrane meets Specifications.
313800 1.04 A.8	Quality control certificates, signed by geomembrane manufacturer. Each quality control certificate shall include applicable roll identification numbers, testing procedures, and results of quality control tests.
313800 1.04 B.6	Certificate that extrudate to be used is comprised of same resin as geomembrane to be used.

<p>SUBCONTRACTOR REVIEW:</p> <p><i>These are submitted as checked below:</i></p> <p>For Approval: <input checked="" type="checkbox"/></p> <p>For Your Use: <input type="checkbox"/></p> <p>As Requested: <input type="checkbox"/></p> <p>Signature of CCS Reviewer: <u> Jennifer Battle </u></p>	<p>ENGINEER APPROVAL:</p>
--	---



Geomembrane Certification Package for
J.R. Whiting Ash Pond Closure

Erie, MI



MATERIAL CERTIFICATIONS IN THIS PACKAGE:

- 40 MIL HDPE MICROSPIKE



16 May 2019

Jennifer Battle
Chesapeake Containment Systems, Inc.
2690 D Salisbury Hwy
Statesville, NC 28677

RE: J.R. Whiting Generating Facility Ponds 1 & 2 Closure – UV/Oven Aging Testing Per Formulation and NCTL Testing – Golder Submittal 313800-02,03,04

Dear Ms. Battle,

Please find below AGRU's response to Golder's concerns indicated by item 3 in the referenced Submittal 313800-02, 03, 04:

- GRI GM 13 and GRI GM 17 require that UV Resistance and Oven Aging Testing be performed once per formulation. A formulation is described as a unique combination of virgin resin and carbon black. This testing is not specific to a particular thickness, surface characteristic or resin lot number, but rather describes properties intrinsic to the raw materials used to manufacture the finished product. Even though this testing is only required per formulation, we send samples of finished geomembrane to our resin supplier(s) periodically for testing to confirm continued compliance with standards. All rolls manufactured for the J.R. Whiting Generating Facility Ponds 1 & 2 Closure were produced from the same resin formulation as that for which UV/Oven Aging results were provided.
- NCTL testing is on-going, however AGRU does certify that all rolls supplied to this project shall achieve or surpass an NCTL transition time of 500 hours.

Sincerely,

A handwritten signature in black ink, appearing to read "Anthony Johnson", with a long horizontal flourish extending to the right.

Anthony Johnson
Technical Review Specialist
AGRU America



10 May 2019

Jennifer Battle
Chesapeake Containment Systems, Inc.
2690D Salisbury Hwy
Statesville, NC 28677

RE: AGRU OA #03022 JR Whiting Ash Pond Closure – Weld Rod Compatibility

Dear Ms. Battle,

Please see below the requested certifications for the above referenced Project:

- All weld rod produced and supplied for this Project is fully compatible with all geomembrane produced and supplied for this Project.

Sincerely,

A handwritten signature in black ink, appearing to read "Anthony Johnson", with a long horizontal flourish extending to the right.

Anthony Johnson
Technical Review Specialist
AGRU America



SECTION 1

List of Materials



JR Whiting - Ash Ponds 1 & 2 Closures
 Chesapeake Containment Systems, Inc.
 4525 Erie Road
 Erie, MI 48133

SO#: 00003022

FG-HDMSDS040BBBEA	52 rolls @ 740	885,040 ft ² .

roll #	width	English		Item	Count	weight	resin lot #
		length	area				
	ft.	ft.	ft ² .			lbs.	
GTD0033840001	23	740	17,020	FG-HDMSDS040BBBEA	1	3766	HJM810460
GTD0033840002	23	740	17,020	FG-HDMSDS040BBBEA	2	3806	HJM810460
GTD0033840003	23	740	17,020	FG-HDMSDS040BBBEA	3	3798	HJM810460
GTD0033840004	23	740	17,020	FG-HDMSDS040BBBEA	4	3810	HJM810510
GTD0033840005	23	740	17,020	FG-HDMSDS040BBBEA	5	3800	HJM810510
GTD0033840006	23	740	17,020	FG-HDMSDS040BBBEA	6	3800	HJM810510
GTD0033840007	23	740	17,020	FG-HDMSDS040BBBEA	7	3808	HJM810510
GTD0033840008	23	740	17,020	FG-HDMSDS040BBBEA	8	3810	HJM810510
GTD0033840009	23	740	17,020	FG-HDMSDS040BBBEA	9	3810	HJM810510
GTD0033840010	23	740	17,020	FG-HDMSDS040BBBEA	10	3798	HJM810510
GTD0033840011	23	740	17,020	FG-HDMSDS040BBBEA	11	3802	HJM810510
GTD0033840012	23	740	17,020	FG-HDMSDS040BBBEA	12	3800	HJM810510
GTD0033840013	23	740	17,020	FG-HDMSDS040BBBEA	13	3794	HJM810510
GTD0033840014	23	740	17,020	FG-HDMSDS040BBBEA	14	3800	HJM810510
GTD0033840015	23	740	17,020	FG-HDMSDS040BBBEA	15	3802	HJM810510
GTD0033840016	23	740	17,020	FG-HDMSDS040BBBEA	16	3806	HJM810510
GTD0033840017	23	740	17,020	FG-HDMSDS040BBBEA	17	3810	HJM810510
GTD0033840018	23	740	17,020	FG-HDMSDS040BBBEA	18	3810	HJM810510
GTD0033840019	23	740	17,020	FG-HDMSDS040BBBEA	19	3814	HJM810510
GTD0033840020	23	740	17,020	FG-HDMSDS040BBBEA	20	3812	HJM810510
GTD0033840021	23	740	17,020	FG-HDMSDS040BBBEA	21	3806	HJM810510
GTD0033840022	23	740	17,020	FG-HDMSDS040BBBEA	22	3806	HJM810510
GTD0033840023	23	740	17,020	FG-HDMSDS040BBBEA	23	3810	HJM810510
GTD0033840024	23	740	17,020	FG-HDMSDS040BBBEA	24	3810	HJM810510
GTD0033840025	23	740	17,020	FG-HDMSDS040BBBEA	25	3804	HJM810510
GTD0033840026	23	740	17,020	FG-HDMSDS040BBBEA	26	3804	HJM810510
GTD0033840027	23	740	17,020	FG-HDMSDS040BBBEA	27	3800	HJM810510
GTD0033840028	23	740	17,020	FG-HDMSDS040BBBEA	28	3796	HJM810510
GTD0033840029	23	740	17,020	FG-HDMSDS040BBBEA	29	3796	HJM810510
GTD0033840030	23	740	17,020	FG-HDMSDS040BBBEA	30	3802	HJM810510
GTD0033840031	23	740	17,020	FG-HDMSDS040BBBEA	31	3810	HJM810510
GTD0033840032	23	740	17,020	FG-HDMSDS040BBBEA	32	3800	HJM810510
GTD0033840033	23	740	17,020	FG-HDMSDS040BBBEA	33	3814	HJM810510
GTD0033840034	23	740	17,020	FG-HDMSDS040BBBEA	34	3812	HJK810050
GTD0033840035	23	740	17,020	FG-HDMSDS040BBBEA	35	3804	HJK810050
GTD0033840036	23	740	17,020	FG-HDMSDS040BBBEA	36	3780	HJK810050
GTD0033840037	23	740	17,020	FG-HDMSDS040BBBEA	37	3794	HJK810050
GTD0033840038	23	740	17,020	FG-HDMSDS040BBBEA	38	3794	HJK810050
GTD0033840039	23	740	17,020	FG-HDMSDS040BBBEA	39	3794	HJK810050
GTD0033840040	23	740	17,020	FG-HDMSDS040BBBEA	40	3796	HJK810050
GTD0033840041	23	740	17,020	FG-HDMSDS040BBBEA	41	3798	HJK810050
GTD0033840042	23	740	17,020	FG-HDMSDS040BBBEA	42	3804	HJK810050
GTD0033840043	23	740	17,020	FG-HDMSDS040BBBEA	43	3808	HJK810050
GTD0033840044	23	740	17,020	FG-HDMSDS040BBBEA	44	3820	HJK810050
GTD0033840045	23	740	17,020	FG-HDMSDS040BBBEA	45	3754	HJK810050
GTD0033840046	23	740	17,020	FG-HDMSDS040BBBEA	46	3746	HJK810050
GTD0033840047	23	740	17,020	FG-HDMSDS040BBBEA	47	3738	HJK810050
GTD0033840048	23	740	17,020	FG-HDMSDS040BBBEA	48	3744	HJK810050
GTD0033840049	23	740	17,020	FG-HDMSDS040BBBEA	49	3746	HJK810050
GTD0033840050	23	740	17,020	FG-HDMSDS040BBBEA	50	3738	HJK810050
GTD0033840051	23	740	17,020	FG-HDMSDS040BBBEA	51	3722	HJK810050
GTD0033840052	23	740	17,020	FG-HDMSDS040BBBEA	52	3718	HJK810050

885,040
 total for order



SECTION 2

Geomembrane Quality Control Certifications



JR Whiting - Ash Ponds 1 & 2 Closures
Chesapeake Containment Systems, Inc.
4525 Erie Road
Erie, MI 48133

SO#: **00003022**
 Liner Type: **40HD micro**
 Item: **FG-HDMSDS040BBEA**
 Current # of Rolls: **52**
 Roll Count: **1-52 (all)**

ENGLISH Measurements

Count	Roll #	(English)			ASTM D5994 (Modified)			ASTM D7466		Weight	Lot #	ASTM D3895	ASTM D792	ASTM D1238	ASTM D4218	ASTM D5596	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D1004	ASTM D4833	ASTM D5397	Production Date		
		Width	Length	Area	Min.	Max.	Ave.	Asperity (Top)	Asperity (Bottom)																				
		ft.	ft.	ft ² .	mils	mils	mils	mils	mils																			lbs.	
Minimum Results (ea. Col.)					37	42	40	29	29	3502		192	0.944	0.26	2.3	10	94	101	117	113	15	14	384	495	33	30	90		
1	GTD0033840001	23	740	17,020	38	47	43	36	33	3766	HJM810460	192	0.944	0.26	2.5	10	94	101	117	113	17	15	392	512	33	30	90	ONGOING	5/4/2019
2	GTD0033840002	23	740	17,020	39	47	43	37	33	3806	HJM810460	192	0.944	0.26	2.5	10	94	101	117	113	17	15	392	512	33	30	90	ONGOING	5/4/2019
3	GTD0033840003	23	740	17,020	38	48	42	37	33	3798	HJM810460	192	0.944	0.26	2.4	10	104	116	136	126	15	14	411	521	33	30	90	ONGOING	5/5/2019
4	GTD0033840004	23	740	17,020	40	46	43	40	33	3810	HJM810510	192	0.944	0.26	2.4	10	104	116	136	126	15	14	411	521	33	30	90	ONGOING	5/5/2019
5	GTD0033840005	23	740	17,020	39	45	43	32	33	3800	HJM810510	192	0.944	0.26	2.5	10	104	116	136	126	15	14	411	521	33	30	90	ONGOING	5/5/2019
6	GTD0033840006	23	740	17,020	39	46	41	33	33	3800	HJM810510	192	0.944	0.26	2.5	10	104	116	136	126	15	14	411	521	33	30	90	ONGOING	5/5/2019
7	GTD0033840007	23	740	17,020	39	44	41	34	34	3808	HJM810510	192	0.944	0.26	2.4	10	104	116	136	126	15	14	411	521	33	30	90	ONGOING	5/5/2019
8	GTD0033840008	23	740	17,020	39	45	42	32	33	3810	HJM810510	192	0.944	0.26	2.3	10	108	115	129	132	19	15	403	550	39	35	96	ONGOING	5/5/2019
9	GTD0033840009	23	740	17,020	39	46	42	32	32	3810	HJM810510	192	0.944	0.26	2.3	10	108	115	129	132	19	15	403	550	39	35	96	ONGOING	5/5/2019
10	GTD0033840010	23	740	17,020	41	46	44	30	32	3798	HJM810510	192	0.944	0.26	2.3	10	108	115	129	132	19	15	403	550	39	35	96	ONGOING	5/5/2019
11	GTD0033840011	23	740	17,020	38	45	43	34	34	3802	HJM810510	192	0.944	0.26	2.5	10	108	115	129	132	19	15	403	550	39	35	96	ONGOING	5/5/2019
12	GTD0033840012	23	740	17,020	40	45	42	33	34	3800	HJM810510	192	0.944	0.26	2.5	10	108	115	129	132	19	15	403	550	39	35	96	ONGOING	5/5/2019
13	GTD0033840013	23	740	17,020	39	43	41	30	33	3794	HJM810510	192	0.944	0.26	2.5	10	105	111	122	129	21	15	390	546	39	35	96	ONGOING	5/5/2019
14	GTD0033840014	23	740	17,020	39	44	42	31	33	3800	HJM810510	192	0.944	0.26	2.5	10	105	111	122	129	21	15	390	546	39	35	96	ONGOING	5/5/2019
15	GTD0033840015	23	740	17,020	38	45	41	32	32	3802	HJM810510	192	0.944	0.26	2.6	10	105	111	122	129	21	15	390	546	39	35	96	ONGOING	5/5/2019
16	GTD0033840016	23	740	17,020	39	44	42	30	33	3806	HJM810510	192	0.944	0.26	2.6	10	105	111	122	129	21	15	390	546	39	35	96	ONGOING	5/6/2019
17	GTD0033840017	23	740	17,020	40	43	41	31	32	3810	HJM810510	192	0.944	0.26	2.5	10	105	111	122	129	21	15	390	546	39	35	96	ONGOING	5/6/2019
18	GTD0033840018	23	740	17,020	38	43	41	30	33	3810	HJM810510	192	0.944	0.26	2.5	10	105	113	127	127	19	14	421	528	39	35	98	ONGOING	5/6/2019
19	GTD0033840019	23	740	17,020	37	44	41	31	33	3814	HJM810510	192	0.944	0.26	2.6	10	105	113	127	127	19	14	421	528	39	35	98	ONGOING	5/6/2019
20	GTD0033840020	23	740	17,020	40	47	42	32	34	3812	HJM810510	192	0.944	0.26	2.6	10	105	113	127	127	19	14	421	528	39	35	98	ONGOING	5/6/2019
21	GTD0033840021	23	740	17,020	39	45	42	34	33	3806	HJM810510	192	0.944	0.26	2.4	10	105	113	127	127	19	14	421	528	39	35	98	ONGOING	5/6/2019
22	GTD0033840022	23	740	17,020	40	45	42	33	34	3806	HJM810510	192	0.944	0.26	2.4	10	105	113	127	127	19	14	421	528	39	35	98	ONGOING	5/6/2019
23	GTD0033840023	23	740	17,020	40	46	43	35	35	3810	HJM810510	192	0.944	0.26	2.5	10	112	116	143	128	20	16	426	518	56	60	98	ONGOING	5/6/2019
24	GTD0033840024	23	740	17,020	38	44	42	34	36	3810	HJM810510	192	0.944	0.26	2.4	10	112	116	143	128	20	16	426	518	56	60	98	ONGOING	5/6/2019
25	GTD0033840025	23	740	17,020	40	45	43	31	29	3804	HJM810510	192	0.944	0.26	2.4	10	112	116	143	128	20	16	426	518	56	60	98	ONGOING	5/6/2019
26	GTD0033840026	23	740	17,020	41	50	45	36	34	3804	HJM810510	192	0.944	0.26	2.5	10	112	116	143	128	20	16	426	518	56	60	98	ONGOING	5/6/2019
27	GTD0033840027	23	740	17,020	40	47	43	37	33	3800	HJM810510	192	0.944	0.26	2.5	10	112	116	143	128	20	16	426	518	56	60	98	ONGOING	5/6/2019
28	GTD0033840028	23	740	17,020	42	48	44	35	35	3796	HJM810510	192	0.944	0.26	2.5	10	107	111	139	132	21	15	445	550	35	35	100	ONGOING	5/6/2019
29	GTD0033840029	23	740	17,020	40	46	43	37	34	3796	HJM810510	192	0.944	0.26	2.5	10	107	111	139	132	21	15	445	550	35	35	100	ONGOING	5/6/2019
30	GTD0033840030	23	740	17,020	41	45	43	35	34	3802	HJM810510	192	0.944	0.26	2.5	10	107	111	139	132	21	15	445	550	35	35	100	ONGOING	5/6/2019
31	GTD0033840031	23	740	17,020	40	45	43	35	35	3810	HJM810510	192	0.944	0.26	2.5	10	107	111	139	132	21	15	445	550	35	35	100	ONGOING	5/7/2019
32	GTD0033840032	23	740	17,020	40	45	43	31	30	3800	HJM810510	192	0.944	0.26	2.4	10	107	111	139	132	21	15	445	550	35	35	100	ONGOING	5/7/2019
33	GTD0033840033	23	740	17,020	42	46	45	37	35	3814	HJM810510	192	0.944	0.26	2.4	10	107	113	130	136	23	16	384	550	35	35	100	ONGOING	5/7/2019
34	GTD0033840034	23	740	17,020	39	48	43	35	35	3812	HJK810050	200	0.944	0.26	2.6	10	107	113	130	136	23	16	384	550	35	35	100	ONGOING	5/7/2019
35	GTD0033840035	23	740	17,020	39	47	43	38	36	3804	HJK810050	200	0.944	0.26	2.6	10	107	113	130	136	23	16	384	550	35	35	100	ONGOING	5/7/2019



JR Whiting - Ash Ponds 1 & 2 Closures
Chesapeake Containment Systems, Inc.
4525 Erie Road
Erie, MI 48133

SO#: **00003022**
 Liner Type: **40HD micro**
 Item: **FG-HDMSDS040BBBEA**
 Current # of Rolls: **52**
 Roll Count: **1-52 (all)**

ENGLISH Measurements

Count	Roll #	(English)			ASTM D5994 (Modified)			ASTM D7466		Weight	Lot #	ASTM D3895	ASTM D792	ASTM D1238	ASTM D4218	ASTM D5596	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D6693	ASTM D1004	ASTM D4833	ASTM D5397	Production Date		
		Width	Length	Area	Min.	Max.	Ave.	Asperity (Top)	Asperity (Bottom)			OIT (Standard)	Specific Gravity	Melt Flow Index	Carbon Black Content	Carbon Black Disp.	Tensile Str. @Yield (MD)	Tensile Str. @Yield (TD)	Tensile Str. @Break (MD)	Tensile Str. @Break (TD)	Elong. @Yield (MD)	Elong. @Yield (TD)	Elong. @Break (MD)	Elong. @Break (TD)	Tear Resistance (MD)	Tear Resistance (TD)		Puncture Resistance	NCTL (500hrs.)
		ft.	ft.	ft ² .	mils	mils	mils	mils	mils			lbs.	min	g/cc	g/10 min.	%	(# in Cat. 1)	ppi	ppi	ppi	ppi	%	%	%	%	lbs.		lbs.	lbs.
Minimum Results (ea. Col.) →					37	42	40	29	29	3502		192	0.944	0.26	2.3	10	94	101	117	113	15	14	384	495	33	30	90		
36	GTD0033840036	23	740	17,020	39	49	43	38	36	3780	HJK810050	200	0.945	0.26	2.4	10	107	113	130	136	23	16	384	550	35	35	100	ONGOING	5/7/2019
37	GTD0033840037	23	740	17,020	39	43	41	30	33	3794	HJK810050	200	0.945	0.26	2.4	10	107	113	130	136	23	16	384	550	35	35	100	ONGOING	5/7/2019
38	GTD0033840038	23	740	17,020	38	44	41	29	32	3794	HJK810050	200	0.945	0.26	2.4	10	105	112	126	121	20	15	402	495	38	32	92	ONGOING	5/7/2019
39	GTD0033840039	23	740	17,020	38	48	42	33	32	3794	HJK810050	200	0.945	0.26	2.4	10	105	112	126	121	20	15	402	495	38	32	92	ONGOING	5/7/2019
40	GTD0033840040	23	740	17,020	38	42	41	30	33	3796	HJK810050	200	0.945	0.26	2.4	10	105	112	126	121	20	15	402	495	38	32	92	ONGOING	5/7/2019
41	GTD0033840041	23	740	17,020	39	42	41	30	33	3798	HJK810050	200	0.945	0.26	2.4	10	105	112	126	121	20	15	402	495	38	32	92	ONGOING	5/7/2019
42	GTD0033840042	23	740	17,020	41	48	44	36	34	3804	HJK810050	200	0.945	0.26	2.5	10	105	112	126	121	20	15	402	495	38	32	92	ONGOING	5/7/2019
43	GTD0033840043	23	740	17,020	43	48	46	38	34	3808	HJK810050	200	0.945	0.26	2.6	10	114	123	142	145	21	14	405	560	38	32	92	ONGOING	5/7/2019
44	GTD0033840044	23	740	17,020	38	48	43	33	33	3820	HJK810050	200	0.945	0.26	2.6	10	114	123	142	145	21	14	405	560	38	32	92	ONGOING	5/7/2019
45	GTD0033840045	23	740	17,020	41	47	44	31	33	3754	HJK810050	200	0.945	0.26	2.6	10	114	123	142	145	21	14	405	560	38	32	92	ONGOING	5/8/2019
46	GTD0033840046	23	740	17,020	42	47	44	37	33	3746	HJK810050	200	0.945	0.26	2.5	10	114	123	142	145	21	14	405	560	38	32	92	ONGOING	5/8/2019
47	GTD0033840047	23	740	17,020	42	47	44	35	34	3738	HJK810050	200	0.945	0.26	2.5	10	114	123	142	145	21	14	405	560	38	32	92	ONGOING	5/8/2019
48	GTD0033840048	23	740	17,020	42	45	43	31	33	3744	HJK810050	200	0.945	0.26	2.5	10	112	118	146	137	21	15	416	547	39	33	97	ONGOING	5/8/2019
49	GTD0033840049	23	740	17,020	39	48	43	36	37	3746	HJK810050	200	0.945	0.26	2.5	10	112	118	146	137	21	15	416	547	39	33	97	ONGOING	5/8/2019
50	GTD0033840050	23	740	17,020	42	48	45	40	34	3738	HJK810050	200	0.945	0.26	2.4	10	112	118	146	137	21	15	416	547	39	33	97	ONGOING	5/8/2019
51	GTD0033840051	23	740	17,020	38	49	42	38	35	3722	HJK810050	200	0.945	0.26	2.4	10	112	118	146	137	21	15	416	547	39	33	97	ONGOING	5/8/2019
52	GTD0033840052	23	740	17,020	38	42	40	30	33	3718	HJK810050	200	0.945	0.26	2.4	10	112	118	146	137	21	15	416	547	39	33	97	ONGOING	5/8/2019



SECTION 3

Resin Certifications

Certificate of Analysis

Shipped To: AGRU AMERICA INC:GEORGETOWN
500 GARRISON RD
GEORGETOWN SC 29440
USA

Recipient: PALMER
Fax:


Delivery #: 89874473
PO #: 15893
Weight: 187100.000 LB
Ship Date: 04/06/2019
Package: BULK
Mode: Hopper Car
Car #: NAHX610138
Seal No: 143201

Product:
MARLEX K307 POLYETHYLENE in Bulk

Lot Number: HJM810460

Property	Test Method	Value	Unit
Melt Index	ASTM D1238	0.26	g/10min
HLMI Flow Rate	ASTM D1238	20	g/10min
Density	D1505 or D4883	0.937	g/cm3
Pellet Count	P02.08.03	28	pelet/gram
Production Date		11/08/2018	

The data set forth herein have been carefully compiled by Chevron Phillips Chemical Company LP (CPChem).
However, there is no warranty of any kind, either expressed or implied, applicable to its use, and the user assumes all risk and liability in connection therewith.

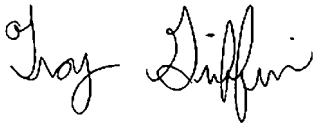

Troy Griffin
Quality Systems Coordinator

For CoA questions contact Patricia Royall at +1-832-813-4806

Certificate of Analysis

Shipped To: AGRU AMERICA INC:GEORGETOWN
500 GARRISON RD
GEORGETOWN SC 29440
USA

Recipient: PALMER
Fax:


Delivery #: 89877535
PO #: 15893
Weight: 189300.000 LB
Ship Date: 04/11/2019
Package: BULK
Mode: Hopper Car
Car #: SHQX041464
Seal No: 143423

Product:
MARLEX K307 POLYETHYLENE in Bulk

Lot Number: HJM810510

Property	Test Method	Value	Unit
Melt Index	ASTM D1238	0.26	g/10min
HLMI Flow Rate	ASTM D1238	21	g/10min
Density	D1505 or D4883	0.938	g/cm3
Pellet Count	P02.08.03	27	pelet/gram
Production Date		11/09/2018	

The data set forth herein have been carefully compiled by Chevron Phillips Chemical Company LP (CPChem).
However, there is no warranty of any kind, either expressed or implied, applicable to its use, and the user assumes all risk and liability in connection therewith.

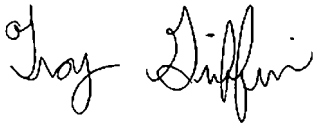

Troy Griffin
Quality Systems Coordinator

For CoA questions contact Patricia Royall at +1-832-813-4806

Certificate of Analysis

Shipped To: AGRU AMERICA INC:GEORGETOWN
500 GARRISON RD
GEORGETOWN SC 29440
USA

Recipient: PALMER
Fax:


Delivery #: 89879178
PO #: 15893
Weight: 181300.000 LB
Ship Date: 04/13/2019
Package: BULK
Mode: Hopper Car
Car #: CEFX054011
Seal No: 85788

Product:
MARLEX K307 POLYETHYLENE in Bulk

Lot Number: HJK810050

Property	Test Method	Value	Unit
Melt Index	ASTM D1238	0.26	g/10min
HLMI Flow Rate	ASTM D1238	22	g/10min
Density	D1505 or D4883	0.938	g/cm3
Pellet Count	P02.08.03	28	pelet/gram
Production Date		10/01/2018	

The data set forth herein have been carefully compiled by Chevron Phillips Chemical Company LP (CPChem).
However, there is no warranty of any kind, either expressed or implied, applicable to its use, and the user assumes all risk and liability in connection therewith.

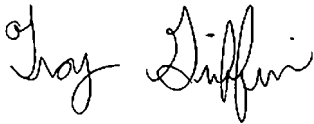

Troy Griffin
Quality Systems Coordinator

For CoA questions contact Patricia Royall at +1-832-813-4806



Vergil H. Rhodes, PE, CPlasT - Tech Svc & App Dev Engineer, Geomembranes
Highways 60 & 123, Bartlesville Research and Technology Center, Room 103 PTC
Bartlesville, OK 74003
■ 918-977-4229 ■ rhodevh@cpchem.com ■ Fax: 918-977-7599 ■ www.cpchem.com

October 31, 2017

Filename: Agru Oven and QUV Exposure Testing_103117.pdf

Nathan Ivy - Corporate Quality Control/Technical Manager
Agru America, Inc.
800 Rockmead #122
Kingwood, TX 77339
281-358-4741

Dear Mr. Ivy:

Please recall your request for testing of oven-exposed and UV-exposed geomembrane samples produced primarily from Marlex[®] 7104 LLDPE and Marlex[®] K307 HDPE. Agru blended other components with each of these polyethylenes to produce the geomembrane samples for testing. Smooth geomembrane samples have been received from Agru and test results are reported below. The samples were tested for HP-OIT in their as-received condition, and were also tested after oven and UV exposures of 90 days and 1600 hours of irradiance, respectively, in accordance with GRI-GM13 and GRI-GM17.

The following geomembrane sheet samples were received from Agru in mid-June 2017 and were reported to be primarily composed of each of the Chevron Phillips Chemical Company grades in the description below:

- K307 Lot #HHB620720, Agru Roll #G17D000534, black sheet, smooth, nominal 0.040" thick.
- 7104 Lot #CFJ810540, Agru Roll #G15B434055, black sheet, smooth, nominal 0.040" thick.

Exposure and testing conditions, along with the test results are tabulated on the next page. GM-13 and GM-17 require minimum % HP-OIT retention after a 90-day oven exposure and after a 1600 hour UV irradiance exposure. These test results indicate these GM-13 and GM-17 minimum % HP-OIT retentions were exceeded by these Agru-supplied K307 and 7104 sheet samples, respectively.

If you have any questions, please feel free to contact me (contact information given above).

Sincerely,

Vergil Rhodes
Polyethylene Technical Service and Applications Development, Geomembrane

NOTICES

Technical Information - By using any Technical Information contained herein, Recipient agrees that said Technical Information is given by CPChem for convenience only, without any warranty or guarantee of any kind, and is accepted and used at your sole risk. Recipients are encouraged to verify independently any such information to their reasonable satisfaction. As used in this paragraph, "Technical Information" includes any technical advice, recommendations, testing, or analysis, including, without limitation, information as it may relate to the selection of a product for a specific use and application.

The following oven aging and UV exposure test methods were conducted in accordance with the GRI-GM13 (HDPE) and GRI-GM17 (LLDPE) requirements:

Test Name	Exposure Conditions	Test Method
Oven Aging	90 days in an oven at 85 °C	ASTM D5721
UV Exposure	1600 UV irradiance hours. Cycle: 20 hours UVA-340 at 75 °C followed by 4 hours dark with condensation at 60 °C. Irradiance was 0.78 W/m ² at wavelength 340 nm. Note: This implies a total UV chamber residence time of 1920 hours, e.g., 1600 hours of irradiance and 320 hours of dark/condensation.	ASTM D7238
HP-OIT	150 °C in an oxygen atmosphere at 500 psi	ASTM D5885

Oven Aging Results:

Sample	Initial HP-OIT (min)	HP-OIT after 90 days of oven aging. (min)	% HP-OIT Retained after 90 days of oven aging.	GRI-GM13 and GRI-GM17 minimum % HP-OIT retained after 90 days of oven aging.
K307 Lot #HHB620720, Agru Roll #G17D000534, black sheet, smooth, nominal 0.040" thick	1264	1123	89	GRI-GM13: 80 minimum
7104 Lot #CFJ810540, Agru Roll #G15B434055, black sheet, smooth, nominal 0.040" thick	550	508	92	GRI-GM17: 60 minimum

UV Aging Results:

Sample	Initial HP-OIT (min)	HP-OIT after 1600 hrs of UV exposure. (min)	% HP-OIT Retained after 1600 hrs of UV exposure.	GRI-GM13 and GRI-GM17 minimum % HP-OIT retained after 1600 hrs of UV exposure.
K307 Lot #HHB620720, Agru Roll #G17D000534, black sheet, smooth, nominal 0.040" thick	1264	1024	81	GRI-GM13: 50 minimum
7104 Lot #CFJ810540, Agru Roll #G15B434055, black sheet, smooth, nominal 0.040" thick	550	470	85	GRI-GM17: 35 minimum

Note: 1600 hours of UV exposure in accordance with ASTM D7238 implies a total UV chamber residence time of 1920 hours, e.g., 1600 hours of irradiance and 320 hours of darkness with condensation.

NOTICES

Technical Information - By using any Technical Information contained herein, Recipient agrees that said Technical Information is given by CPChem for convenience only, without any warranty or guarantee of any kind, and is accepted and used at your sole risk. Recipients are encouraged to verify independently any such information to their reasonable satisfaction. As used in this paragraph, "Technical Information" includes any technical advice, recommendations, testing, or analysis, including, without limitation, information as it may relate to the selection of a product for a specific use and application.

APPENDIX F

Material Testing Geotextile

APPENDIX F.1

Geotextile Inventory Log

GEOSYNTHETIC INVENTORY CONTROL LOG

PROJECT NUMBER: 1788523 PROJECT TITLE: JRW Ash & Chemical Pond Clousure
 OWNER: CEC CONTRACTOR: FLSI
 LOCATION: Erie, Mi.

MATERIAL TYPE: GEOMEMBRANE GEONET GEOTEXTILE OTHER
 DATE OF ARRIVAL: 7.22.19 DATE OF INVENTORY: 7.22.19
 MATERIAL MANUFACTURER: AGRU INVENTORY MONITOR: DH
 PRODUCT IDENTIFICATION: 802 TEXTILE CONDITION IN TRUCK: Good
 TRUCK TYPE: FLATBED TRAILER UNLOADING METHOD:

	ROLL NUMBER	BATCH OR LOT NO.	MATERIAL DIMENSIONS			QC CERT Y/N	CONF. SAMP. Y/N	OTHER	REMARKS
			LENGTH	WIDTH	THICKNESS OR WEIGHT				
1	1003029012	NA	600'	15	802	Y	NA	NA	
2	-0011					Y			
3	-0094					Y			
4	-0010					Y			
5	-0035	NA	600'	15	802	Y	NA	NA	
* 6	-0135		600'			Y			NO CERT *
7	023410146	NA	600'	15	802	Y	NA	NA	
8	023410173	NA	230'	15	802	Y	NA	NA	
9									
10									
11									
12									
13									
14									
15									
16									
17									
18									
19									
20									
21									
22									
23									
24									
25									

Golder Form: G2
(July 2000)

REVIEWED BY: RS DATE: 12-2-19

GOLDER ASSOCIATES INC. HD

12/19/19